

SKETCH D

NEW VOLUNTARY GENERATOR





EXISTING LIFE-SAFETY GENERATOR



NORMAL SERVICE



EXISTING FIRE PUMP

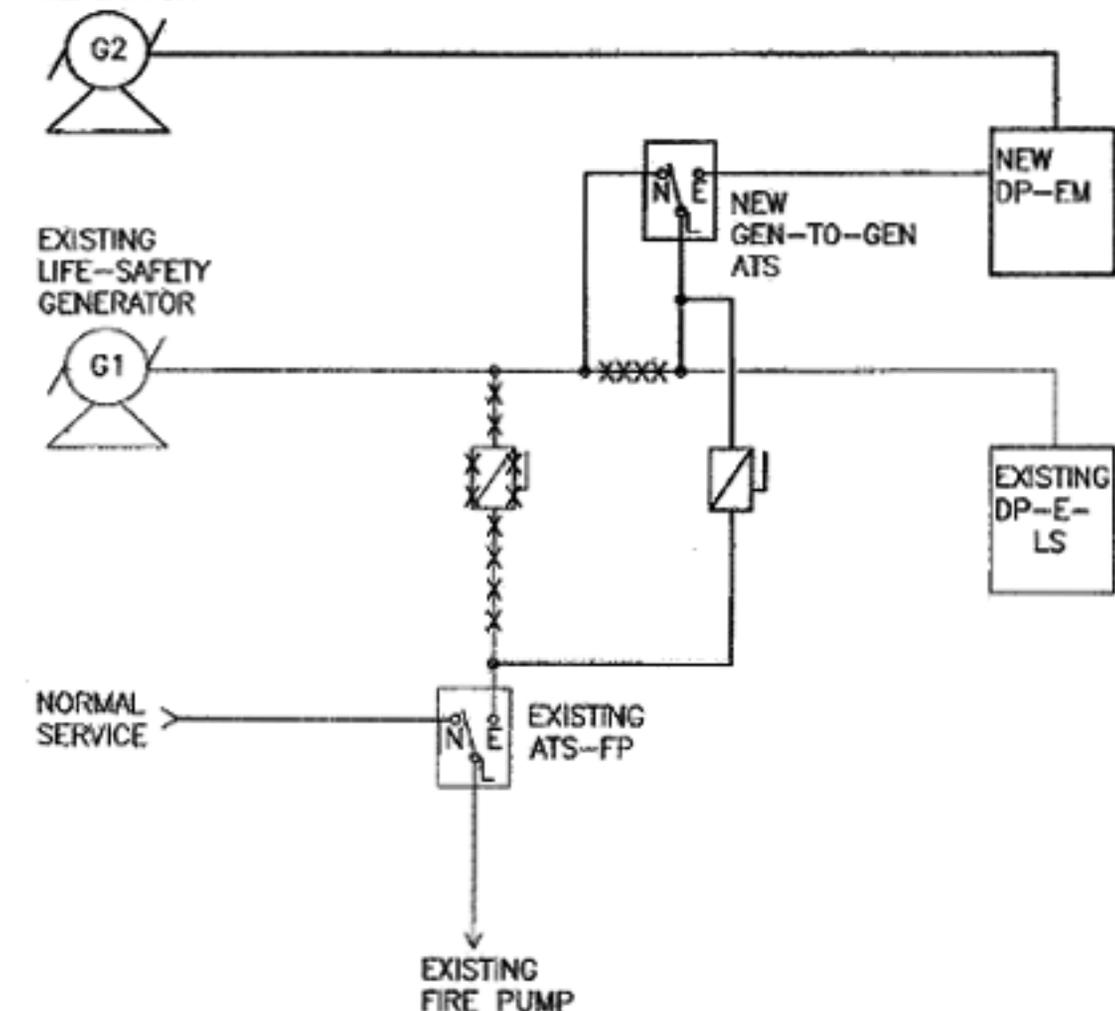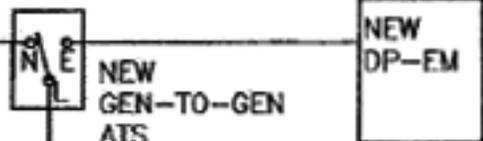

OPTION 2A:

IN THE EVENT THE NEW VOLUNTARY GENERATOR 2 IS REQUIRED TO PROVIDE ADDITIONAL EMERGENCY POWER TO EXISTING FIRE PUMP, AND IN LIEU OF PROVIDING AN ADDITIONAL ATS AS INDICATED IN OPTION 2, A TAP MADE DOWN-STREAM OF THE GEN-TO-GEN ATS SHALL BE MADE TO PROVIDE EMERGENCY POWER TO THE EXISTING FIRE PUMP AS INDICATED ABOVE.