



DISCONNECT 'WITHIN SIGHT' FROM AC UNIT

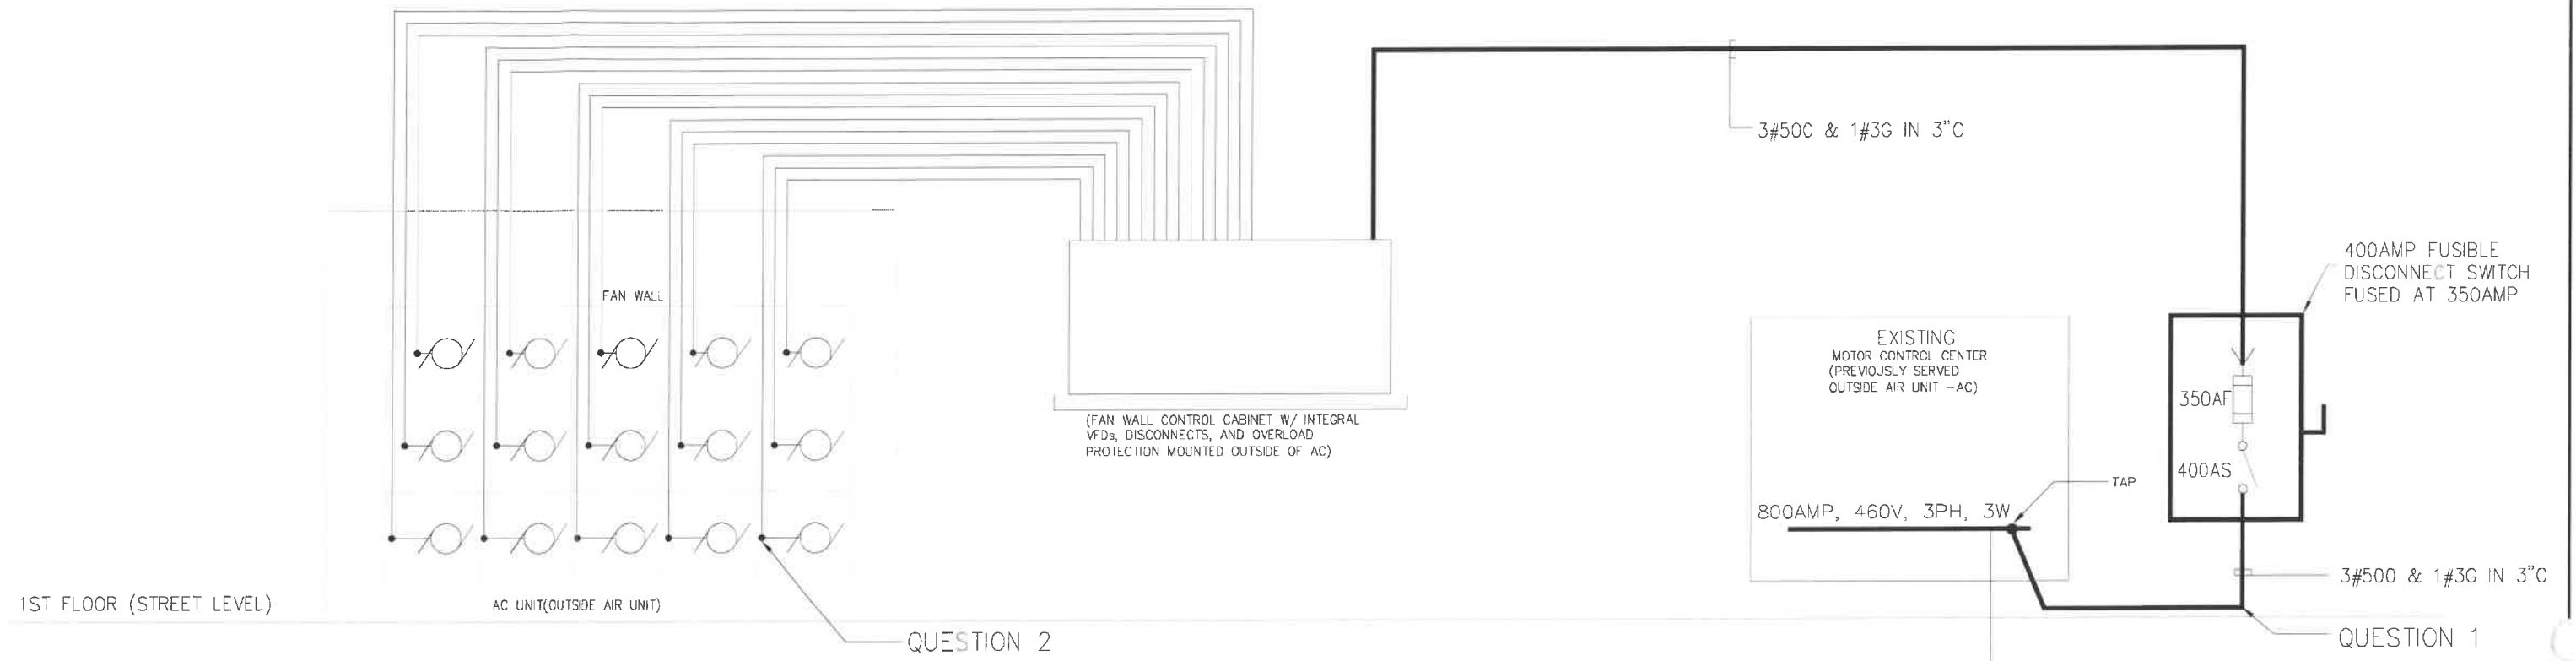

EXISTING 800AMP FEEDER  
6#500MCM  
(1968 CODE)

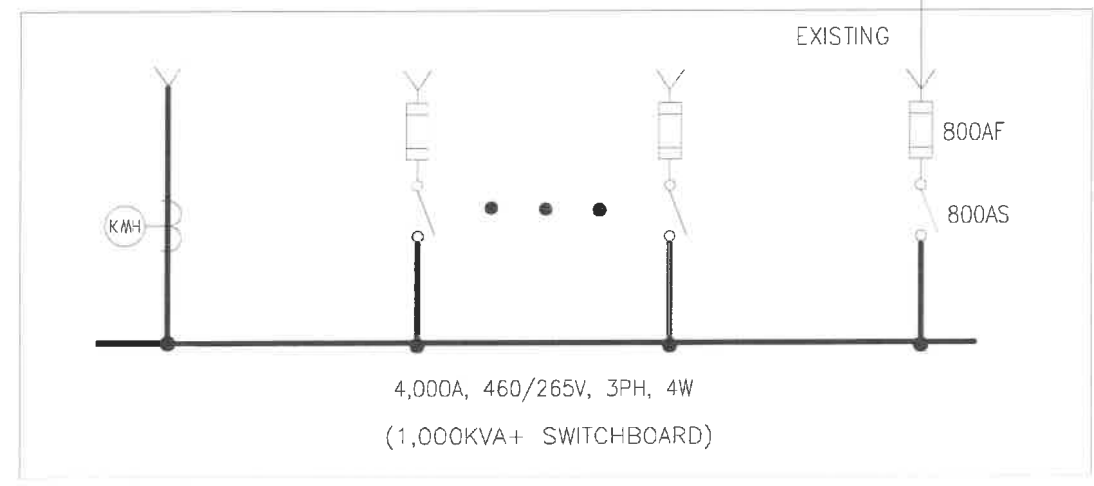

NOTE: ALL CABLES SHOWN - COPPER

CELLAR

DESCRIPTION:

### Electrical One Line Diagram

SCALE	NTS
SKETCH NO.	SKE-100