



SKETCH C

NEW VOLUNTARY GENERATOR

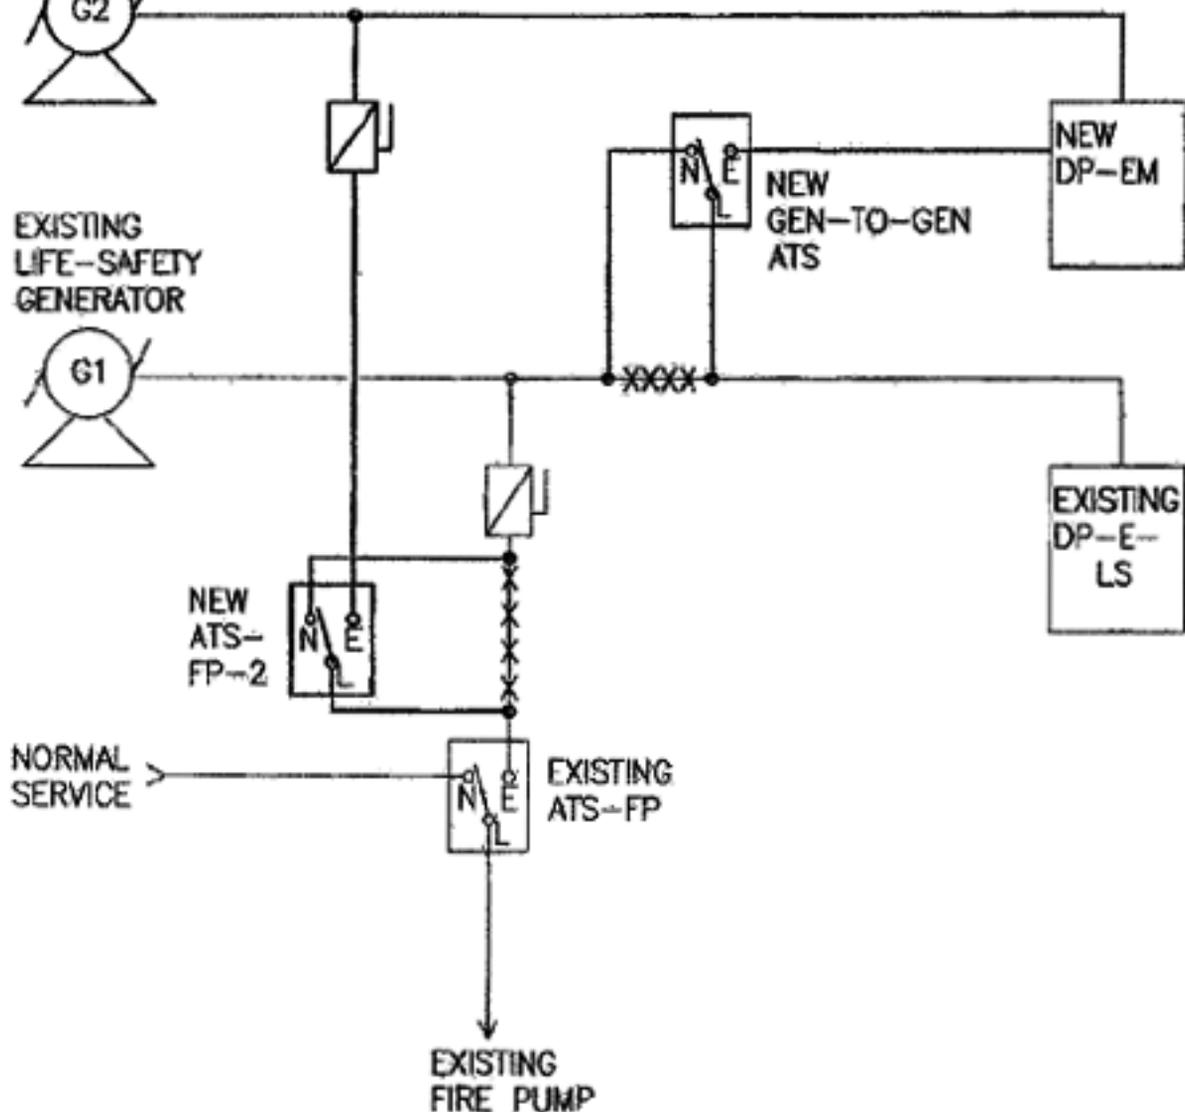

EXISTING LIFE-SAFETY GENERATOR



OPTION 2:

IN THE EVENT THE NEW VOLUNTARY GENERATOR 2 IS REQUIRED TO PROVIDE ADDITIONAL EMERGENCY POWER TO EXISTING FIRE PUMP, AN ADDITIONAL ATS SHALL BE INSTALLED TO SERVE THE FIRE PUMP. THE NEW ATS SHALL SWITCH EMERGENCY FEEDS FROM THE EXISTING LIFE-SAFETY GENERATOR AND NEW VOLUNTARY GENERATOR AS INDICATED ABOVE.