



DEPARTMENT OF BUILDINGS

EXECUTIVE OFFICES
60 HUDSON STREET, NEW YORK, N.Y. 10013

RUDOLPH J. RINALDI, Commissioner

GEORGE C. SAKONA, P.E.
First Assistant Commissioner
Technical Affairs
(212) 312-8120

June 5, 1990

Mr. C.T. Vogel P.E.
50 East 42nd Street
New York, N.Y. 10017-5405

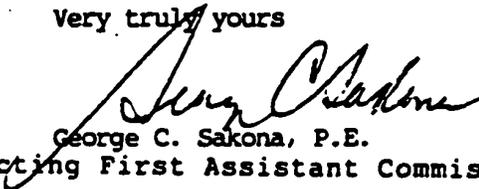
RE: Fire and Smoke Damper
Requirements in Occupancy
Group H-2

Dear Mr. Vogel:

Your request in a letter, dated April 17, 1990 to waive the requirements of smoke dampers in ducts for toilet exhaust penetrating toilet shafts has been reviewed by the office and is hereby approved provided the following conditions are compiled with:

1. No other ducts shall be permitted in the toilet shafts
2. Toilet exhaust fan shall remain on continuously.

Very truly yours


George C. Sakona, P.E.
Acting First Assistant Commissioner

GCS:cn

cc: Commissioner Rinaldi
Borough Superintendent
Executive Engineer I. Polsky, P.E.
Chief Toohey, Fire Dept.,
File