



**Environmental
Protection**

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD DESIGNS AND GUIDELINES FOR GREEN INFRASTRUCTURE PRACTICES

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

TABLE OF CONTENTS

SHEET TITLE

COVER SHEET
TOC-01 TABLE OF CONTENTS
TOC-02 TABLE OF CONTENTS (CONT.)

GI-100 STANDARDS FOR RIGHT-OF-WAY GREEN INFRASTRUCTURE PRACTICES

GI-101 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1
GI-102 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1
GI-103 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1A - WITH STONE COLUMNS
GI-104 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1A - WITH STONE COLUMNS
GI-105 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1B - WITH STORMWATER INLET
GI-106 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1B - WITH STORMWATER INLET
GI-107 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1C - WITH STORMWATER CHAMBER
GI-108 STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1C - WITH STORMWATER CHAMBER
GI-109 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2
GI-110 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2
GI-111 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2A - WITH STONE COLUMNS
GI-112 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2A - WITH STONE COLUMNS
GI-113 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2B - WITH STORMWATER INLET
GI-114 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2B - WITH STORMWATER INLET
GI-115 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2C - WITH STORMWATER CHAMBER
GI-116 STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2C - WITH STORMWATER CHAMBER
GI-117 STANDARD FOR 10'X5' R.O.W. BIOSWALE TYPE 3
GI-118 STANDARD FOR 10'X5' R.O.W. BIOSWALE TYPE 3
GI-119 STANDARD FOR 10'X5' R.O.W. BIOSWALE TYPE 3A - WITH STONE COLUMN
GI-120 STANDARD FOR 10'X5' R.O.W. BIOSWALE TYPE 3A - WITH STONE COLUMN
GI-121 STANDARD FOR R.O.W. RAIN GARDEN TYPE 1, TYPE 2, AND TYPE 3
GI-122 DIMENSION SCHEDULE FOR VARIABLE SIZE R.O.W. BIOSWALE AND R.O.W. RAIN GARDEN
GI-123 STONE COLUMN SCHEDULE FOR VARIABLE SIZE R.O.W. BIOSWALE
GI-124 SURFACE GRADING PLANS FOR R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-125 STANDARD FOR HYDRAULICALLY CONNECTED R.O.W.B. - PERFORATED PIPE
GI-126 STANDARD FOR R.O.W. STORMWATER INFILTRATION BASIN
GI-127 STANDARD FOR 20'x3' R.O.W. GREENSTRIP TYPE 1
GI-128 STANDARD FOR 20'x3' R.O.W. GREENSTRIP TYPE 1
GI-129 STANDARD FOR 15'x3' R.O.W. GREENSTRIP TYPE 2
GI-130 STANDARD FOR 15'x3' R.O.W. GREENSTRIP TYPE 2
GI-131 STANDARD FOR 10'x3' R.O.W. GREENSTRIP TYPE 3
GI-132 STANDARD FOR 10'x3' R.O.W. GREENSTRIP TYPE 3
GI-133 SURFACE GRADING & DIMENSION SCHEDULE PLANS FOR R.O.W. GREENSTRIPS
GI-134 STANDARD FOR R.O.W. PRECAST CONCRETE PANEL POROUS PAVEMENT

SHEET TITLE

GI-200 MISCELLANEOUS DETAILS FOR RIGHT-OF-WAY GREEN INFRASTRUCTURE PRACTICES

GI-201 STANDARD R.O.W. BIOSWALE INLET SEDIMENT PAD
GI-202 STANDARD FOR STORMWATER INLET
GI-203 STANDARD FOR PRECAST STORMWATER INLET
GI-204 STANDARD R.O.W. BIOSWALE DETAILS
GI-205 STANDARD DETAILS FOR R.O.W. STORMWATER INFILTRATION BASIN

GI-300 SUGGESTED GUIDELINES FOR RIGHT-OF-WAY STORMWATER GREENSTREETS LAYOUTS

GI-301 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1 LAYOUT
GI-302 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1 LAYOUT
GI-303 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1A-WITH STONE COLUMNS LAYOUT
GI-304 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1A-WITH STONE COLUMNS LAYOUT
GI-305 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2 LAYOUT
GI-306 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2 LAYOUT
GI-307 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2A-WITH STONE COLUMNS LAYOUT
GI-308 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2A-WITH STONE COLUMNS LAYOUT
GI-309 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 3 LAYOUT
GI-310 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) BIOFILTER INLET LAYOUT
GI-311 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) BIOFILTER INLET
GI-312 SUGGESTED GUIDELINES FOR R.O.W. STORMWATER GREENSTREET (ROWSGS) CONCRETE AND GRATE PEDESTRIAN PATHWAYS

GI-400 GUIDELINES FOR ON-SITE GREEN INFRASTRUCTURE PRACTICES

GI-401 GUIDELINES FOR ON-SITE BIORETENTION RAIN GARDEN
GI-402 GUIDELINES FOR ON-SITE POROUS AND PERMEABLE SURFACES
GI-403 GUIDELINES FOR ON-SITE SUBSURFACE STORMWATER RETENTION CHAMBER

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

TABLE OF CONTENTS

SHEET TITLE

GI-500 PLANTING PLANS FOR RIGHT-OF-WAY GREEN INFRASTRUCTURE PRACTICES



GI-501A	STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-501B	STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-501C	STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-501D	STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-502A	STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-502B	STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-502C	STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-502D	STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-503A	STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-503B	STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-503C	STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-503D	STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS
GI-504A	STANDARD PLANTING PLANS FOR TYPE 1 & TYPE 2 R.O.W. GREENSTRIPS
GI-504B	STANDARD PLANTING PLANS FOR TYPE 1 & TYPE 2 R.O.W. GREENSTRIPS
GI-504C	STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. GREENSTRIPS

GI-600 STEEL GUARDS STANDARDS FOR RIGHT-OF-WAY GREEN INFRASTRUCTURE PRACTICES

GI-601A	STANDARD FOR R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS - TYPE 'A' STEEL GUARD
GI-601B	STANDARD FOR R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS - TYPE 'B' STEEL GUARD
GI-601C	STANDARD FOR R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS - TYPE 'C' STEEL GUARD
GI-601D	STANDARD FOR R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS - TYPE 'D' STEEL GUARD
GI-602A	STANDARD FOR R.O.W. BIOSWALES - TYPE 'B-1' STEEL GUARD WITH BOLTED PANELS
GI-602A-1	STANDARD DETAILS FOR R.O.W. BIOSWALES - TYPE 'B-1' STEEL GUARD WITH BOLTED PANELS

**GI-100
STANDARDS FOR
RIGHT-OF-WAY GREEN INFRASTRUCTURE
PRACTICES**

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 20'x5' R.O.W. BIOSWALE TYPE 1
- NO CONNECTION TO SEWERS

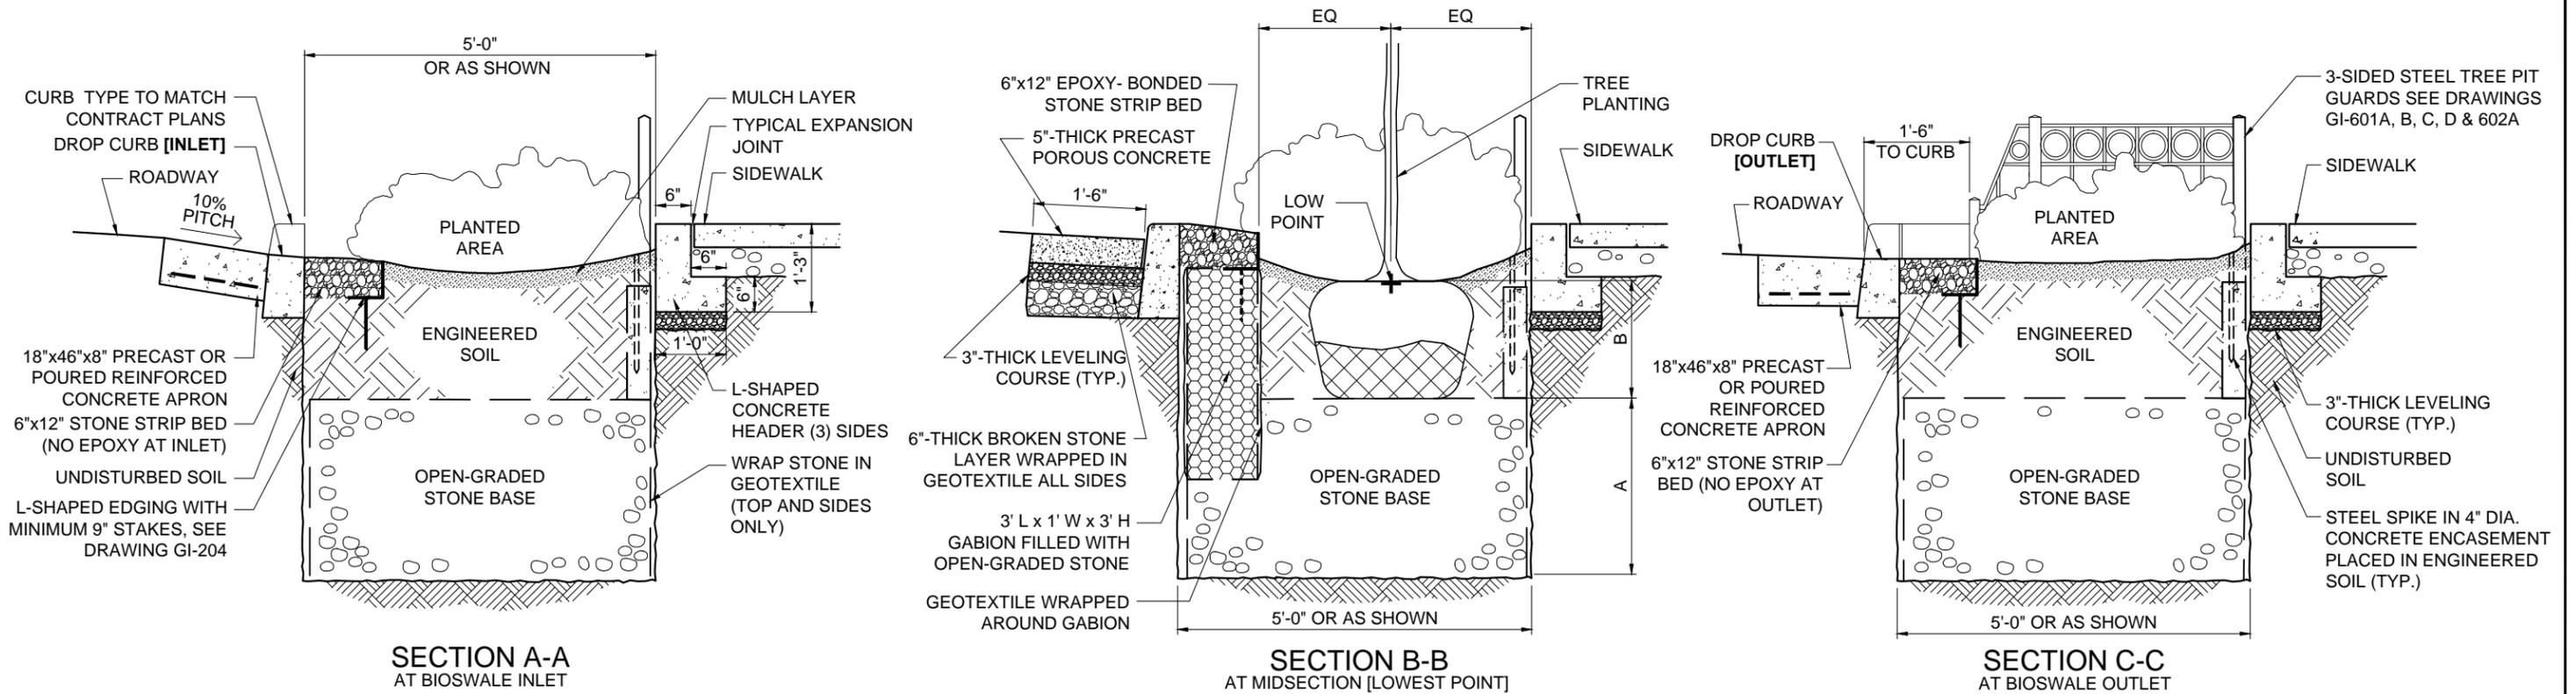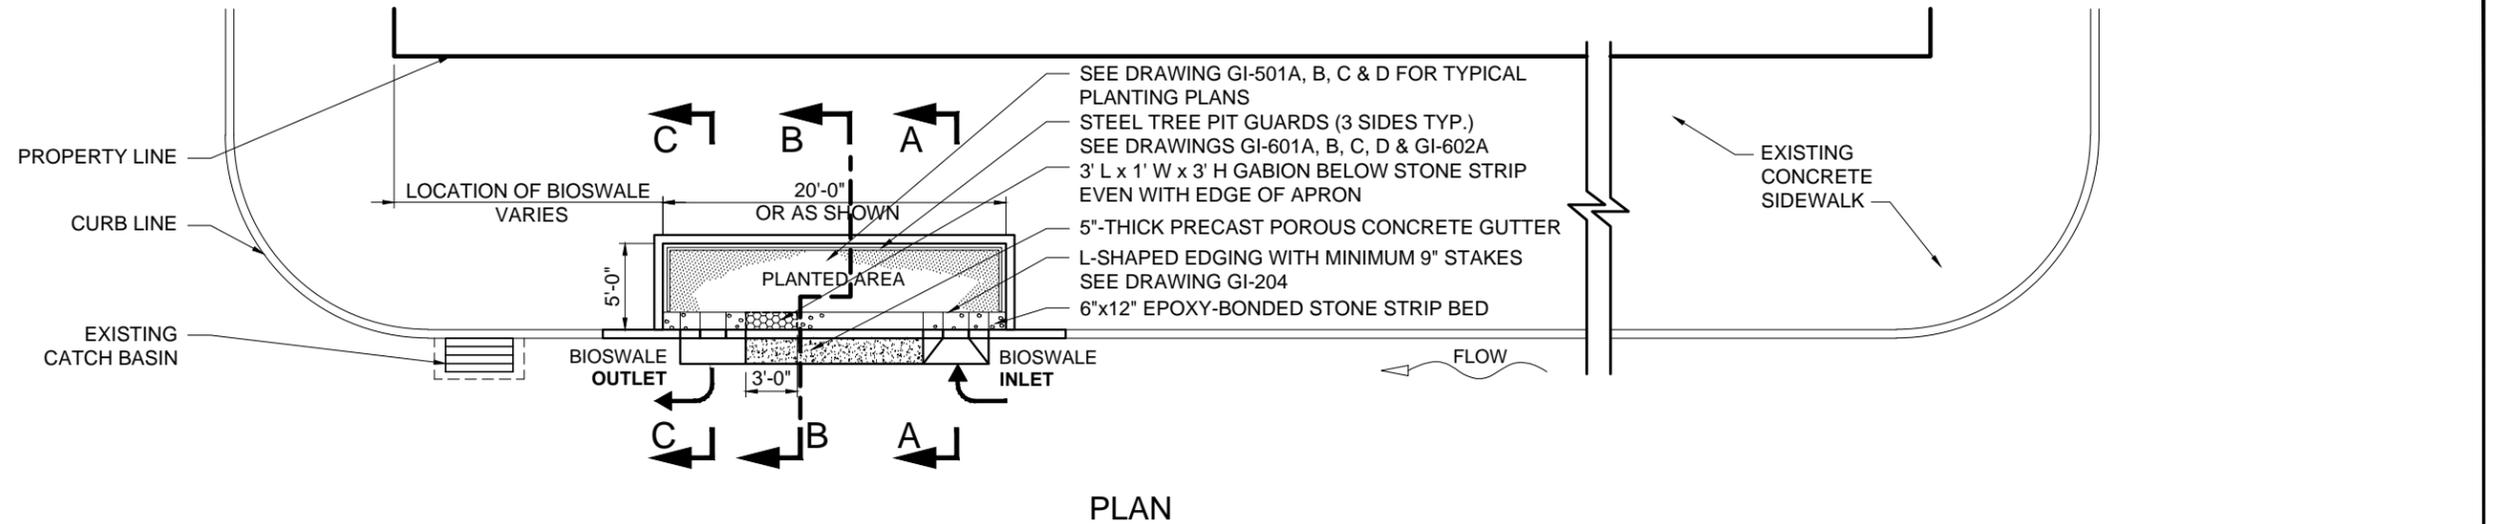


ROWB	A	B
WITH TREE	2'-6"	24" MIN
NO TREE	3'-0"	18" MIN

DEPTH SCHEDULE

Maedi Tuna
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 20'x5' R.O.W. BIOSWALE TYPE 1
- NO CONNECTION TO SEWERS

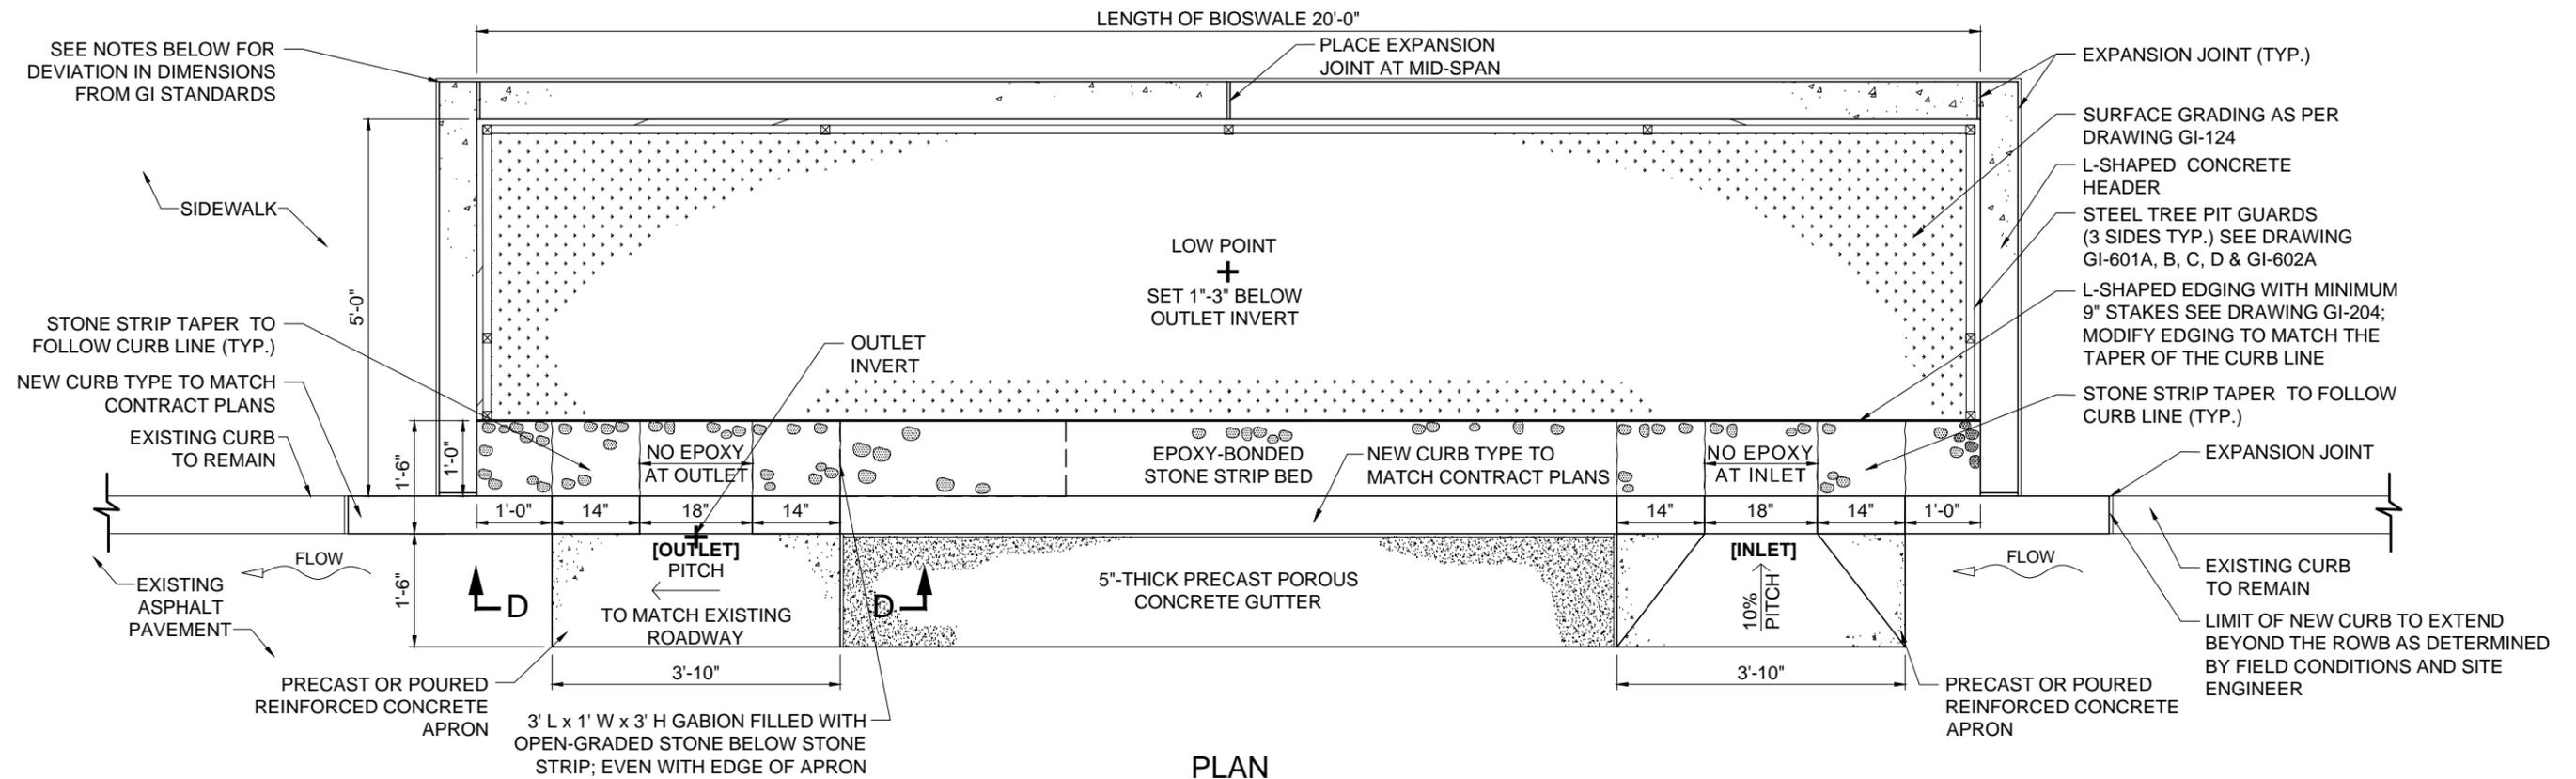

PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS

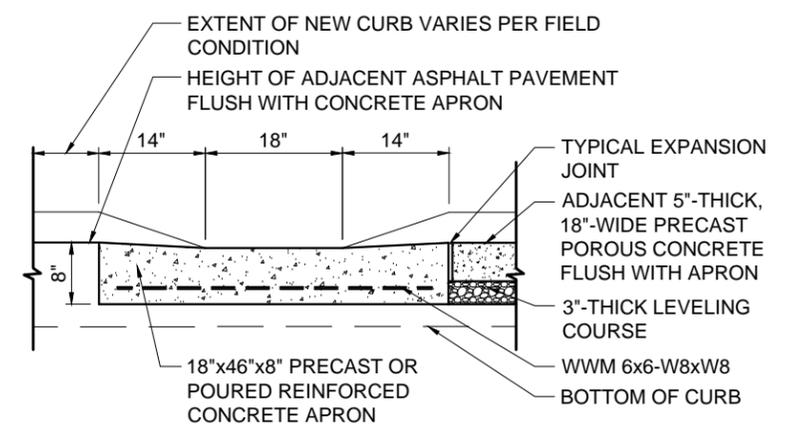

SECTION D-D




M. J. F. ASCE
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1A - WITH STONE COLUMNS

- NO CONNECTION TO SEWERS

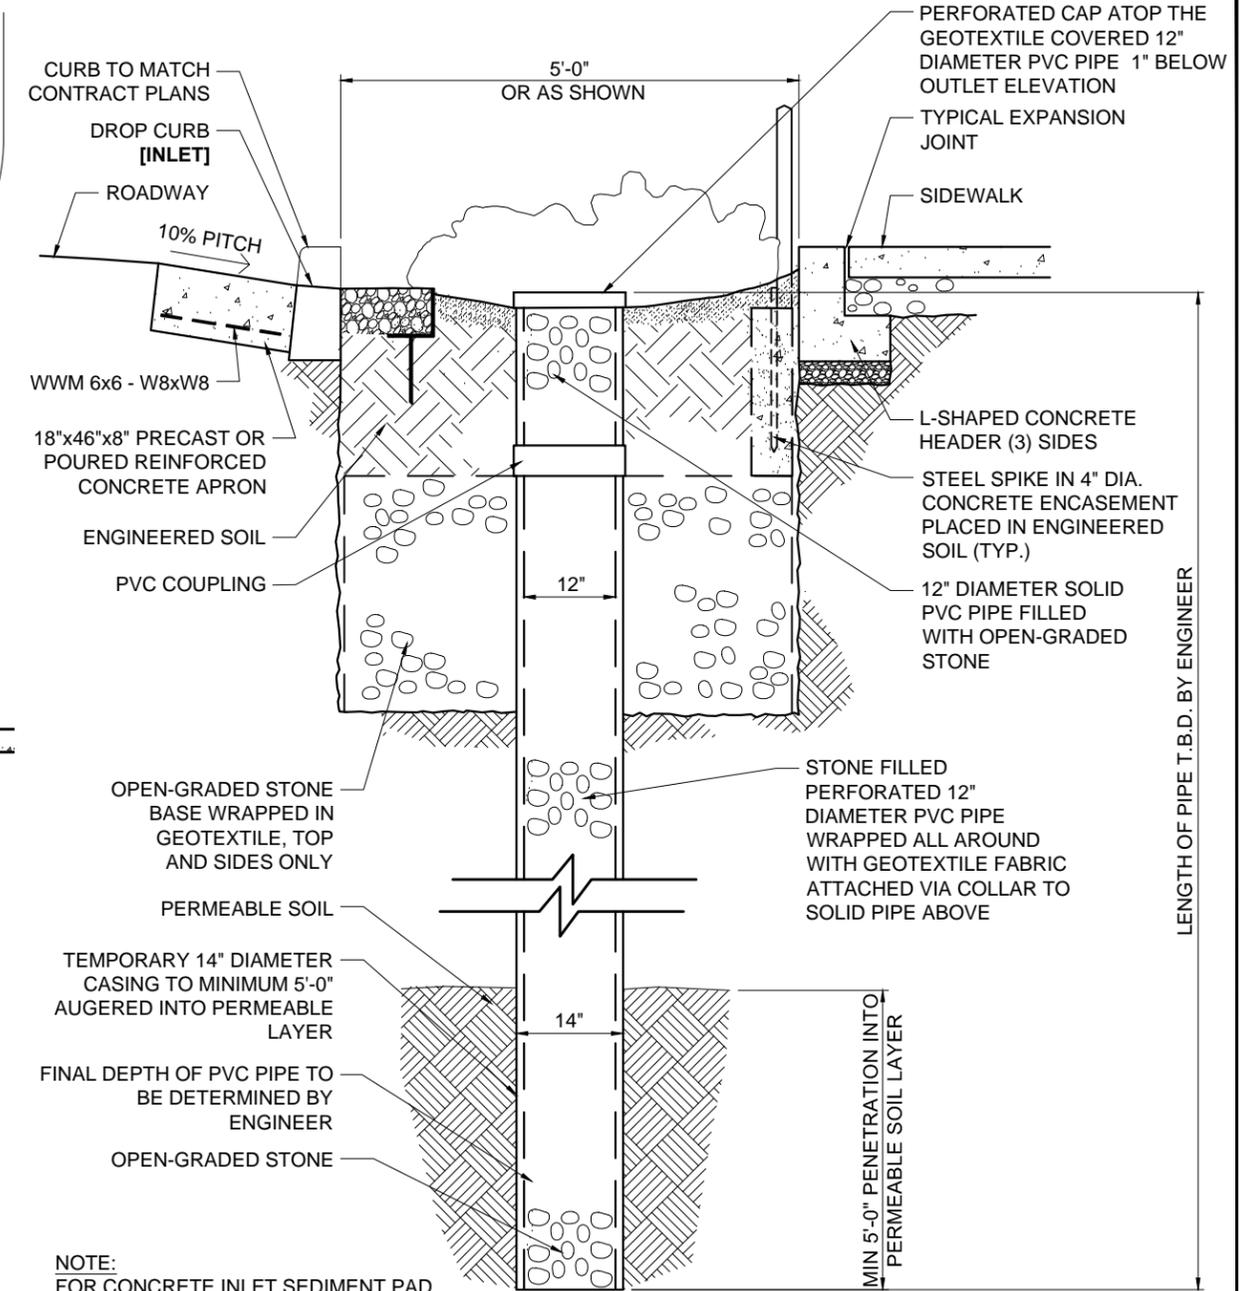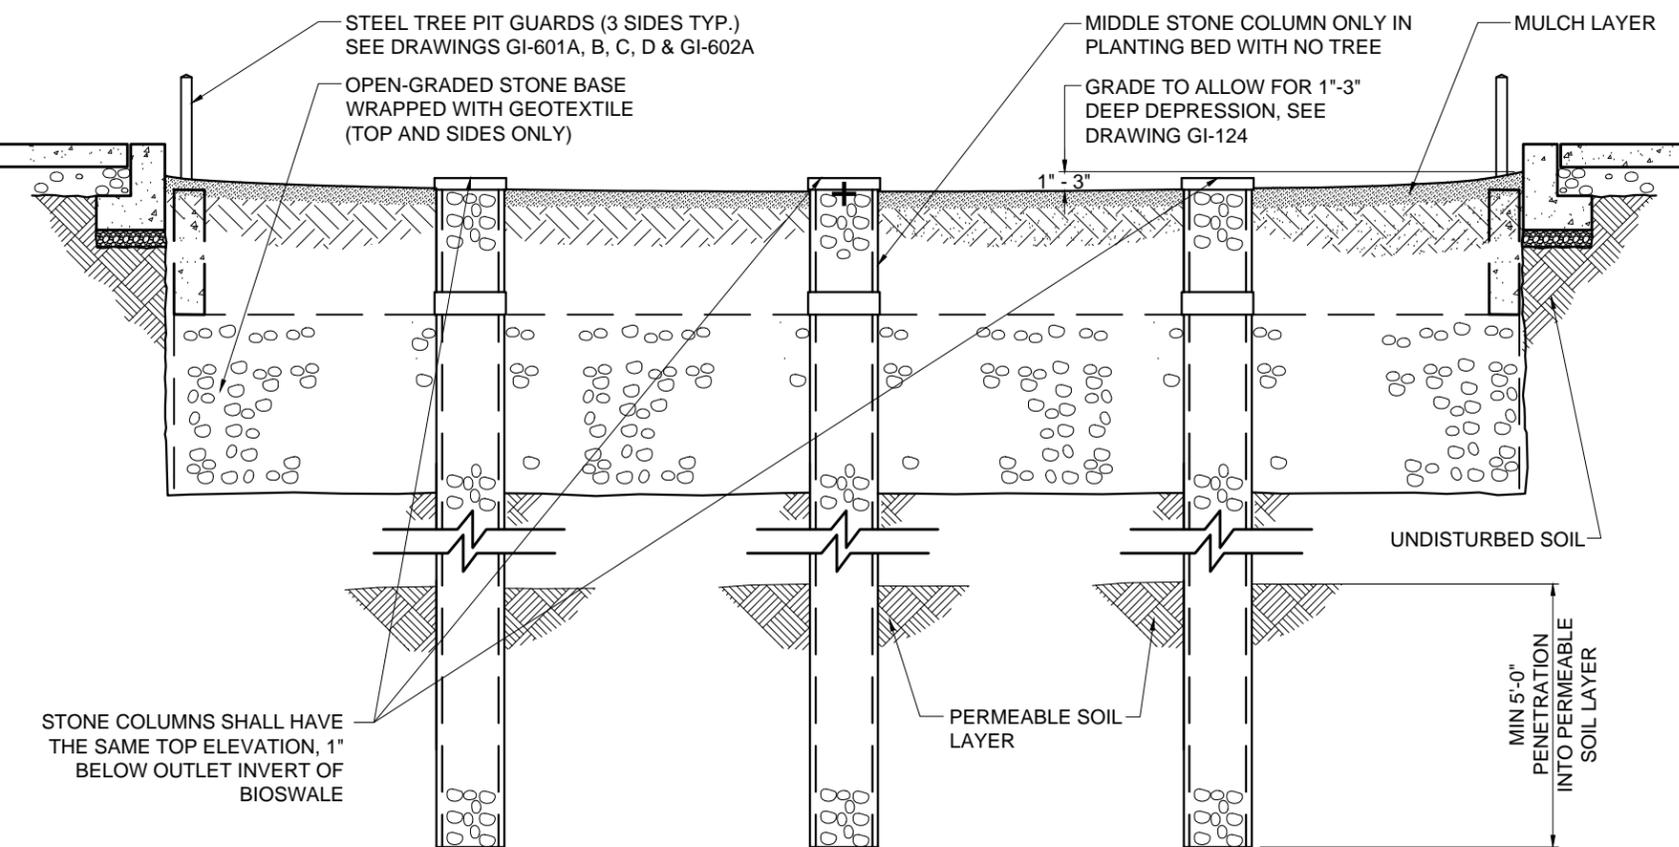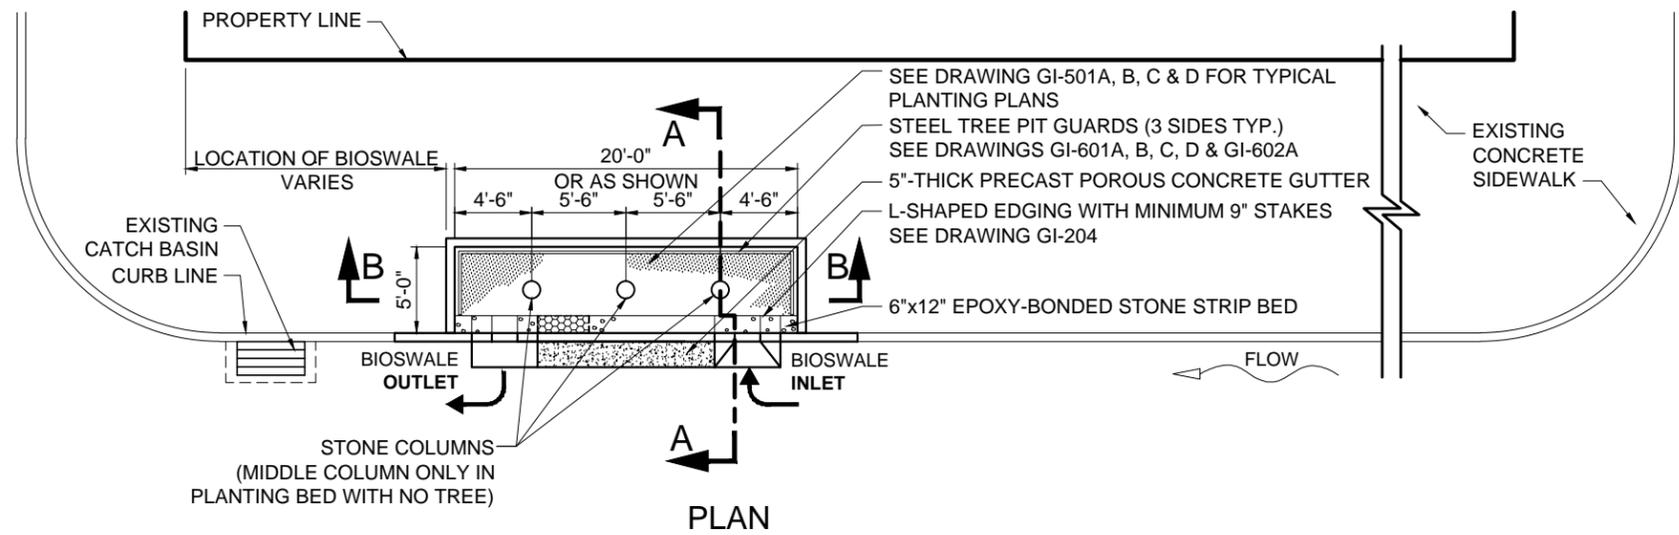


NOTE:
FOR CONCRETE INLET SEDIMENT PAD
SEE DRAWING GI-201

Maedi Tuna P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1A - WITH STONE COLUMNS
 - NO CONNECTION TO SEWERS

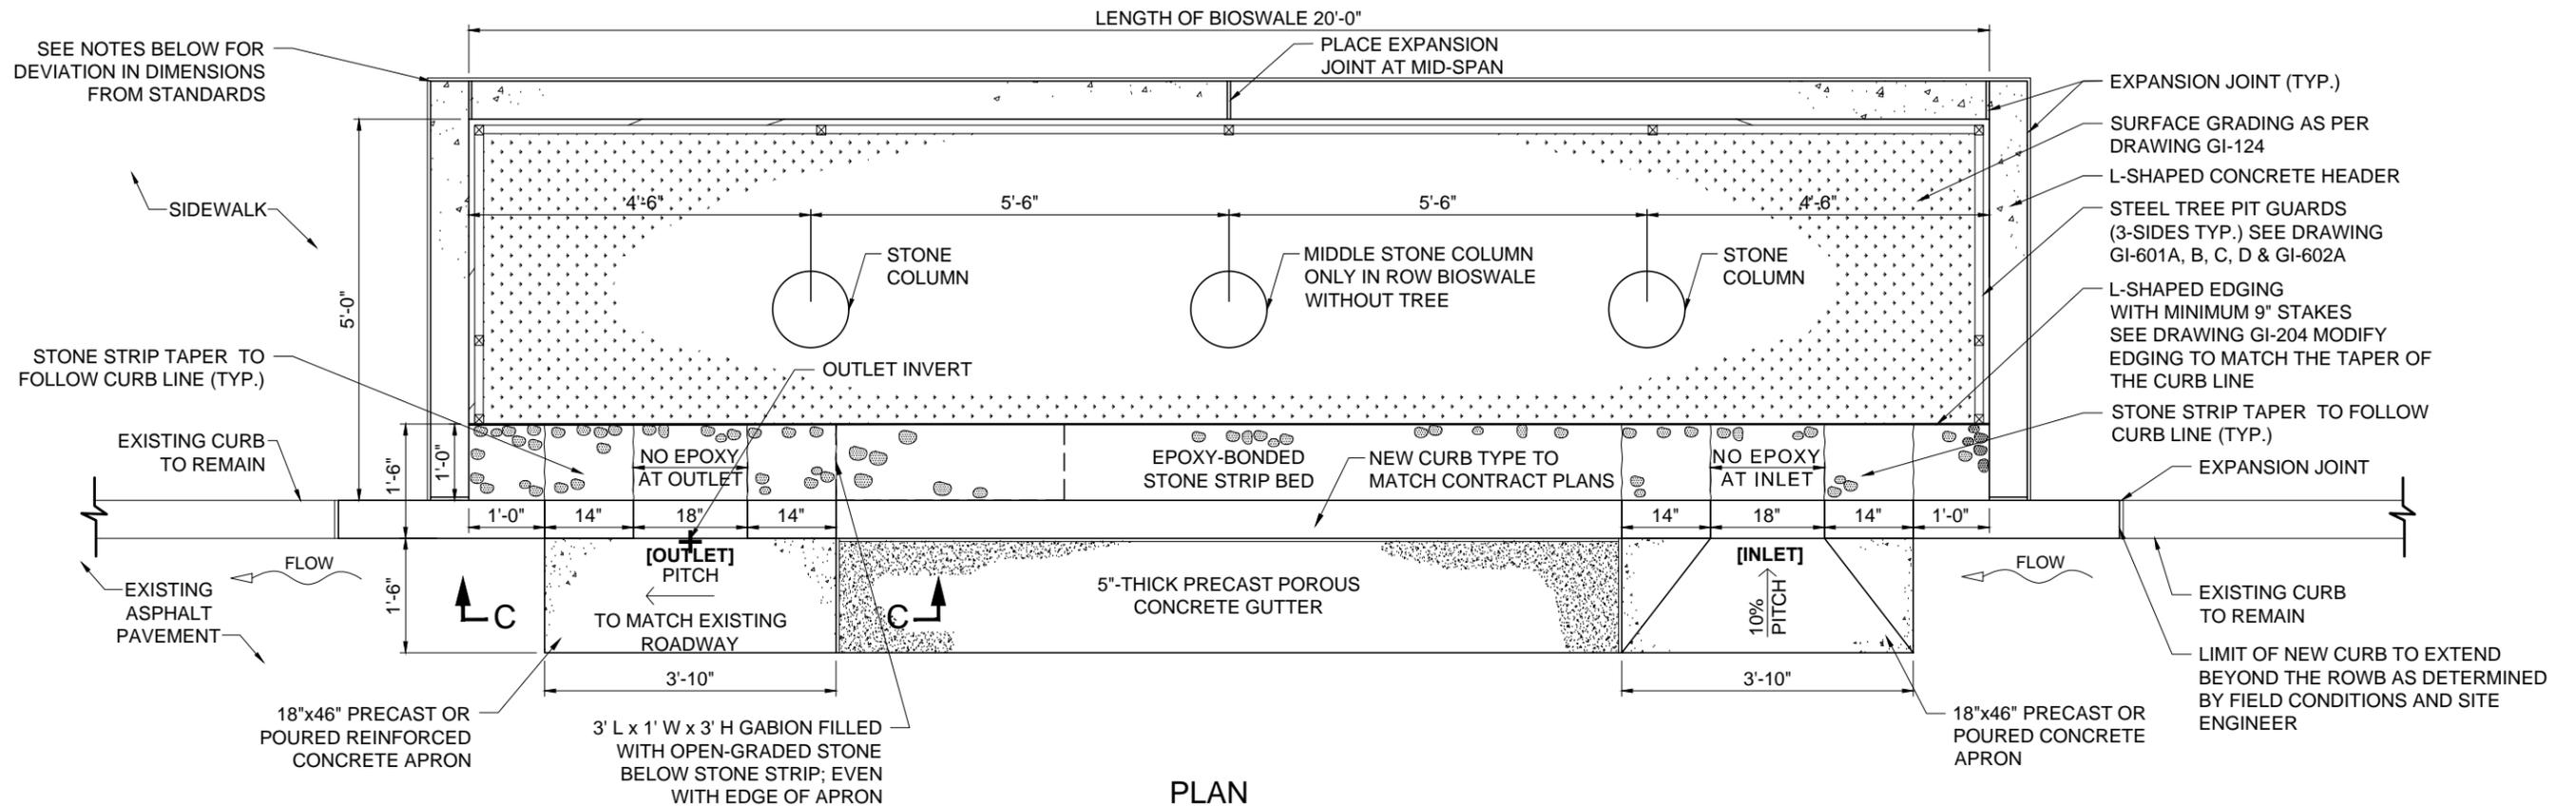

PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. 14" DIAMETER CASING TO BE AUGERED TO DEPTH AS DIRECTED BY ENGINEER. 12" DIAMETER PVC PIPE WRAPPED ALL AROUND WITH GEOTEXTILE FABRIC INSERTED IN THE 14" CASING
11. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS

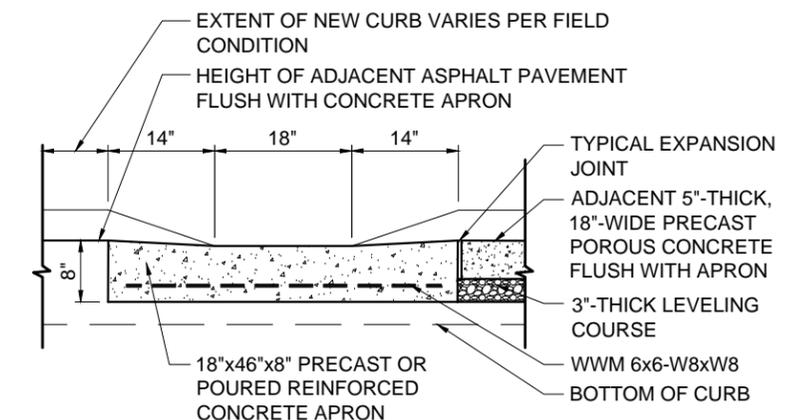



SECTION C-C

Maedi Tuma
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR 20'X5' R.O.W. BIOSWALE TYPE 1B - WITH STORMWATER INLET
- NO CONNECTION TO SEWERS

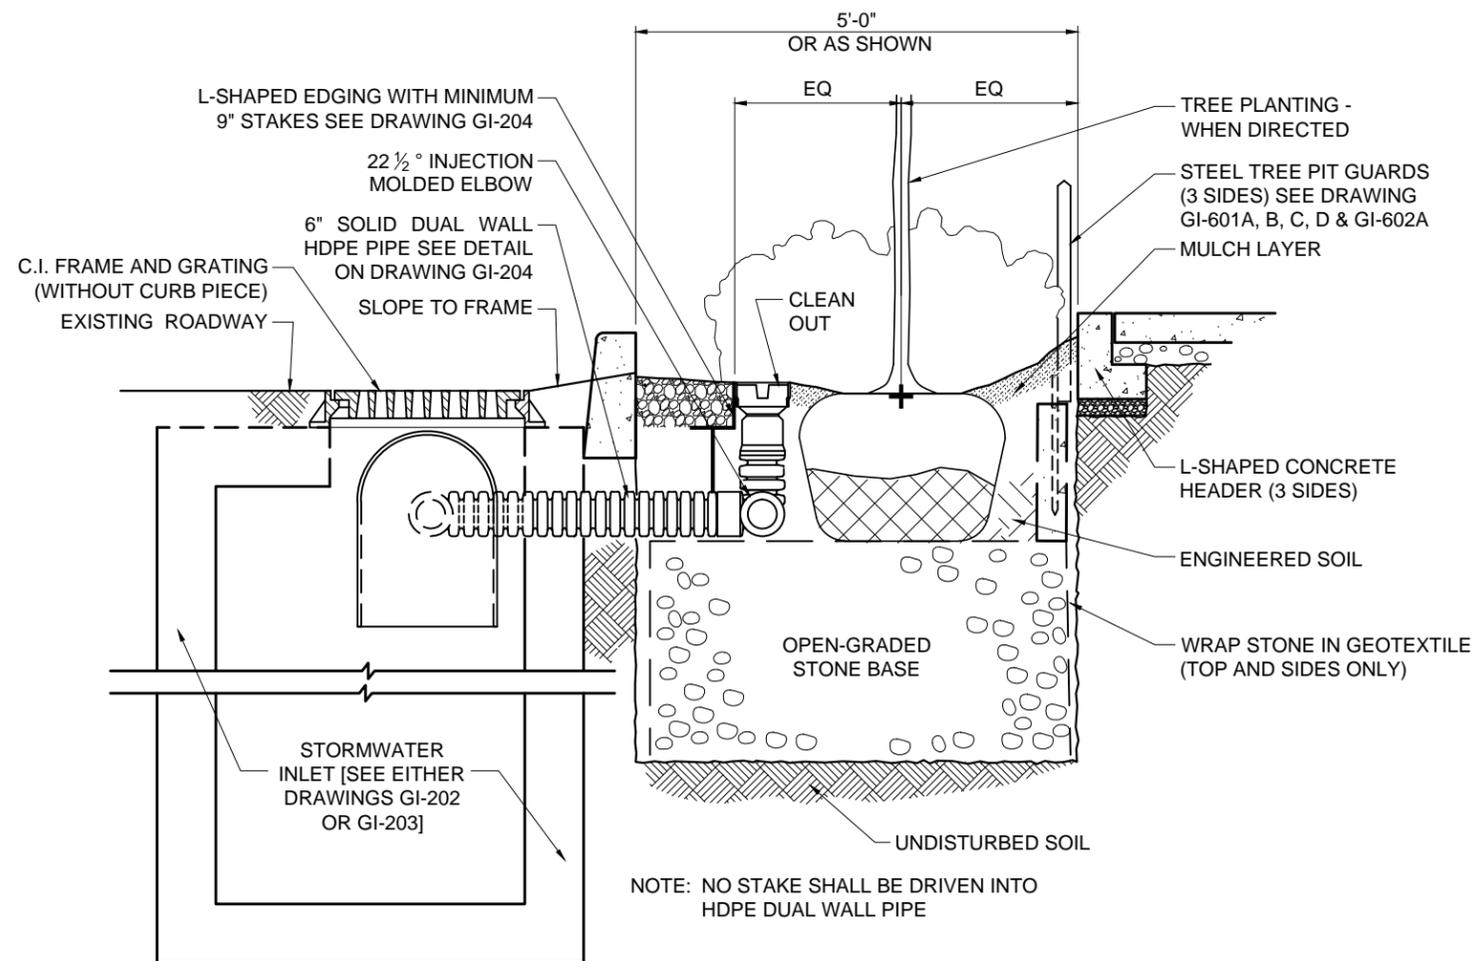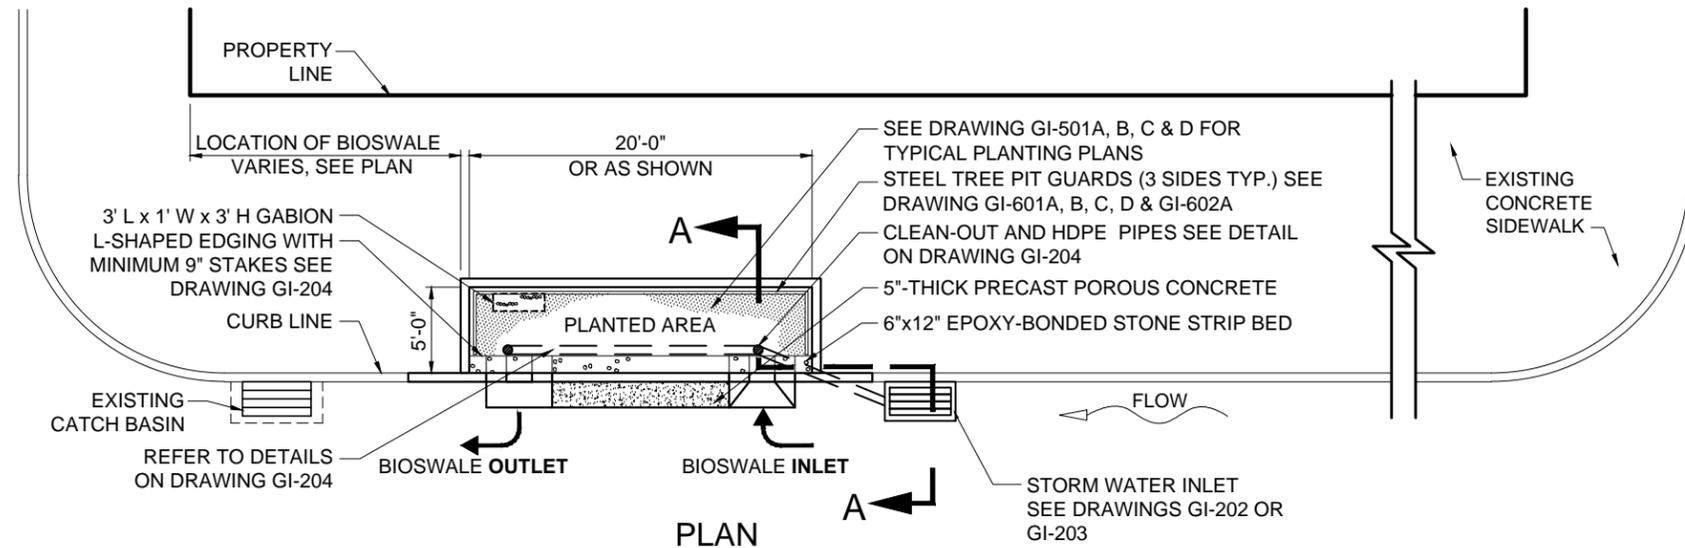

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2') FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2') FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS


Maedi Tuna
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR 20'x5' R.O.W. BIOSWALE TYPE 1C - WITH STORMWATER CHAMBER


- NO CONNECTION TO SEWERS

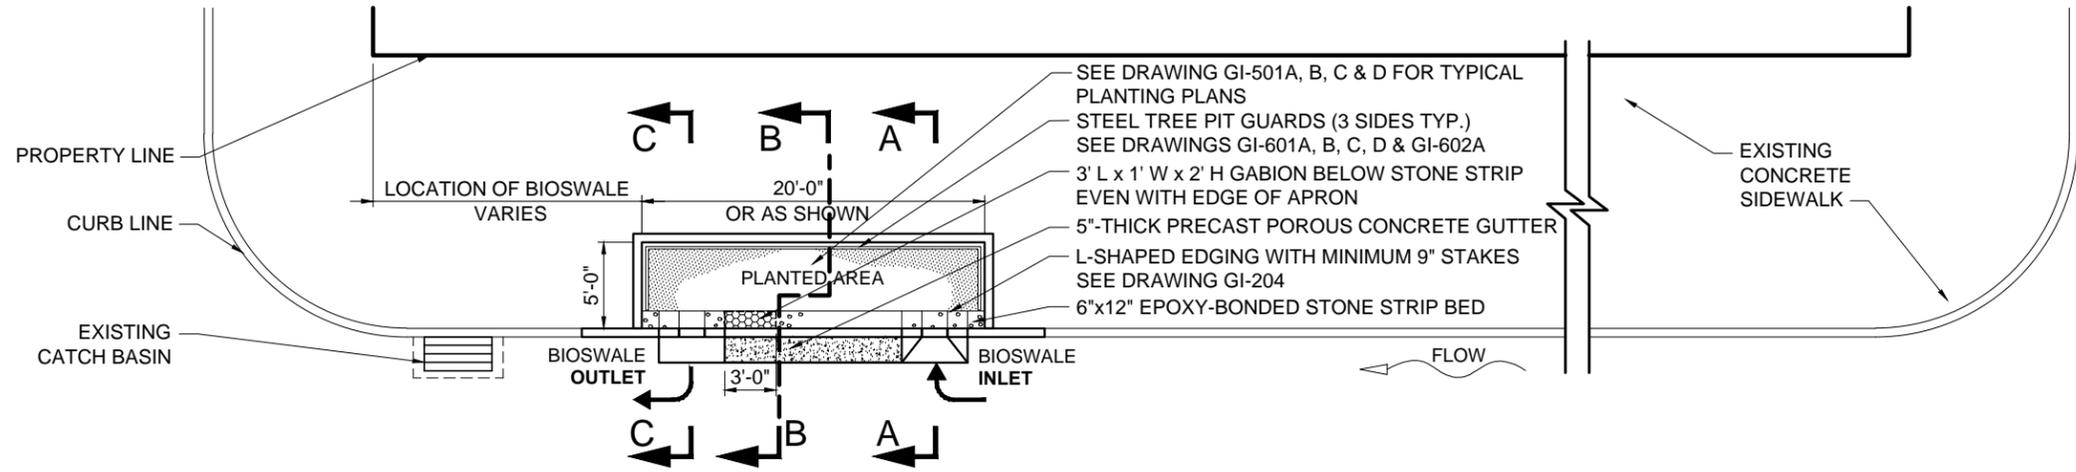


PLAN

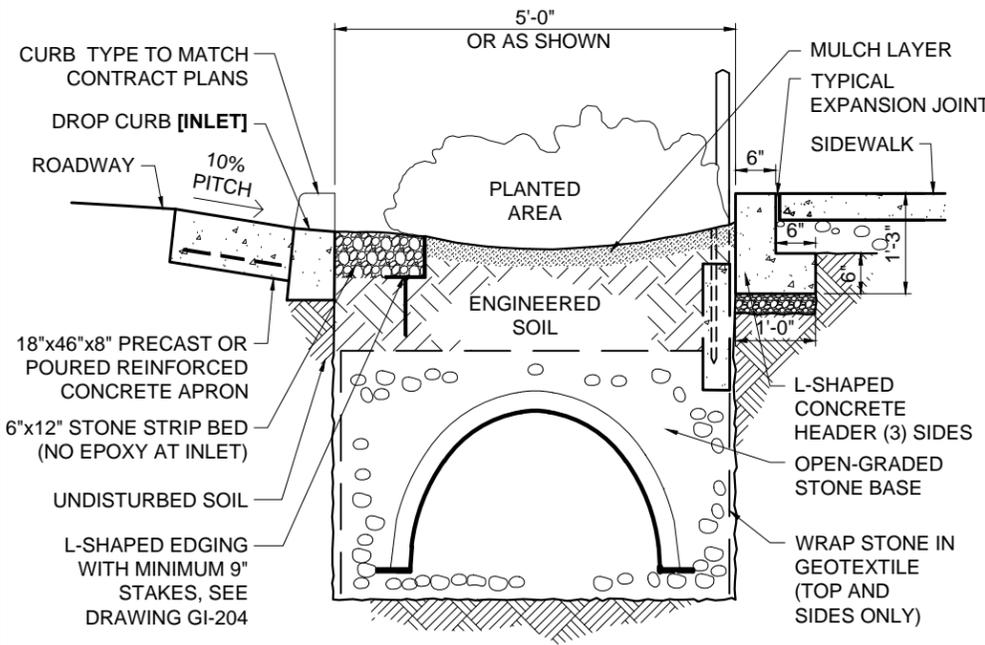

SECTION A-A
AT BIOSWALE INLET

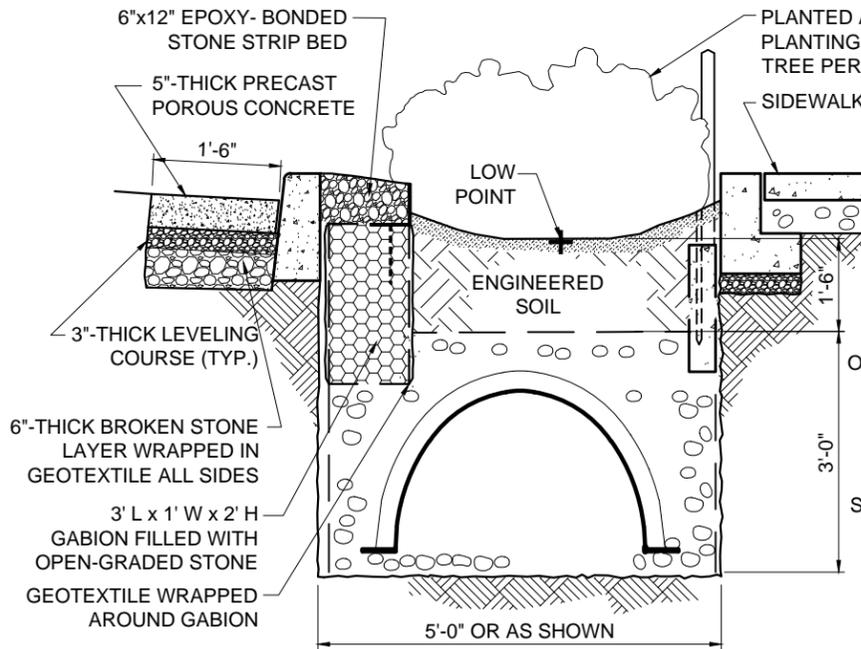

SECTION B-B
AT MIDSECTION [LOWEST POINT]

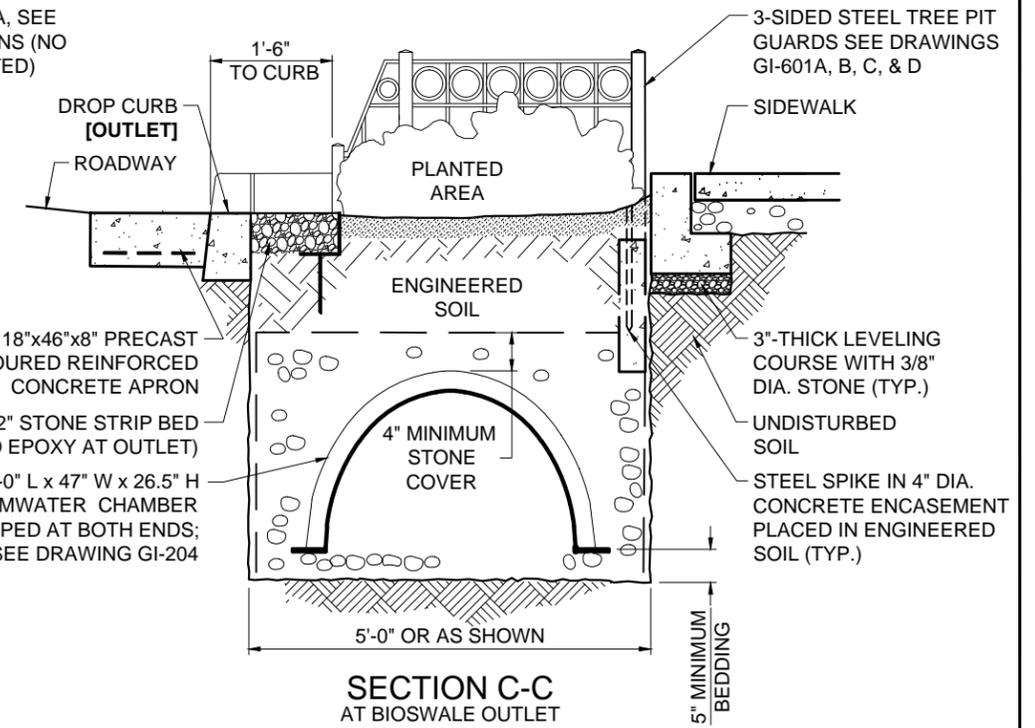

SECTION C-C
AT BIOSWALE OUTLET


Medi Tuna
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR 20'x5' R.O.W. BIOSWALE TYPE 1C - WITH STORMWATER CHAMBER


- NO CONNECTION TO SEWERS

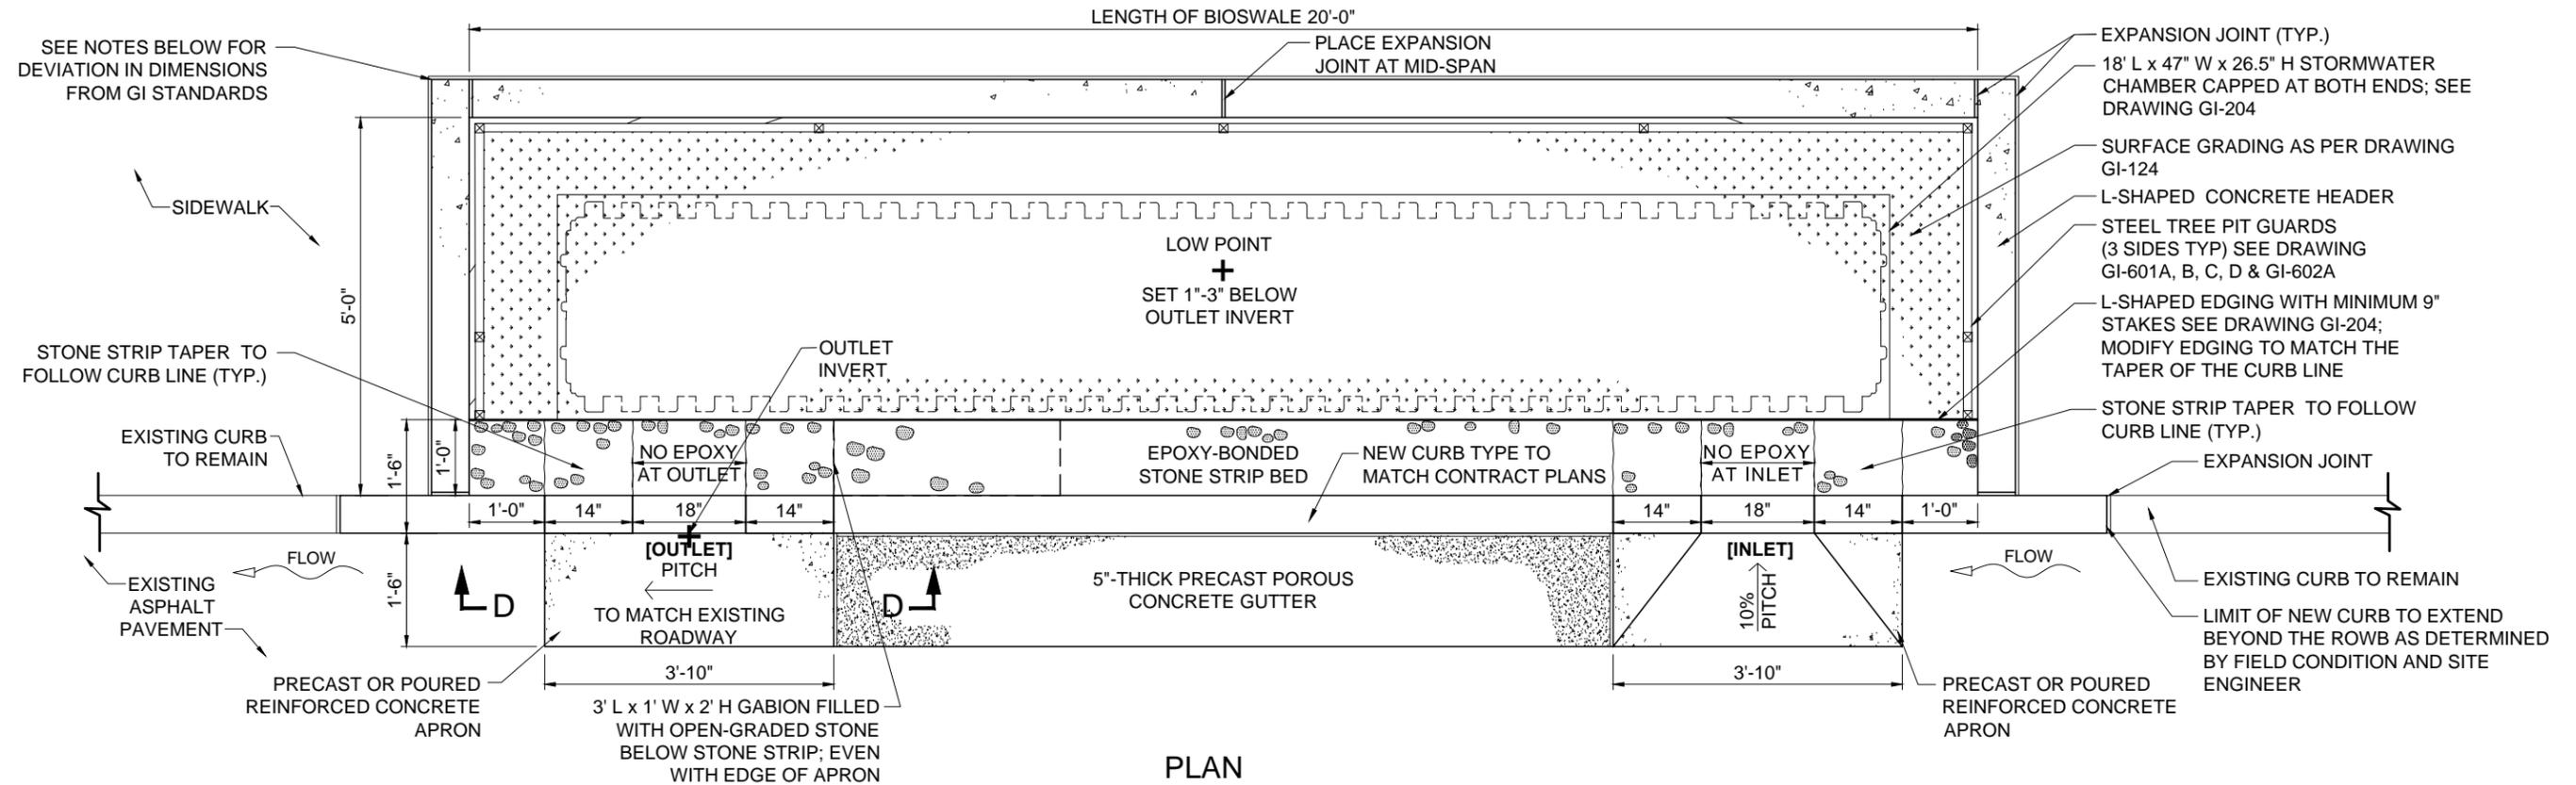

PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS

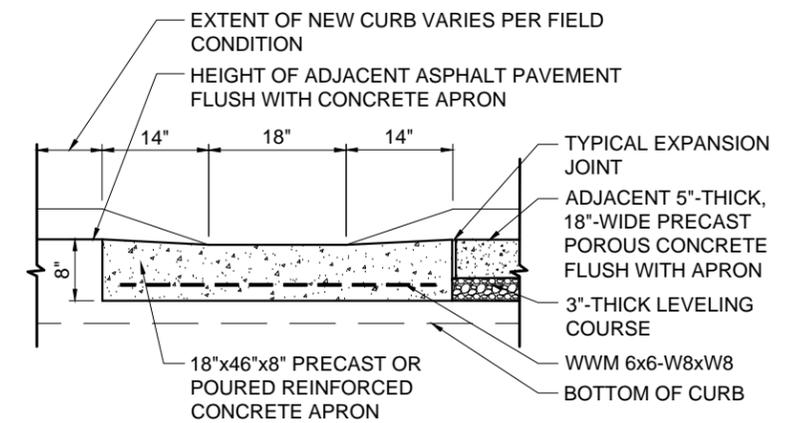


SECTION D-D


Maedi Turaq
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 15'x5' R.O.W. BIOSWALE TYPE 2
 - NO CONNECTION TO SEWERS

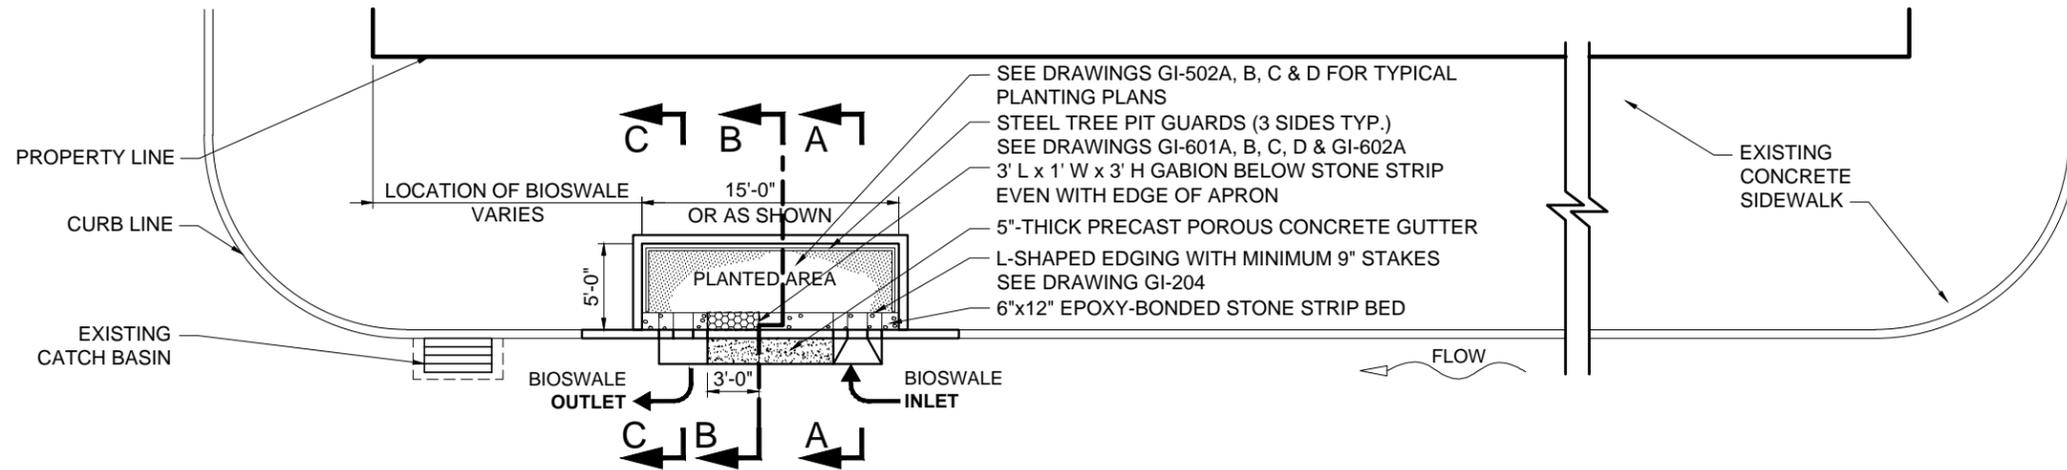


PLAN

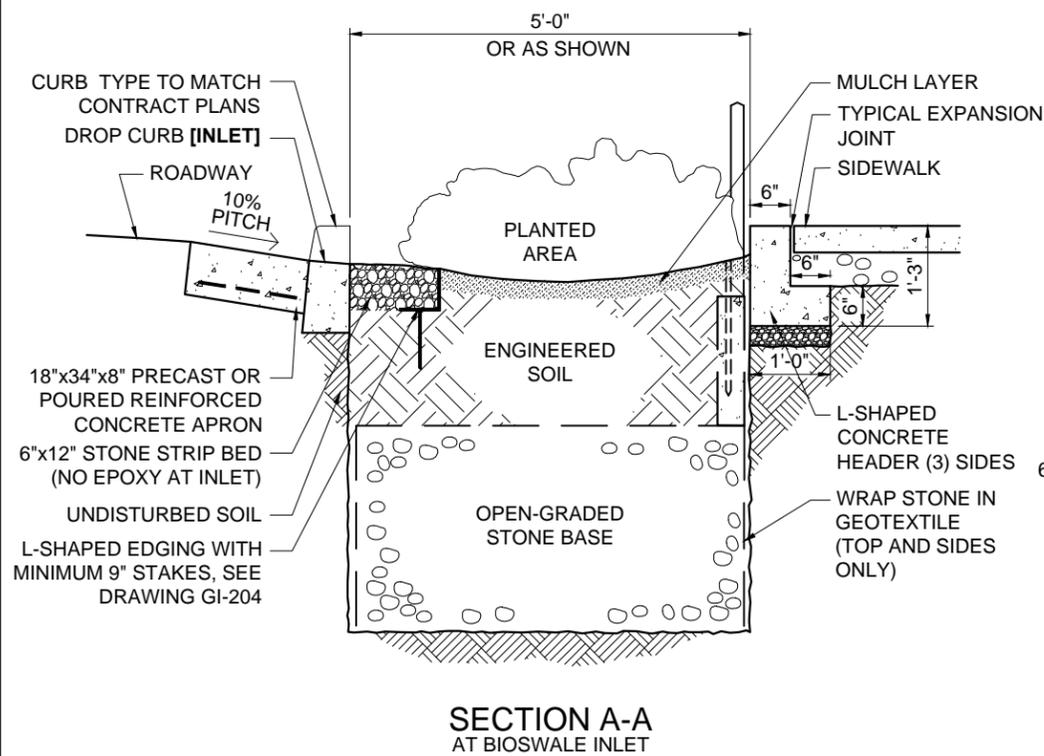

SECTION A-A
AT BIOSWALE INLET

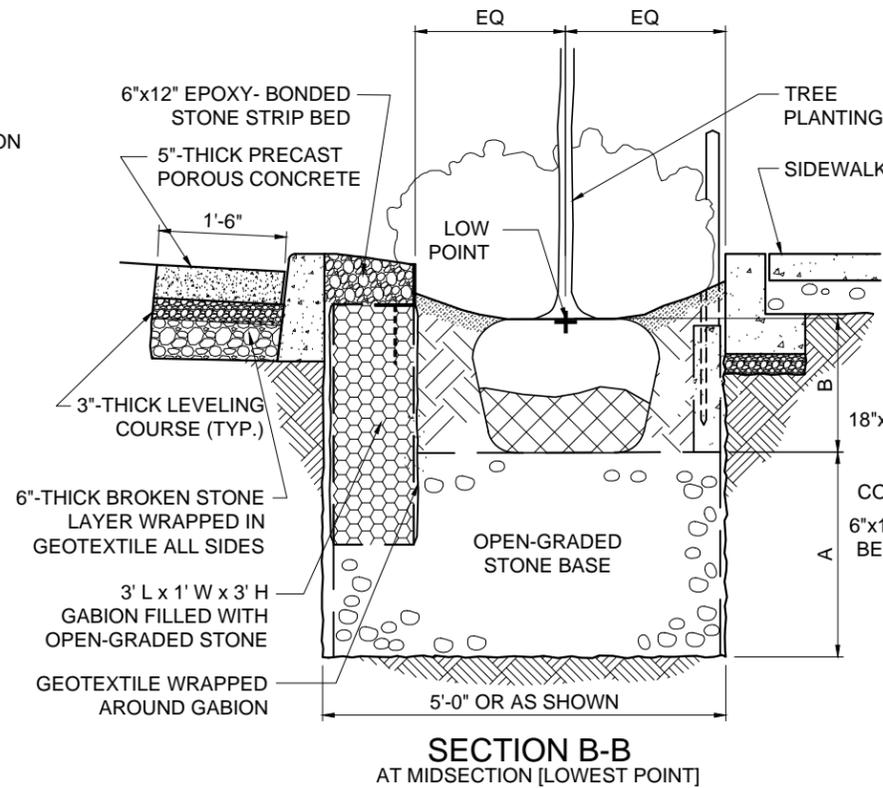

SECTION B-B
AT MIDSECTION [LOWEST POINT]

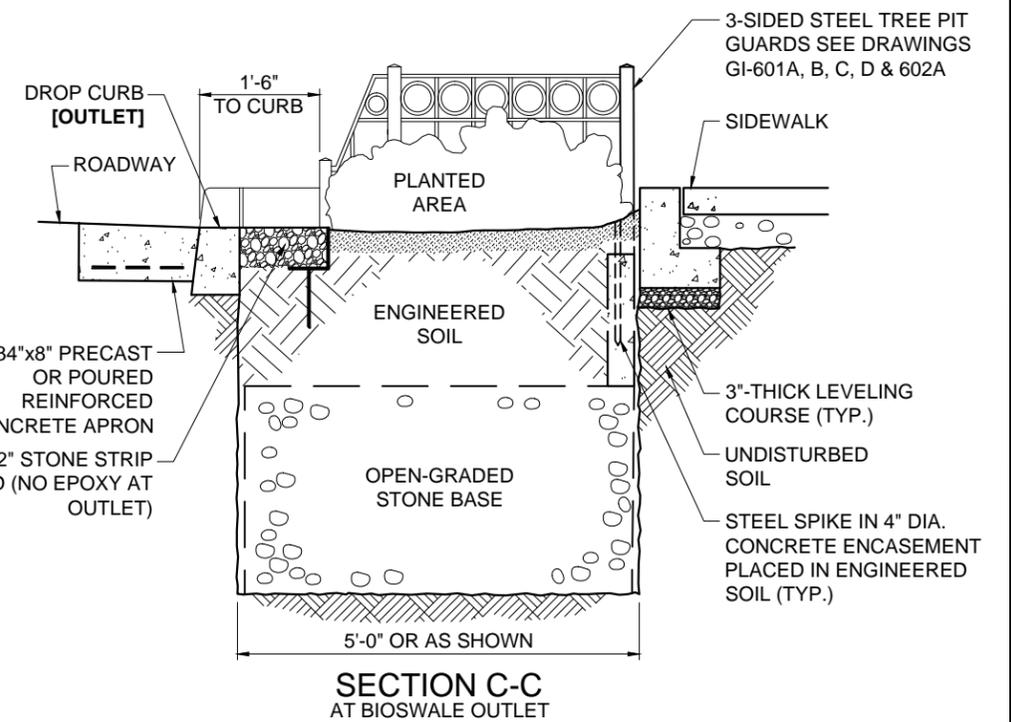

SECTION C-C
AT BIOSWALE OUTLET


ROWB	A	B
WITH TREE	2'-6"	24" MIN
NO TREE	3'-0"	18" MIN

DEPTH SCHEDULE

Medi Tuna
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 15'x5' R.O.W. BIOSWALE TYPE 2
- NO CONNECTION TO SEWERS

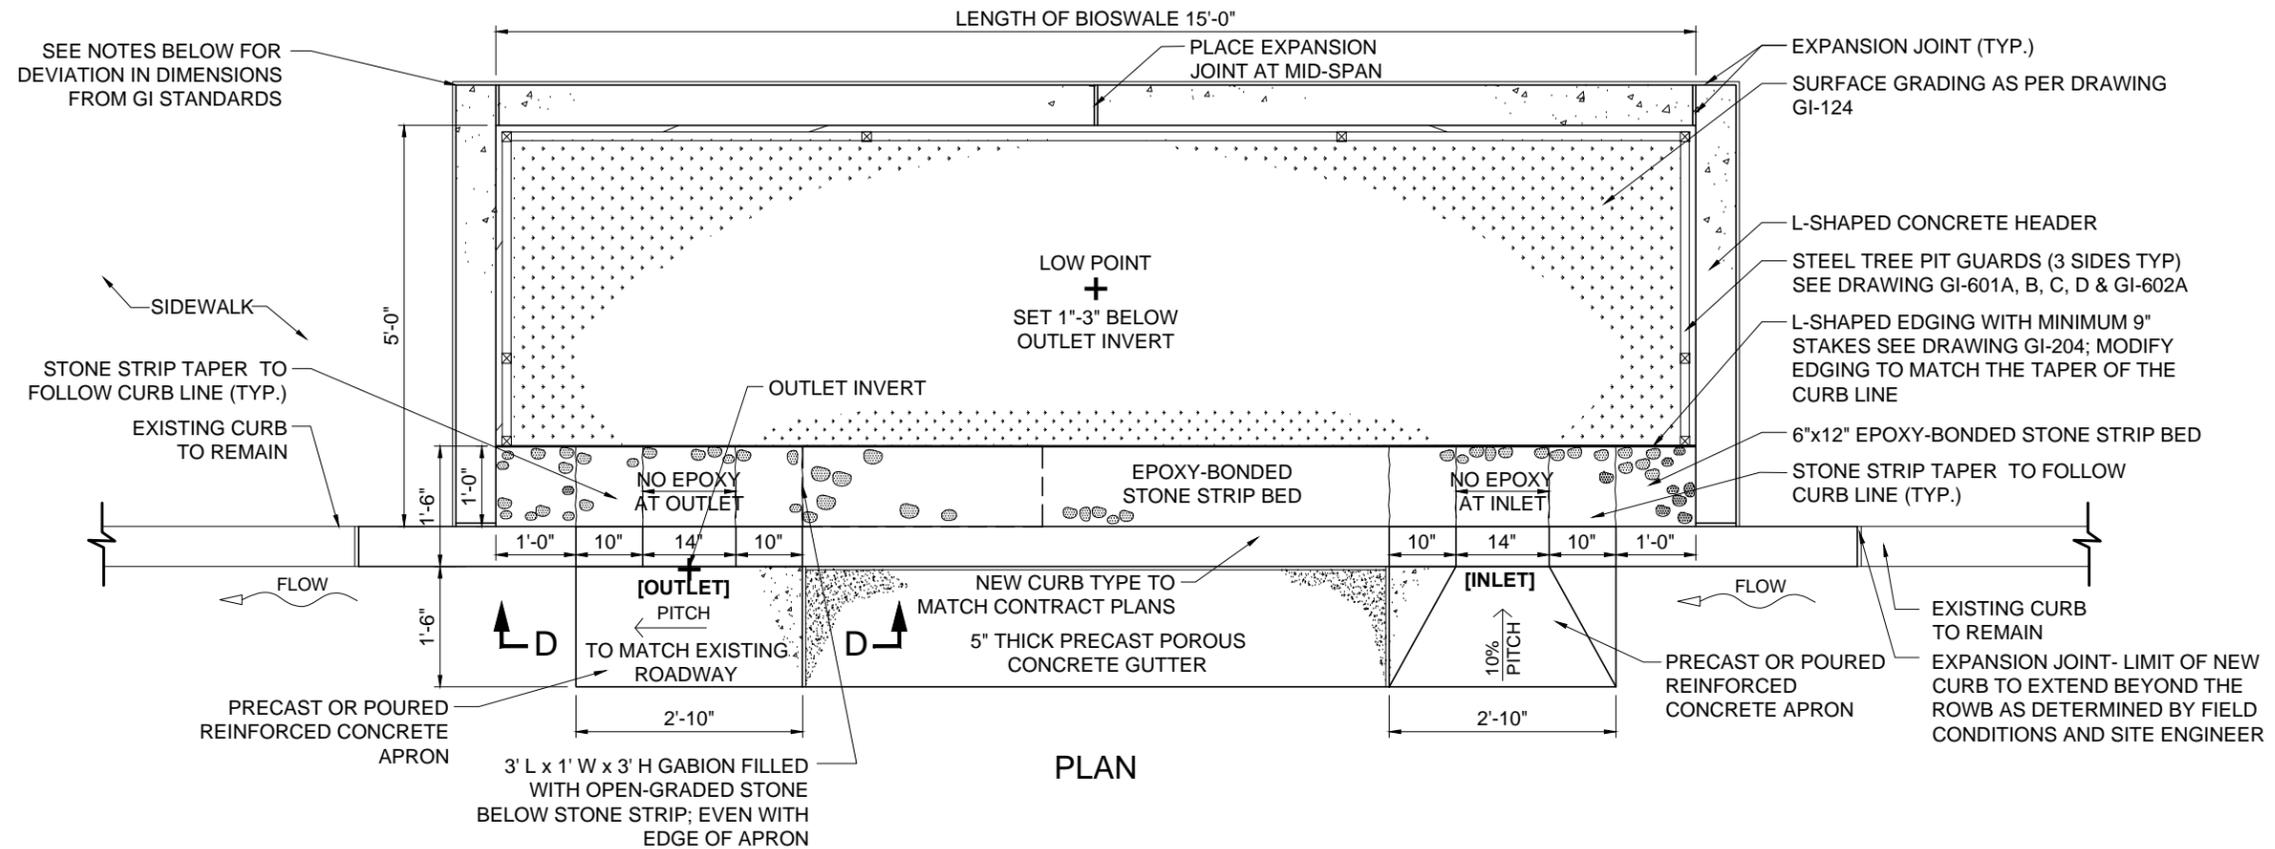

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS


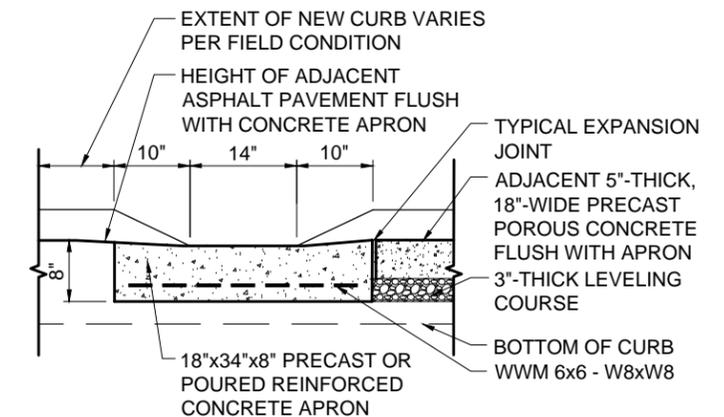


SECTION D-D


M. A. T. F.
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2A - WITH STONE COLUMNS
 - NO CONNECTION TO SEWERS

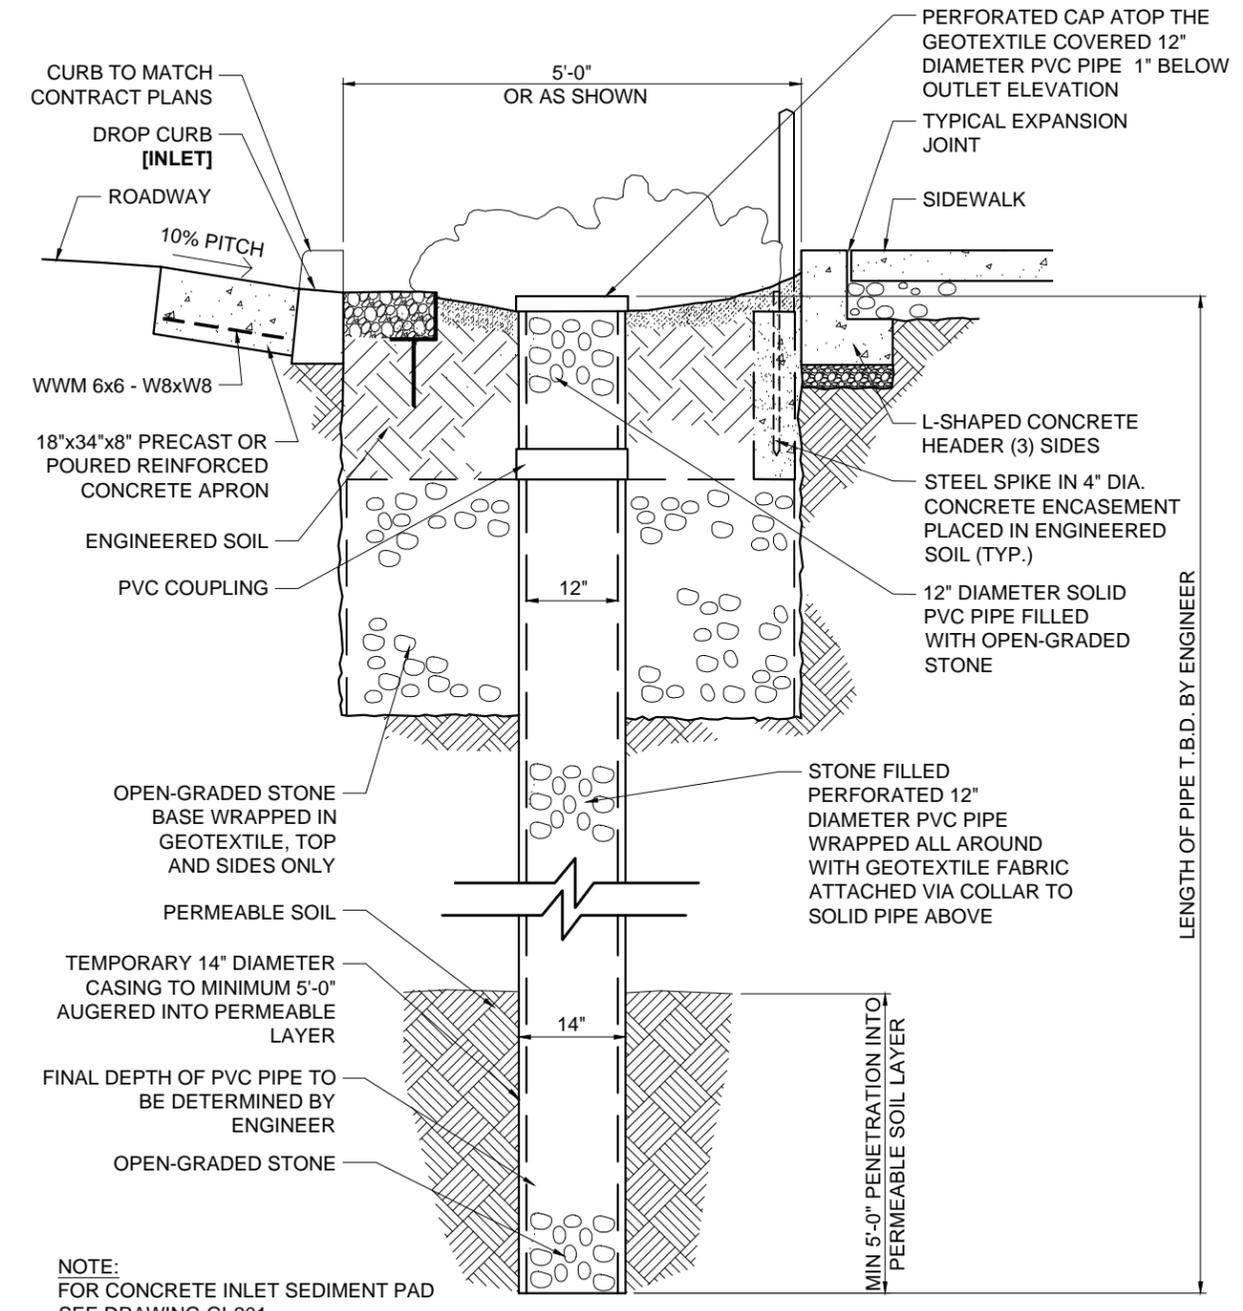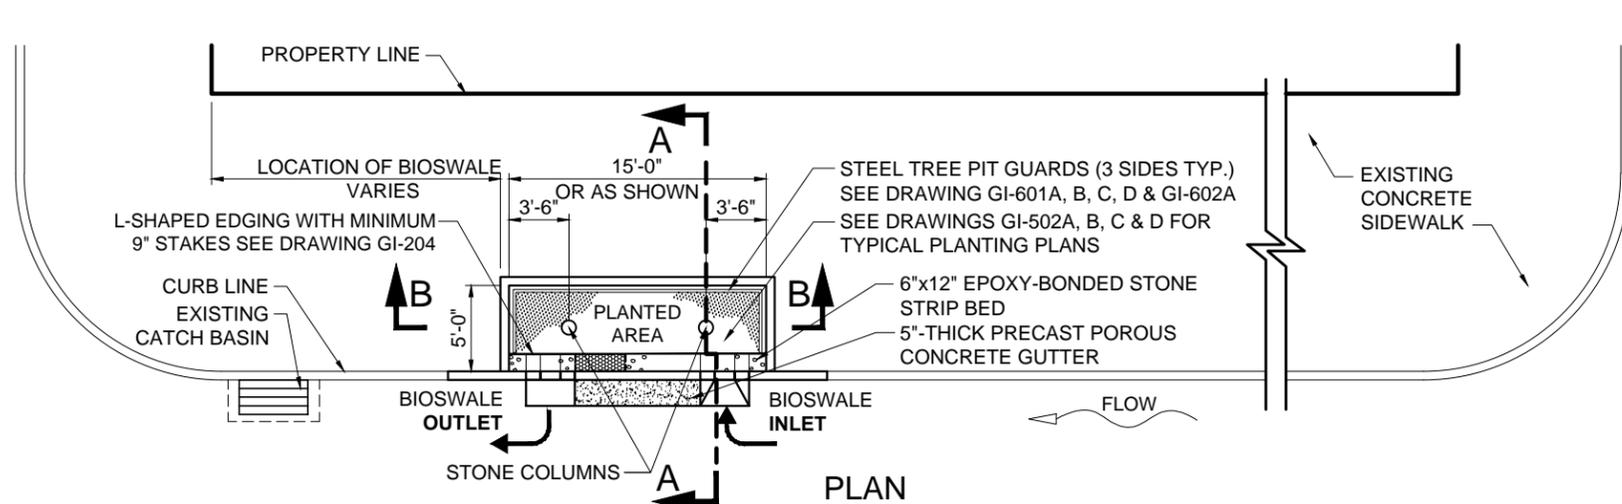


NOTE:
FOR CONCRETE INLET SEDIMENT PAD SEE DRAWING GI-201

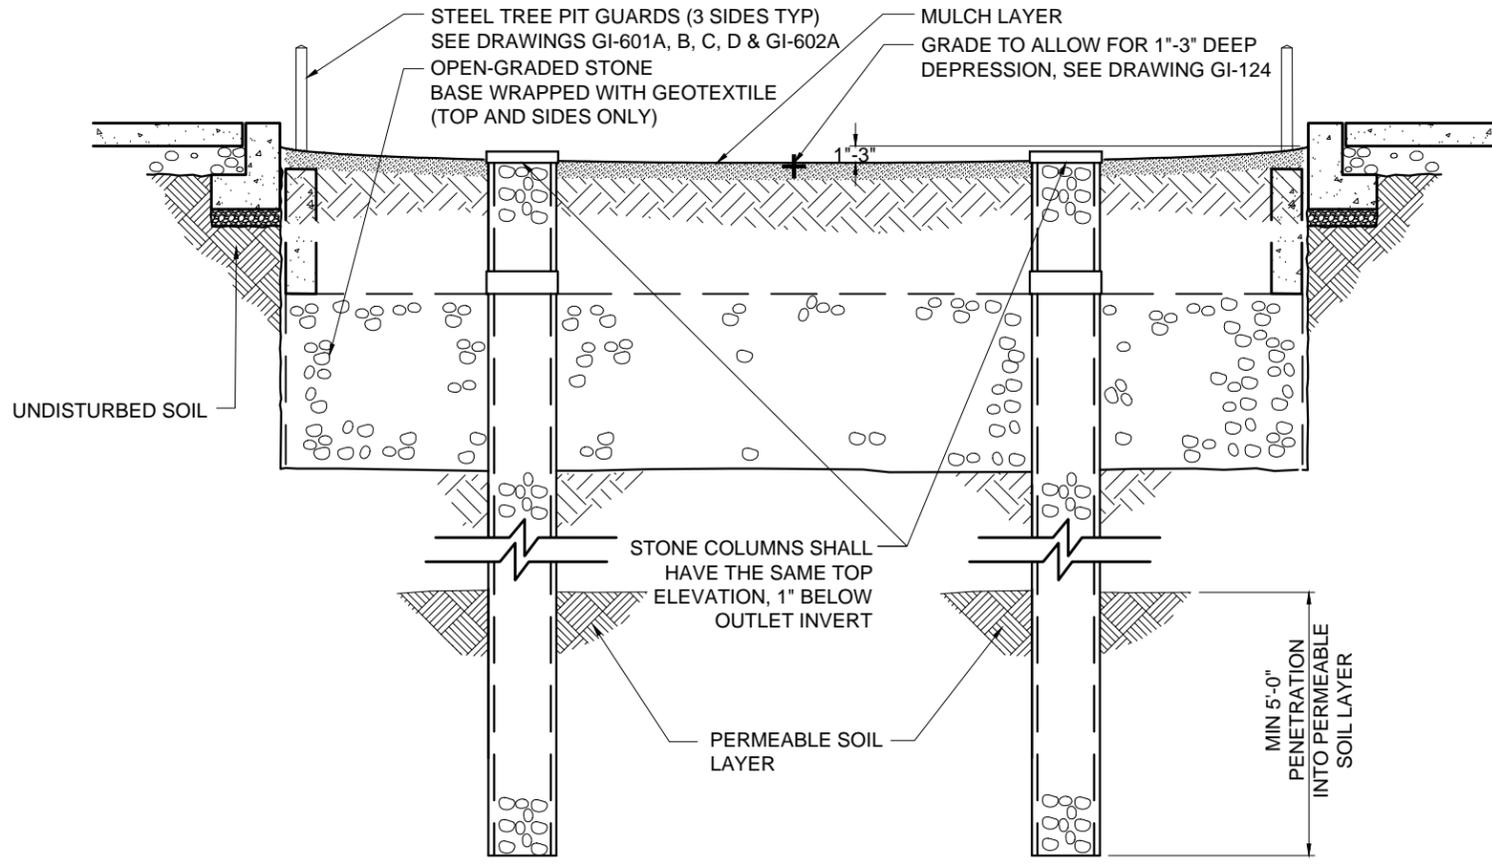

Maedi Taha P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2A - WITH STONE COLUMNS
 - NO CONNECTION TO SEWERS

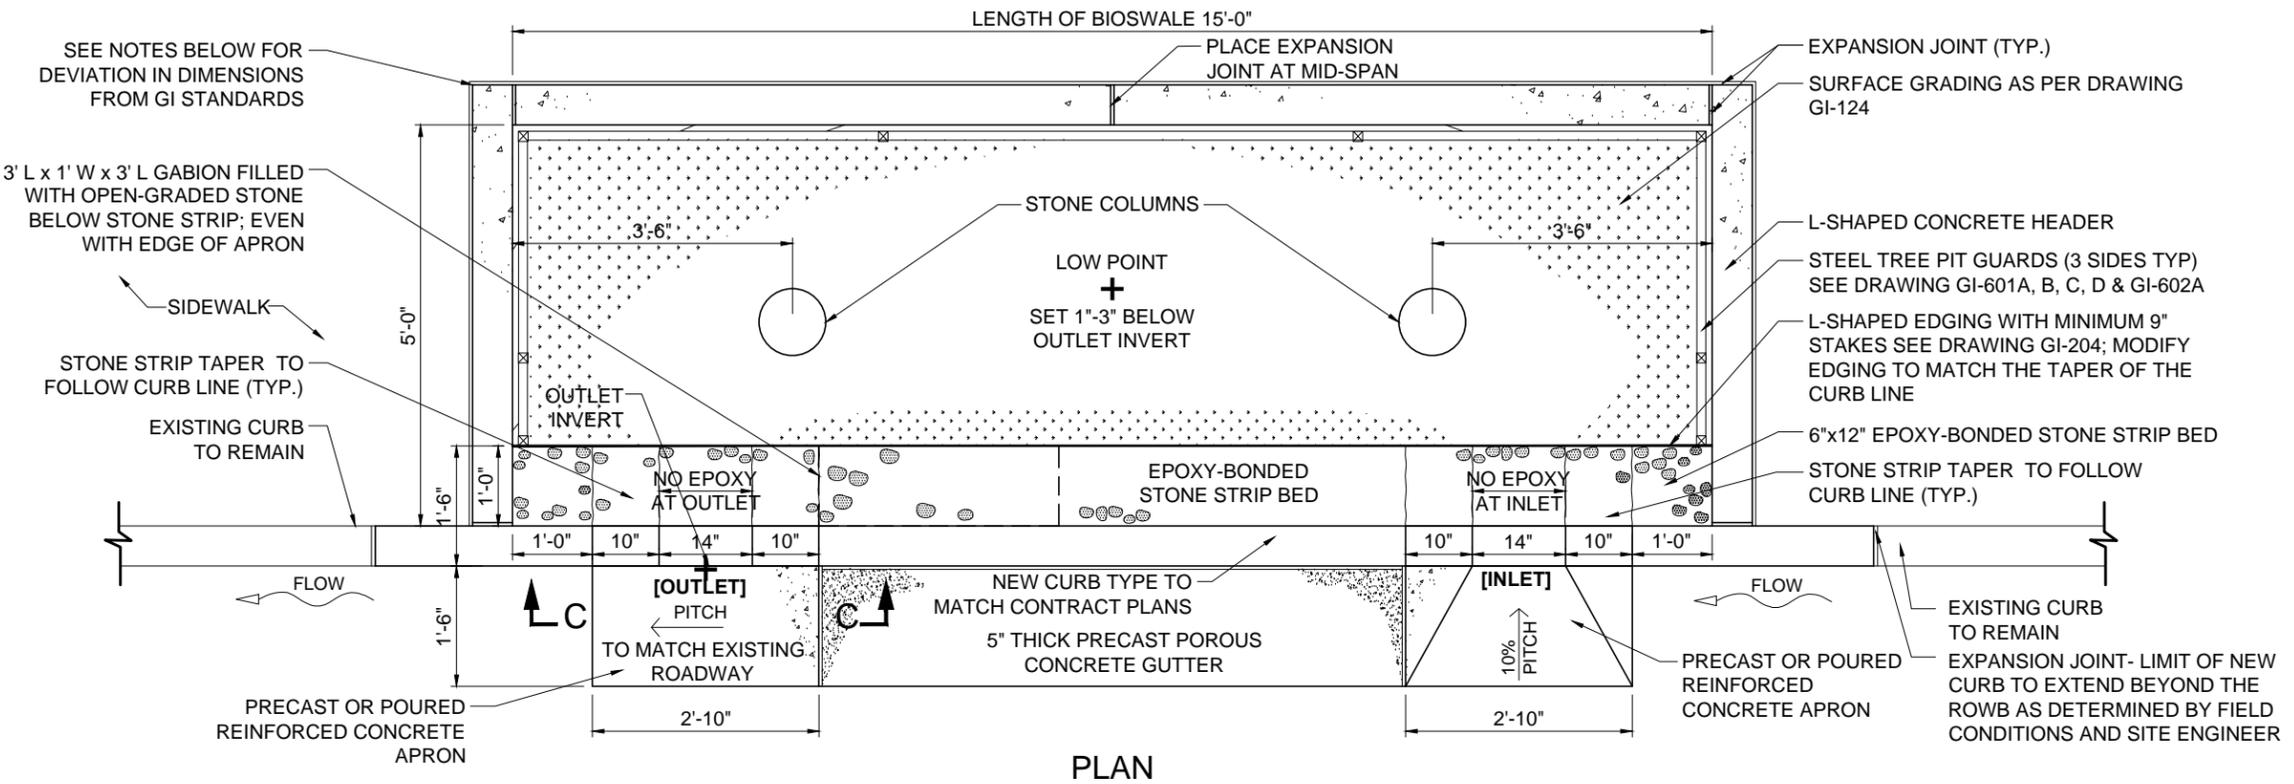

PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. 14" DIAMETER CASING TO BE AUGERED TO DEPTH AS DIRECTED BY ENGINEER. 12" DIAMETER PVC PIPE WRAPPED ALL AROUND WITH GEOTEXTILE FABRIC INSERTED IN THE 14" CASING
11. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS

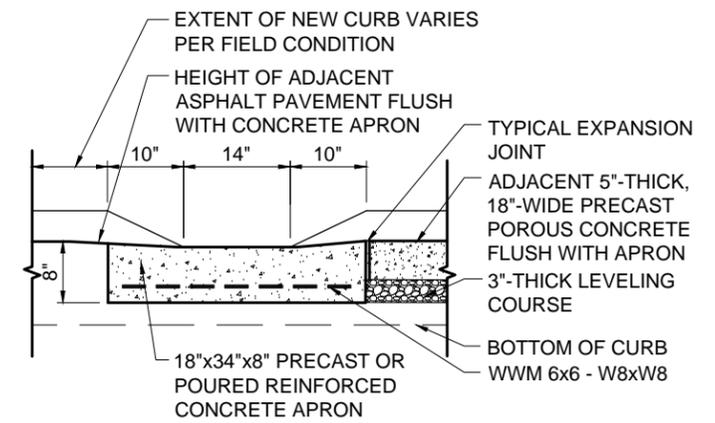



SECTION C-C

Maedi Tana
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2B - WITH STORMWATER INLET
- NO CONNECTION TO SEWERS

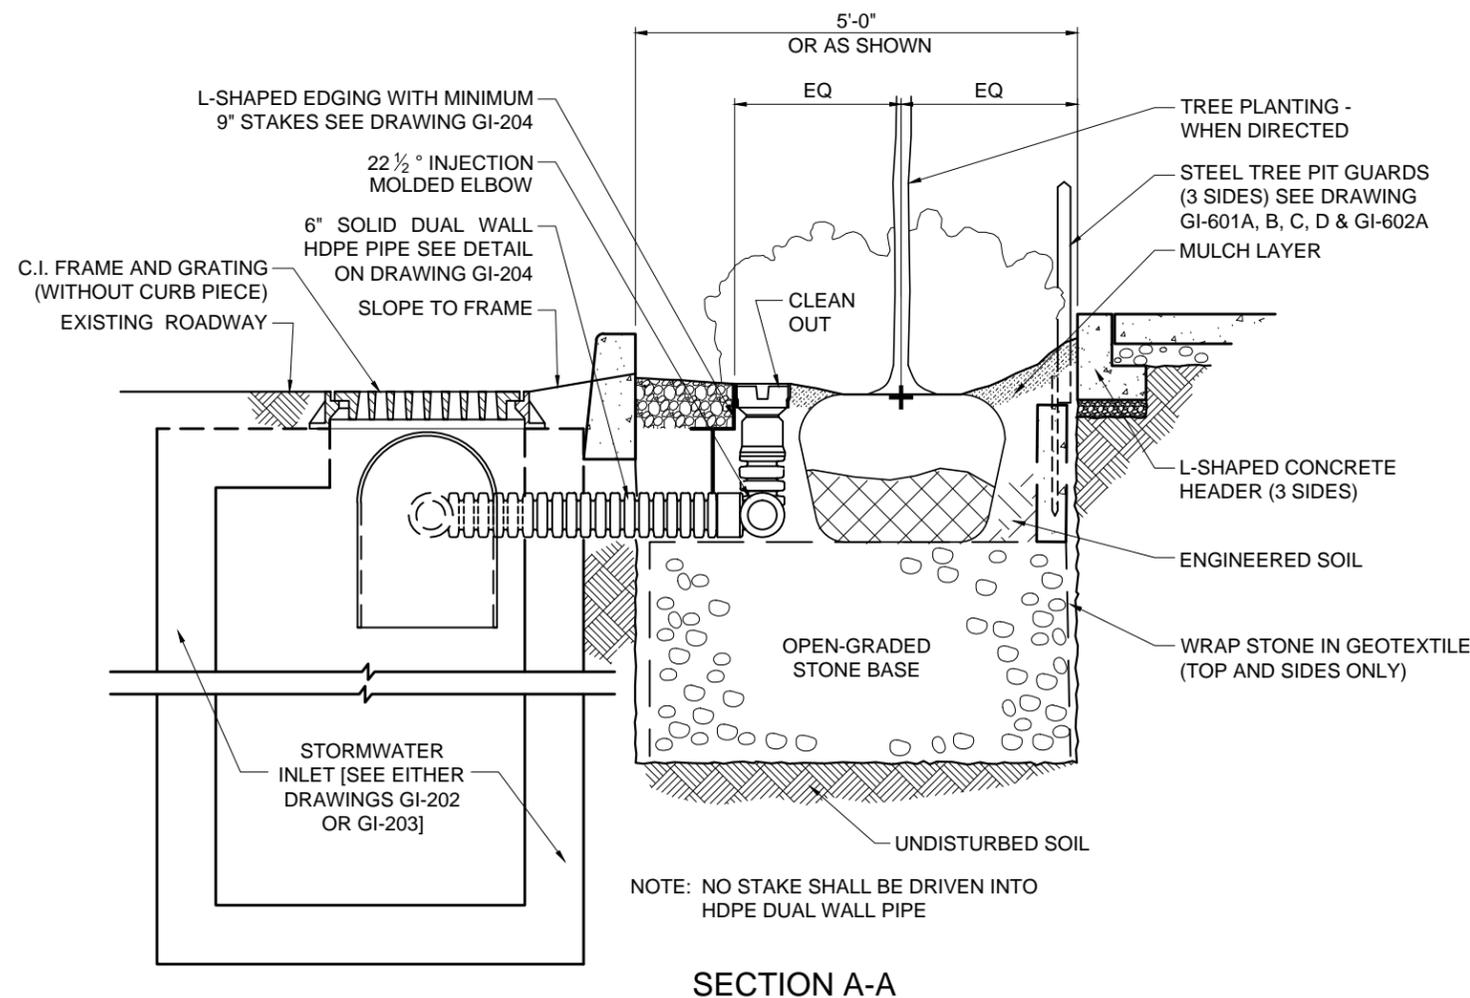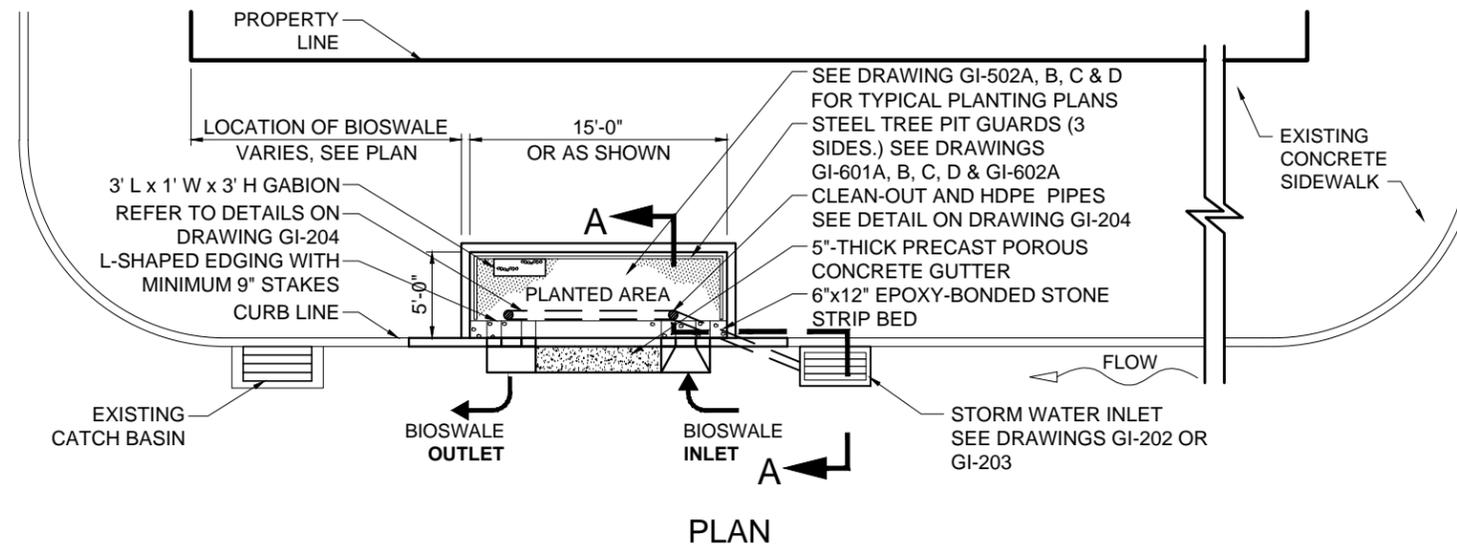

NOTES:


1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2') FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2') FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS

Maedi Tuna
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD FOR 15'X5' R.O.W. BIOSWALE TYPE 2B - WITH STORMWATER INLET
- NO CONNECTION TO SEWERS

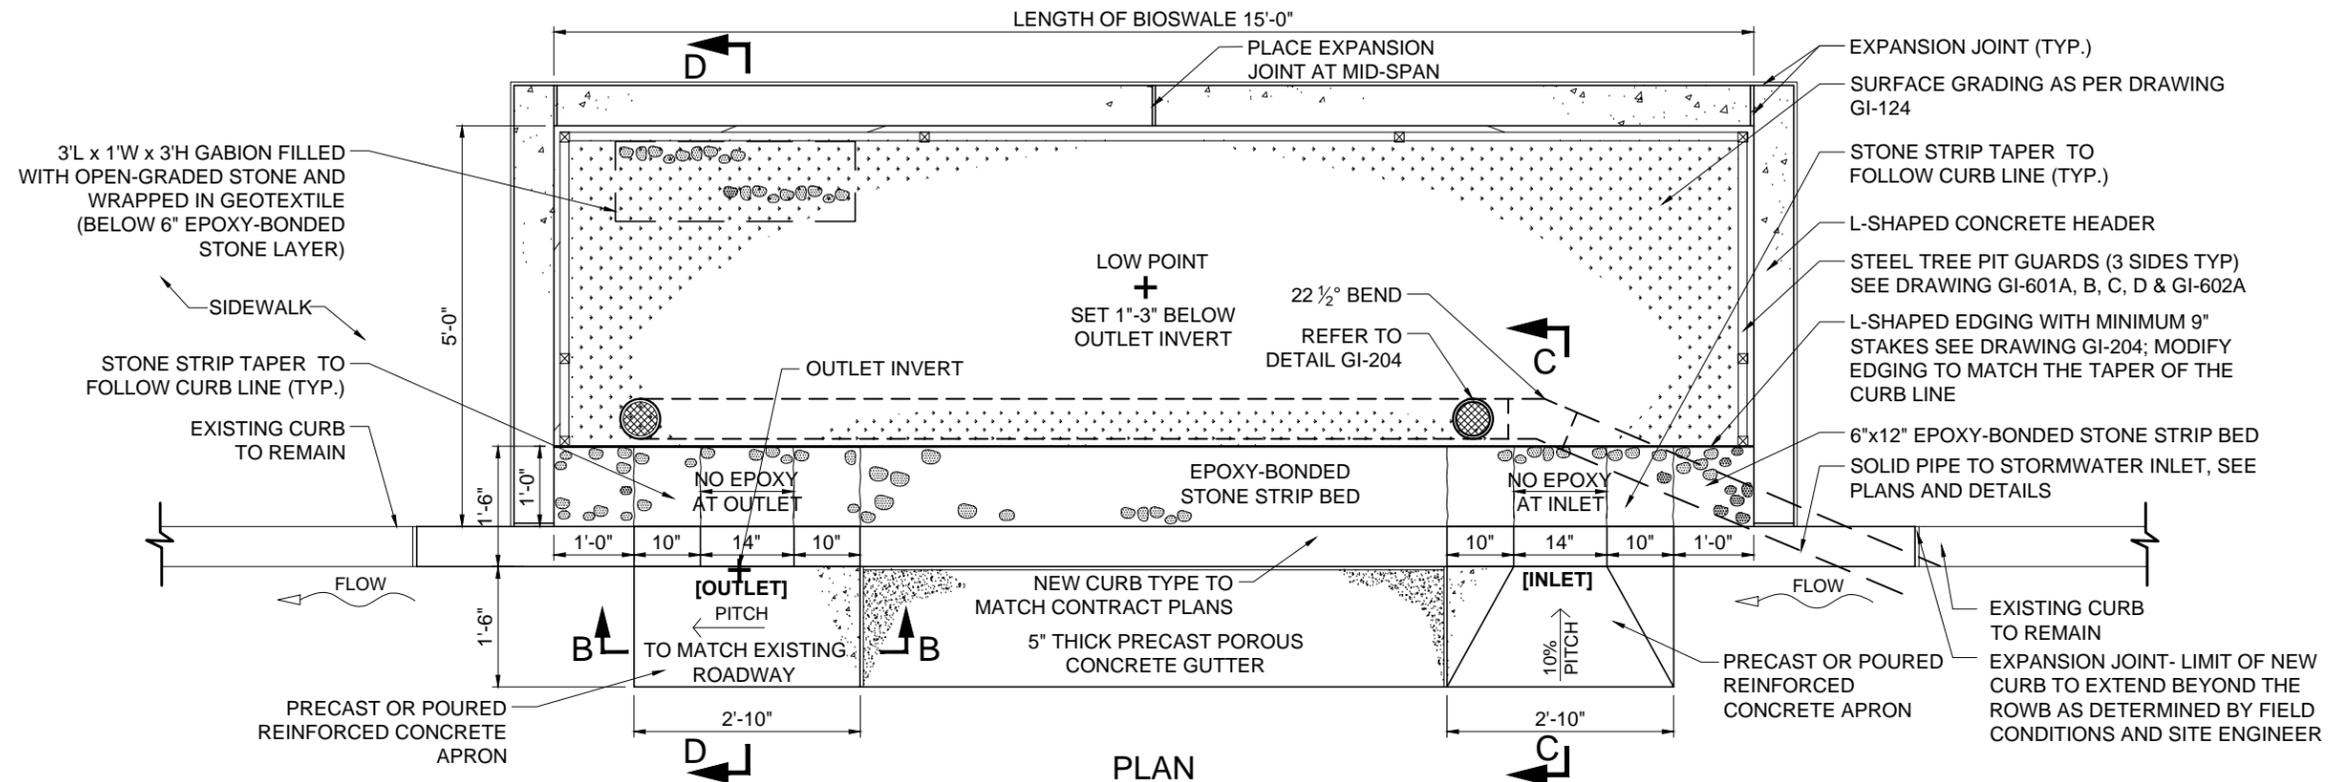


PLAN

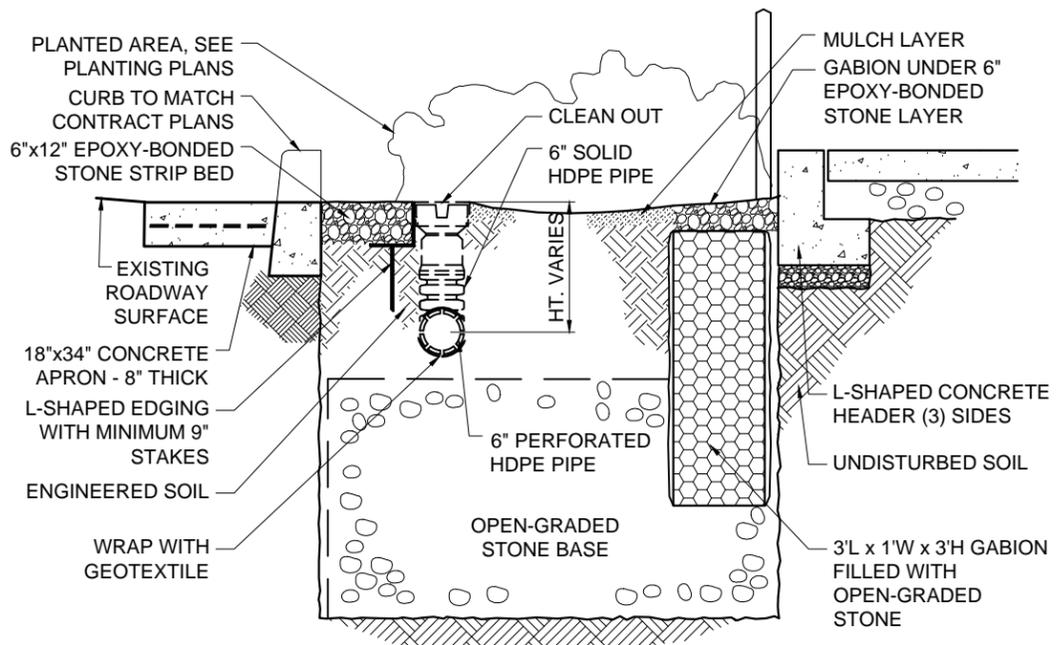

SECTION D-D
AT BIOSWALE OUTLET

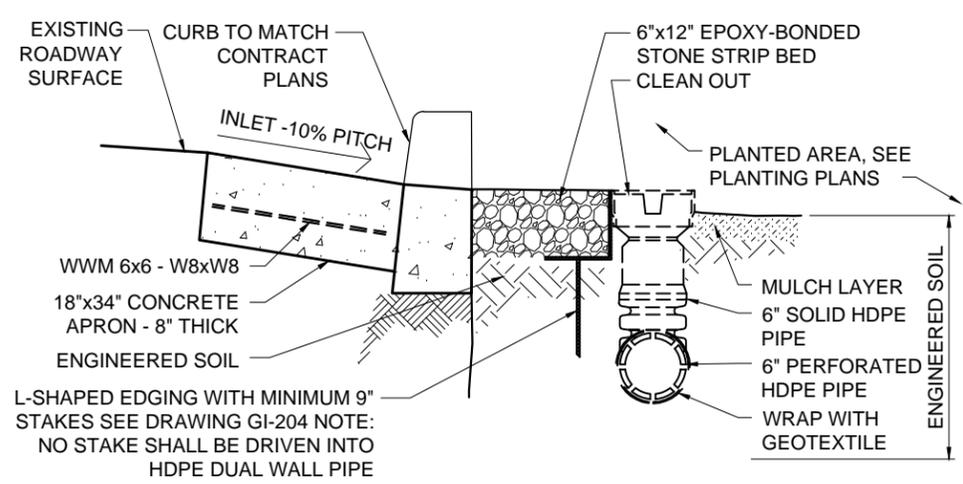

SECTION C-C
AT BIOSWALE INLET

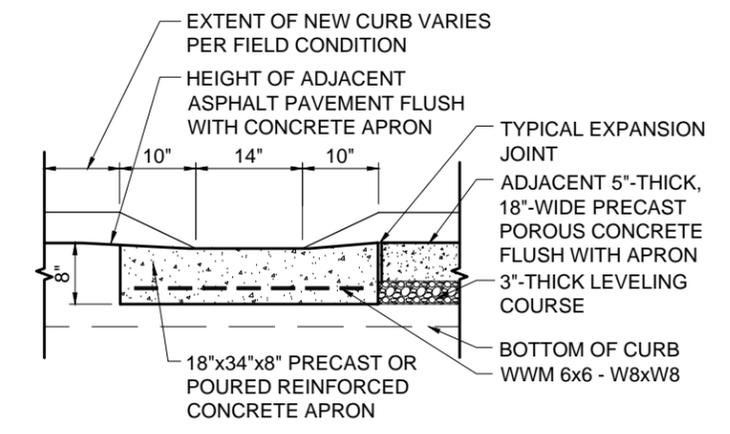

SECTION B-B


Medi Taha
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR 15'x5' R.O.W. BIOSWALE TYPE 2C - WITH STORMWATER CHAMBER


- NO CONNECTION TO SEWERS

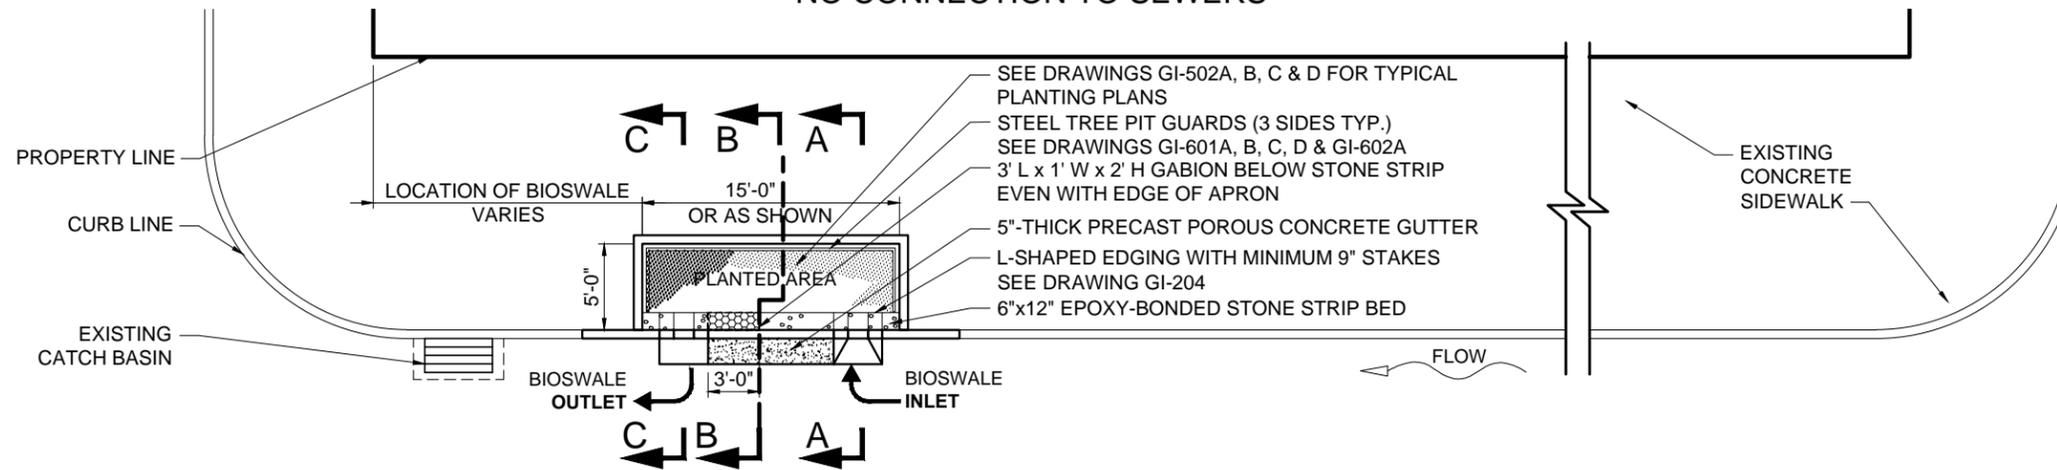


PLAN

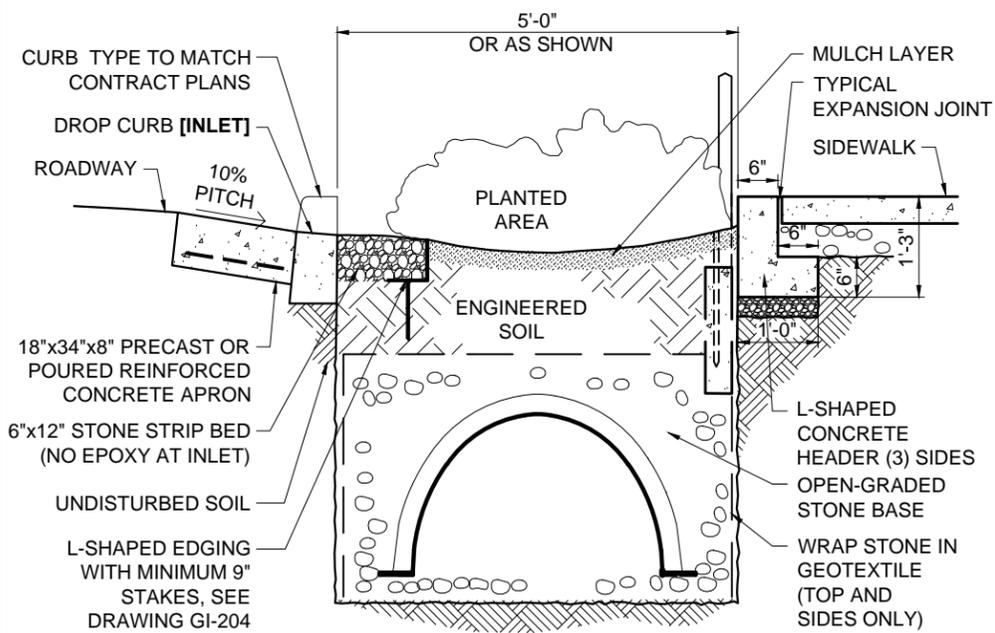

SECTION A-A
AT BIOSWALE INLET

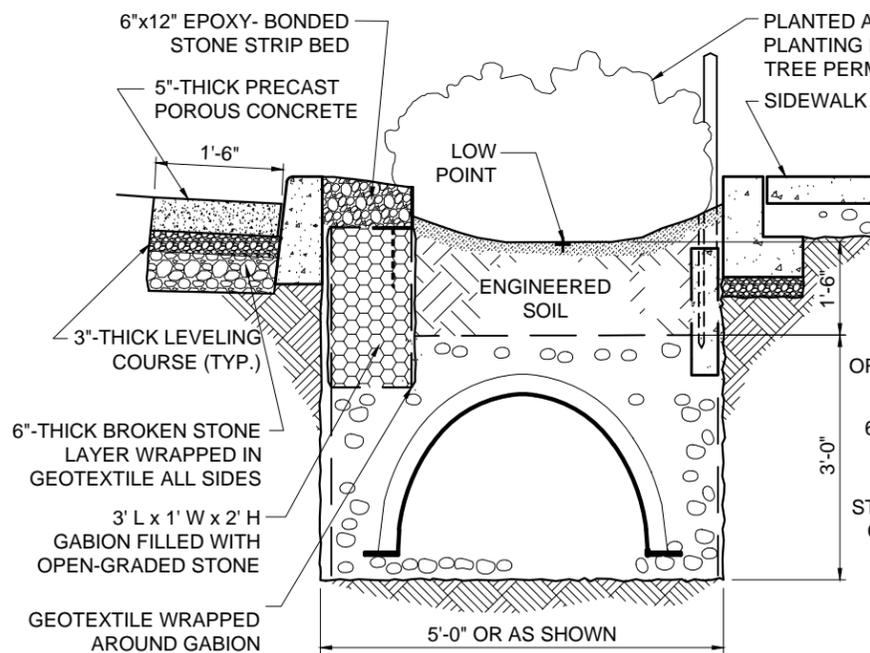

SECTION B-B
AT MIDSECTION [LOWEST POINT]

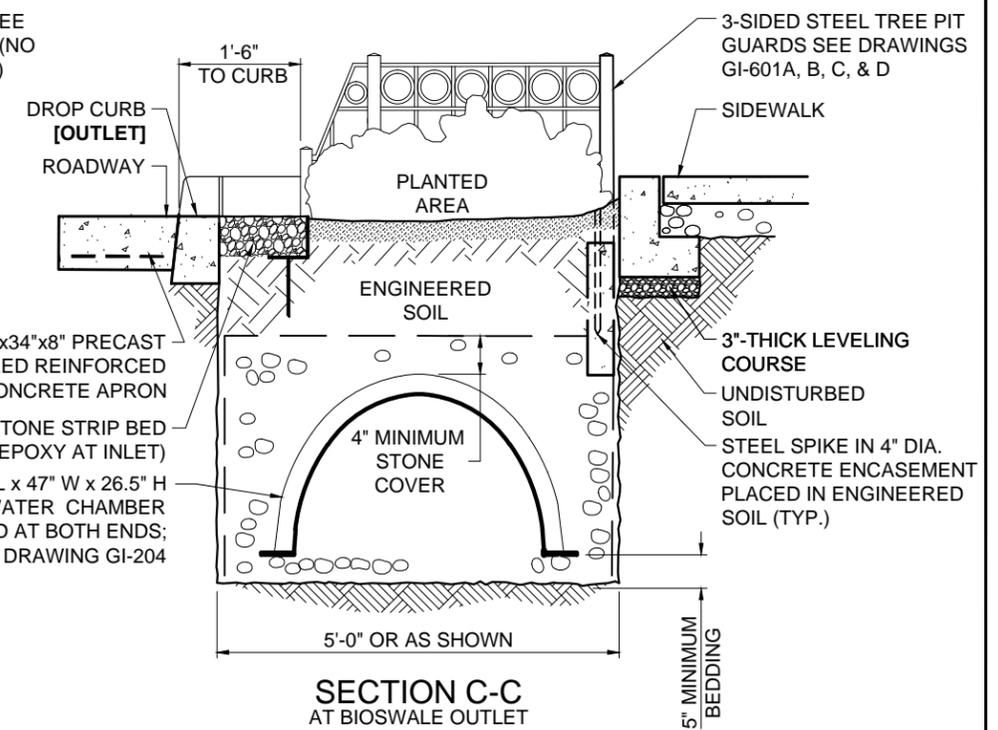

SECTION C-C
AT BIOSWALE OUTLET


Medi Tuna
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR 15'x5' R.O.W. BIOSWALE TYPE 2C - WITH STORMWATER CHAMBER


- NO CONNECTION TO SEWERS

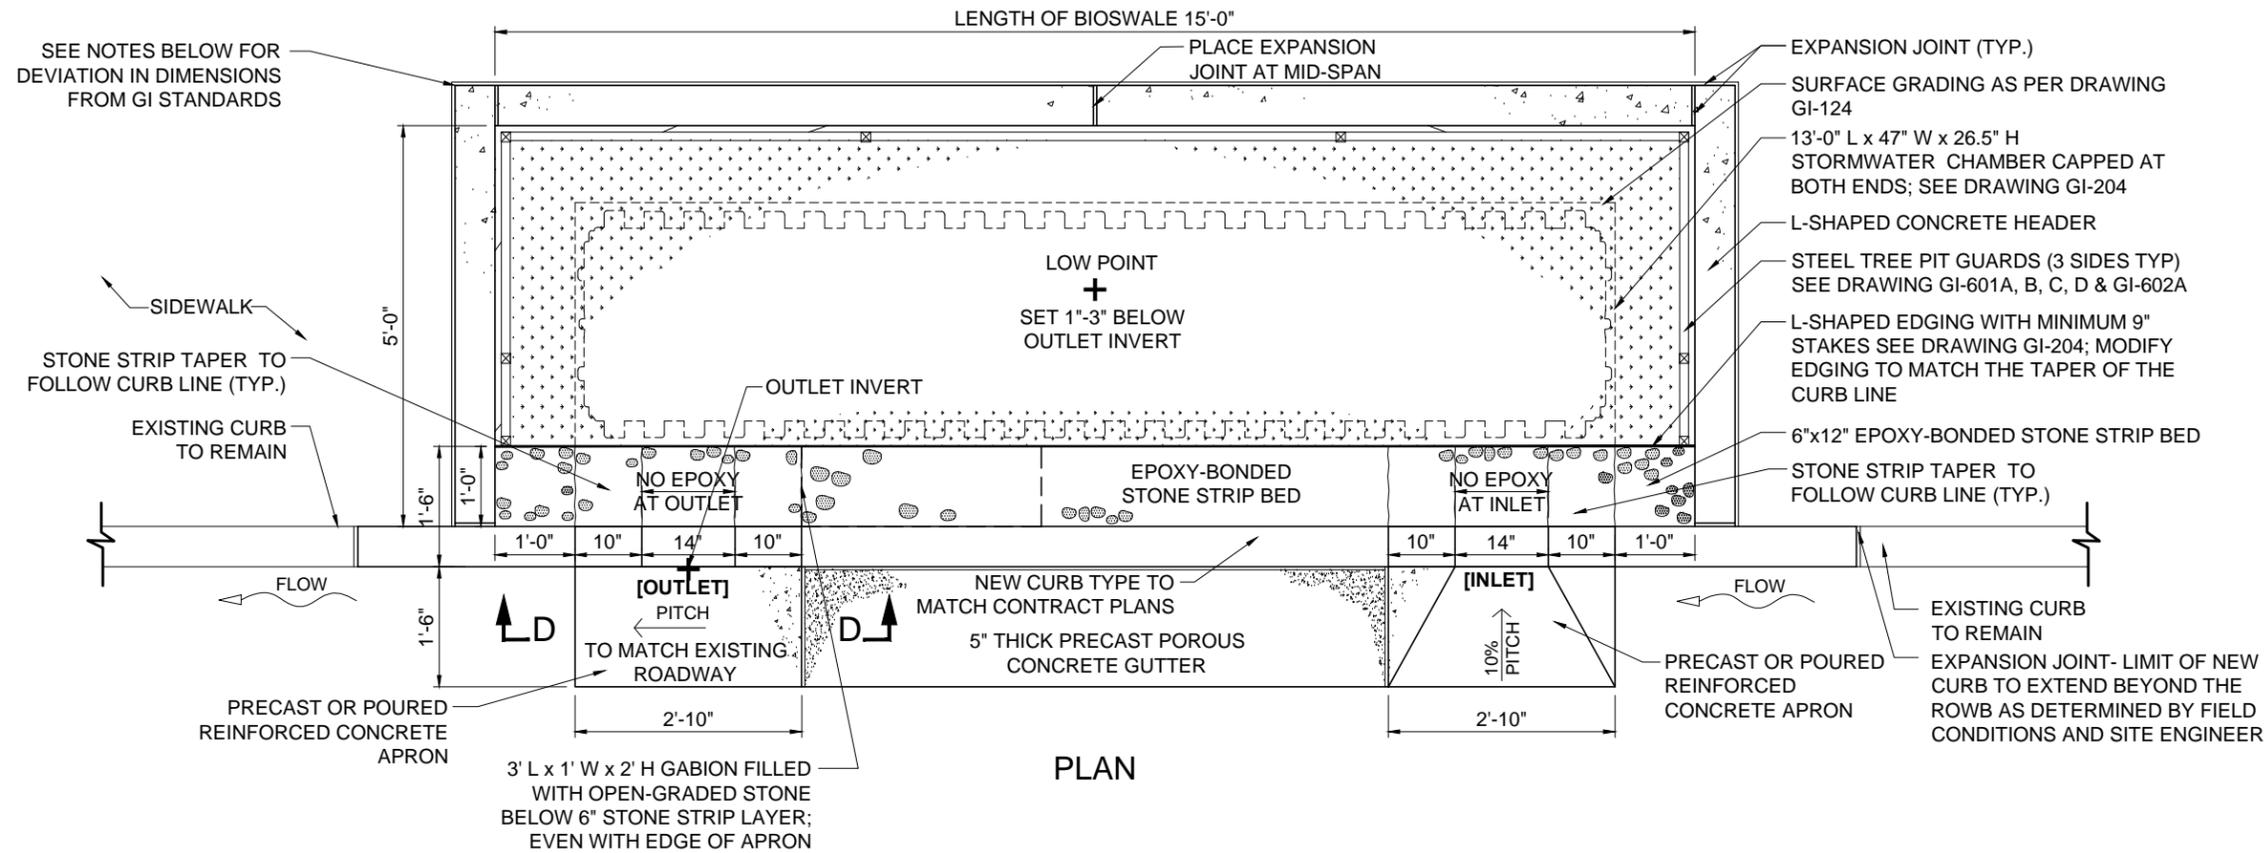

PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2') FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2') FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS


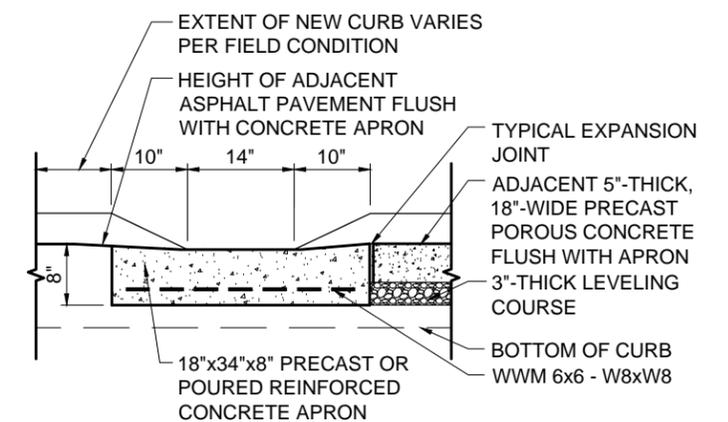


SECTION D-D


Maedi Turaq
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 10'x5' R.O.W. BIOSWALE TYPE 3
 - NO CONNECTION TO SEWERS

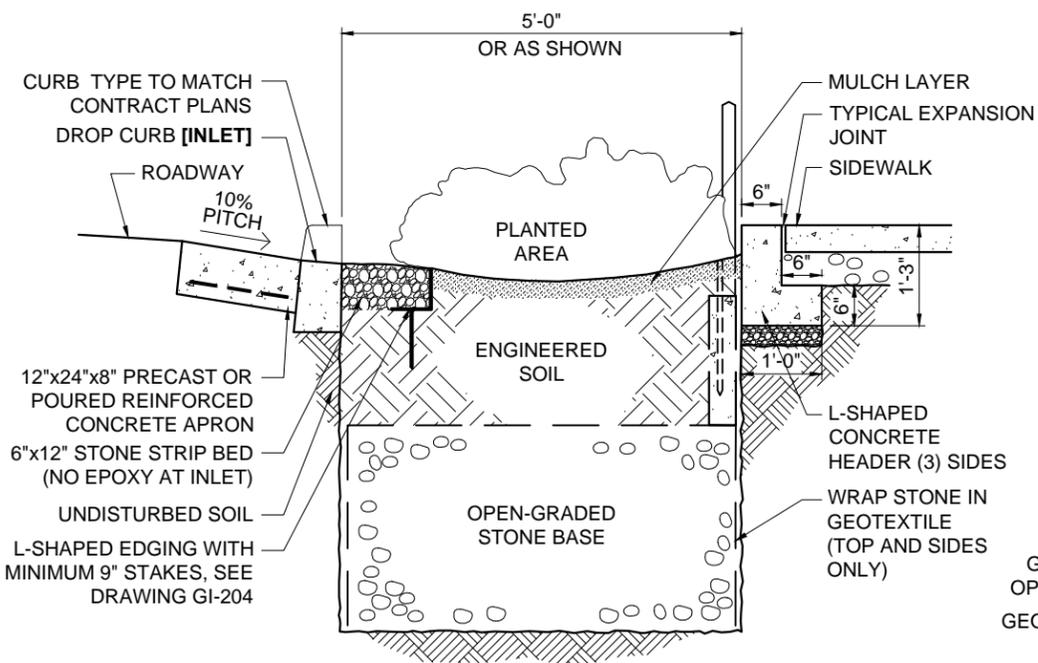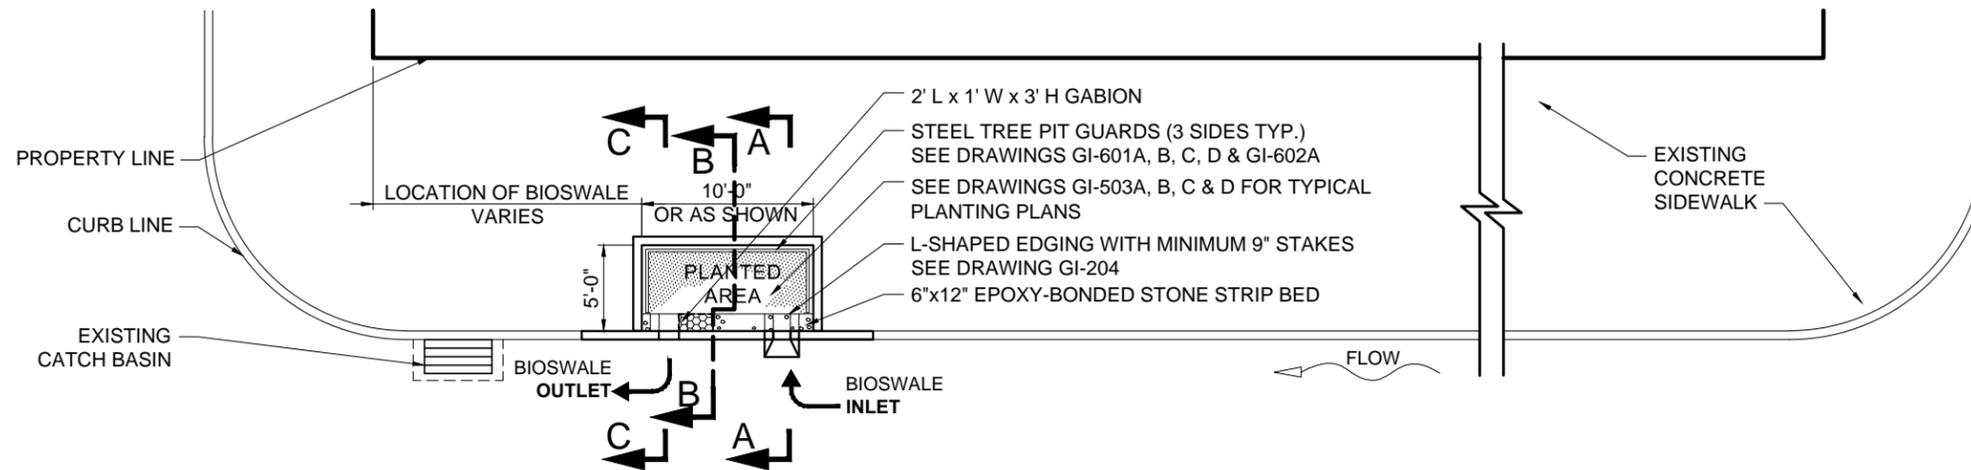

SECTION A-A
AT BIOSWALE INLET

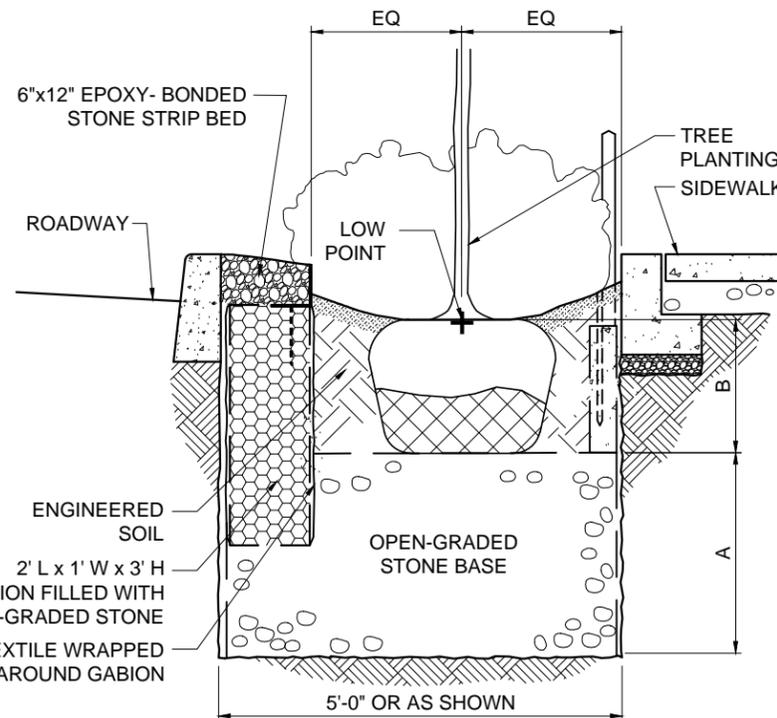

SECTION B-B
AT MIDSECTION [LOWEST POINT]

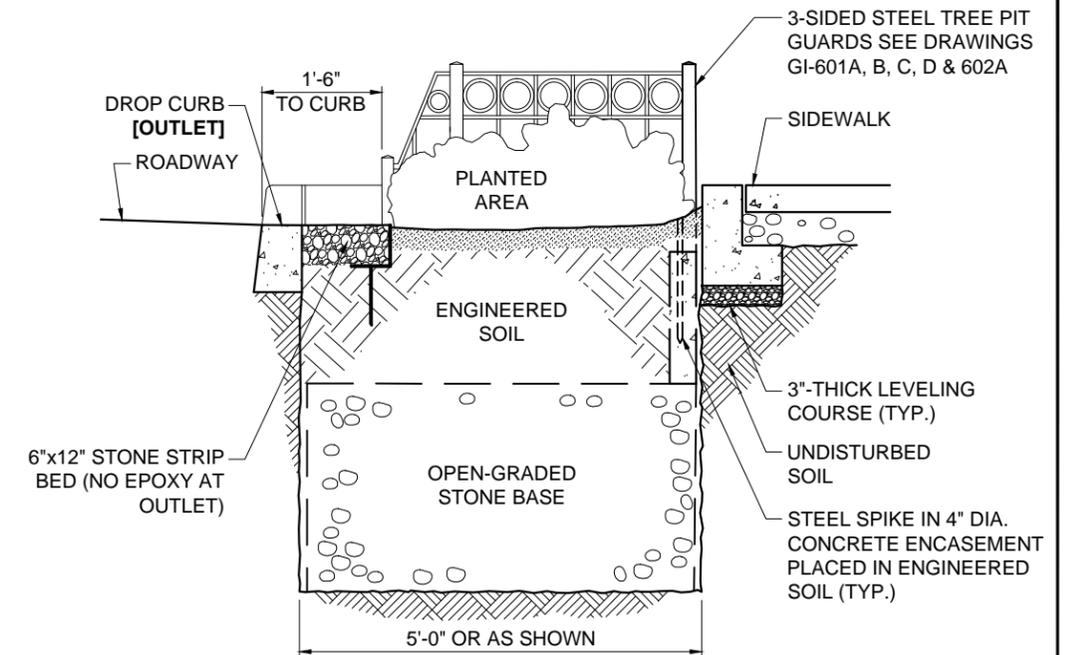

SECTION C-C
AT BIOSWALE OUTLET


ROWB	A	B
WITH TREE	2'-6"	24" MIN
NO TREE	3'-0"	18" MIN

DEPTH SCHEDULE

Maedi Taha
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 10'x5' R.O.W. BIOSWALE TYPE 3
- NO CONNECTION TO SEWERS

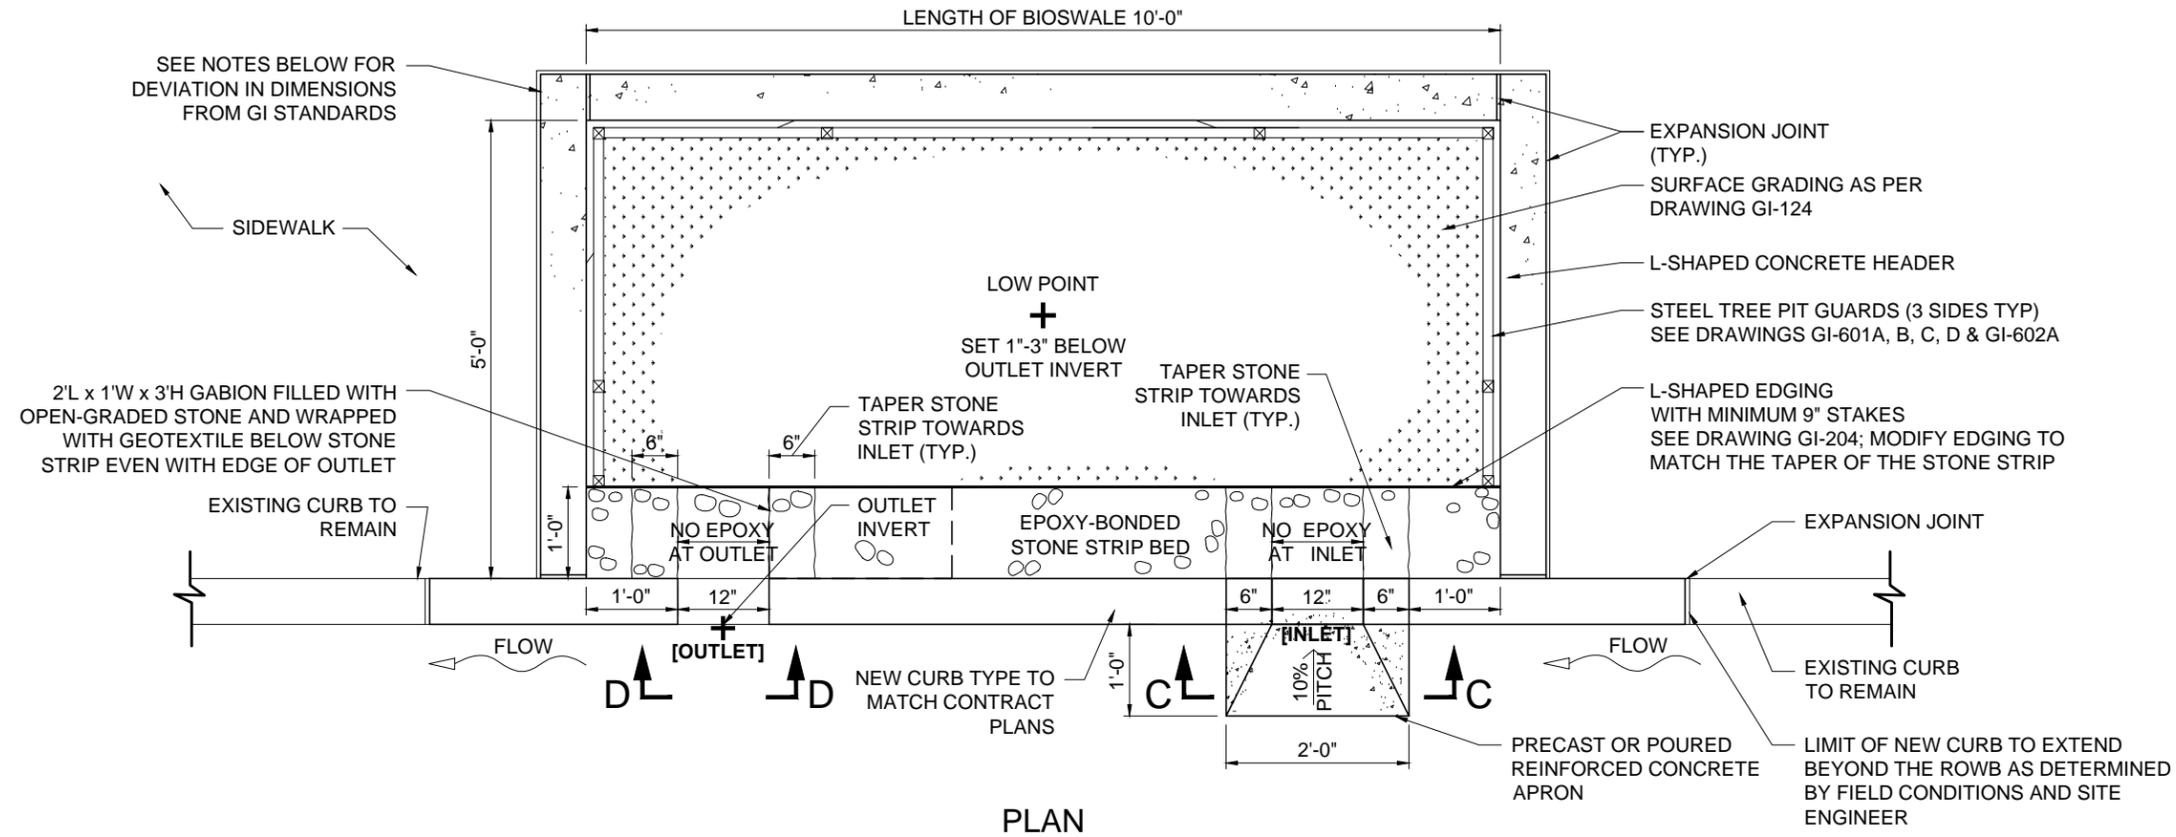

PLAN

NOTES:


1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS

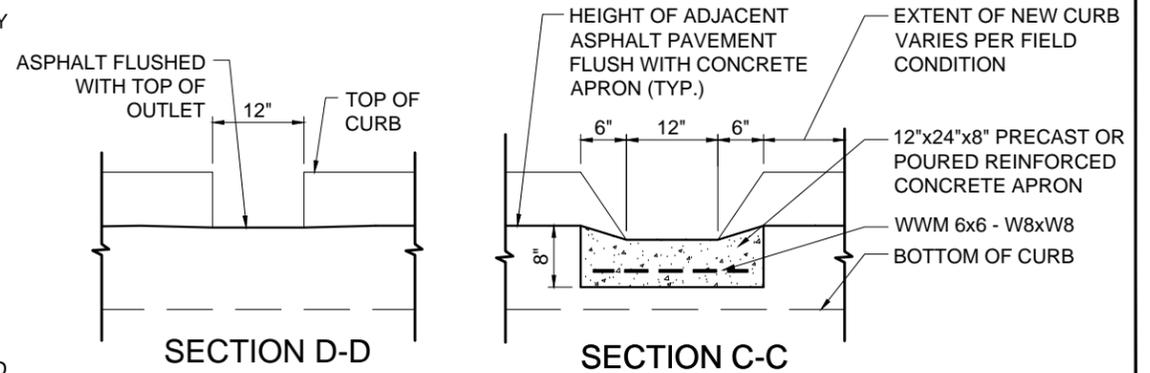


Maedi Taha
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 10'X5' R.O.W. BIOSWALE TYPE 3A - WITH STONE COLUMN
 - NO CONNECTION TO SEWERS

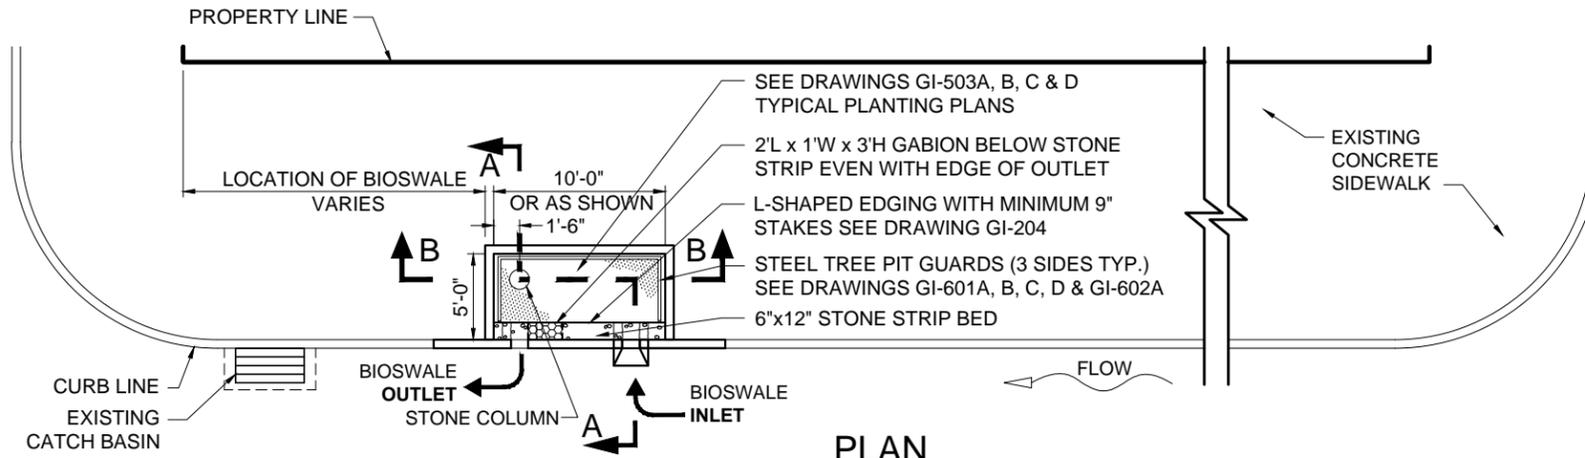

PLAN

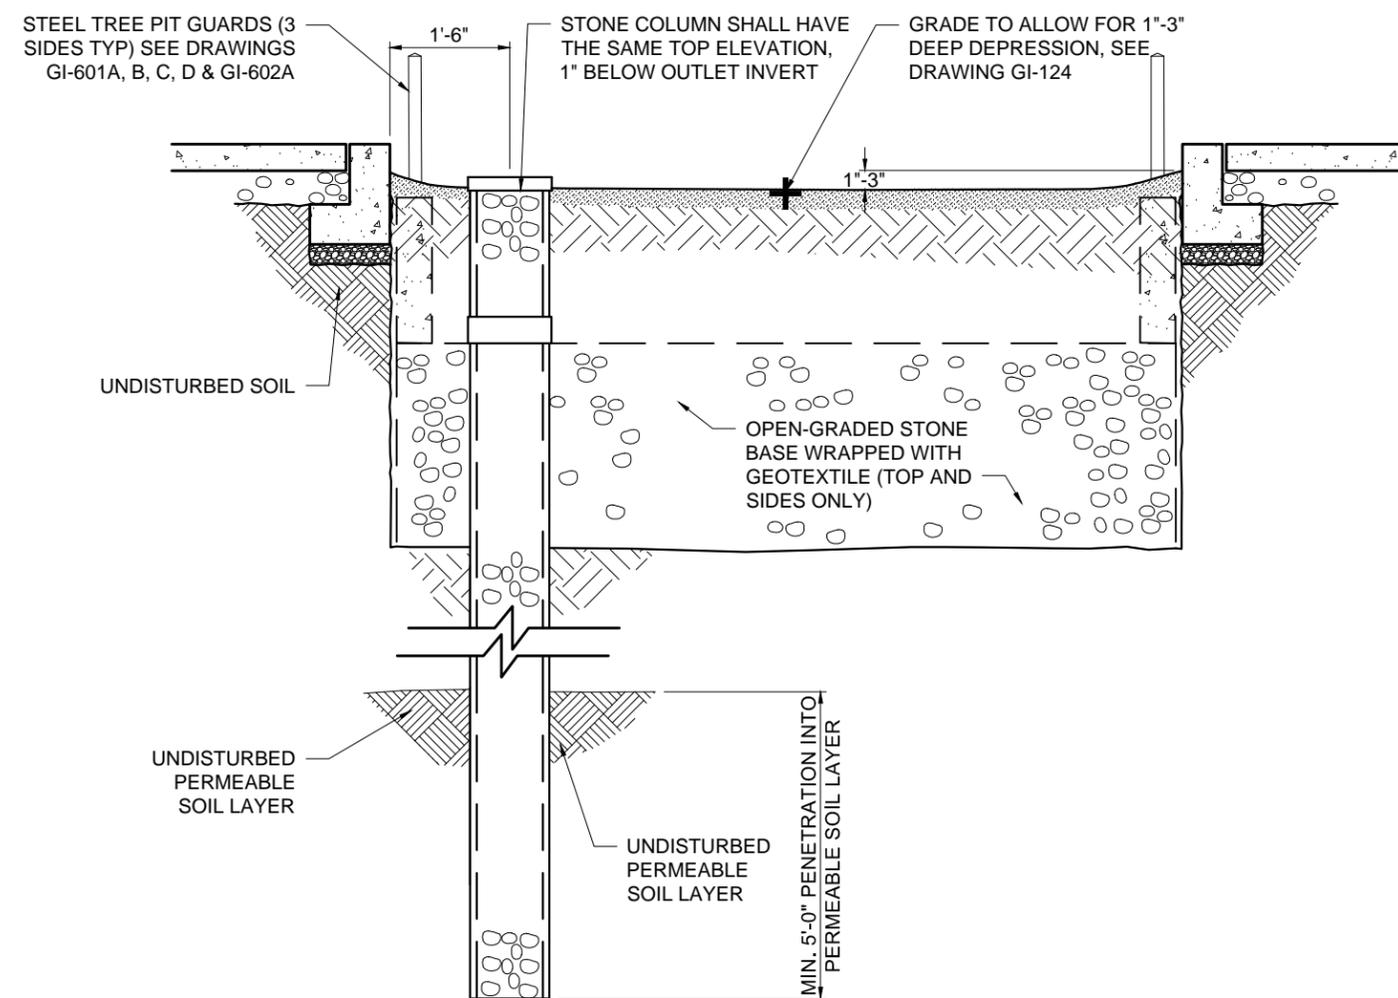

SECTION B-B

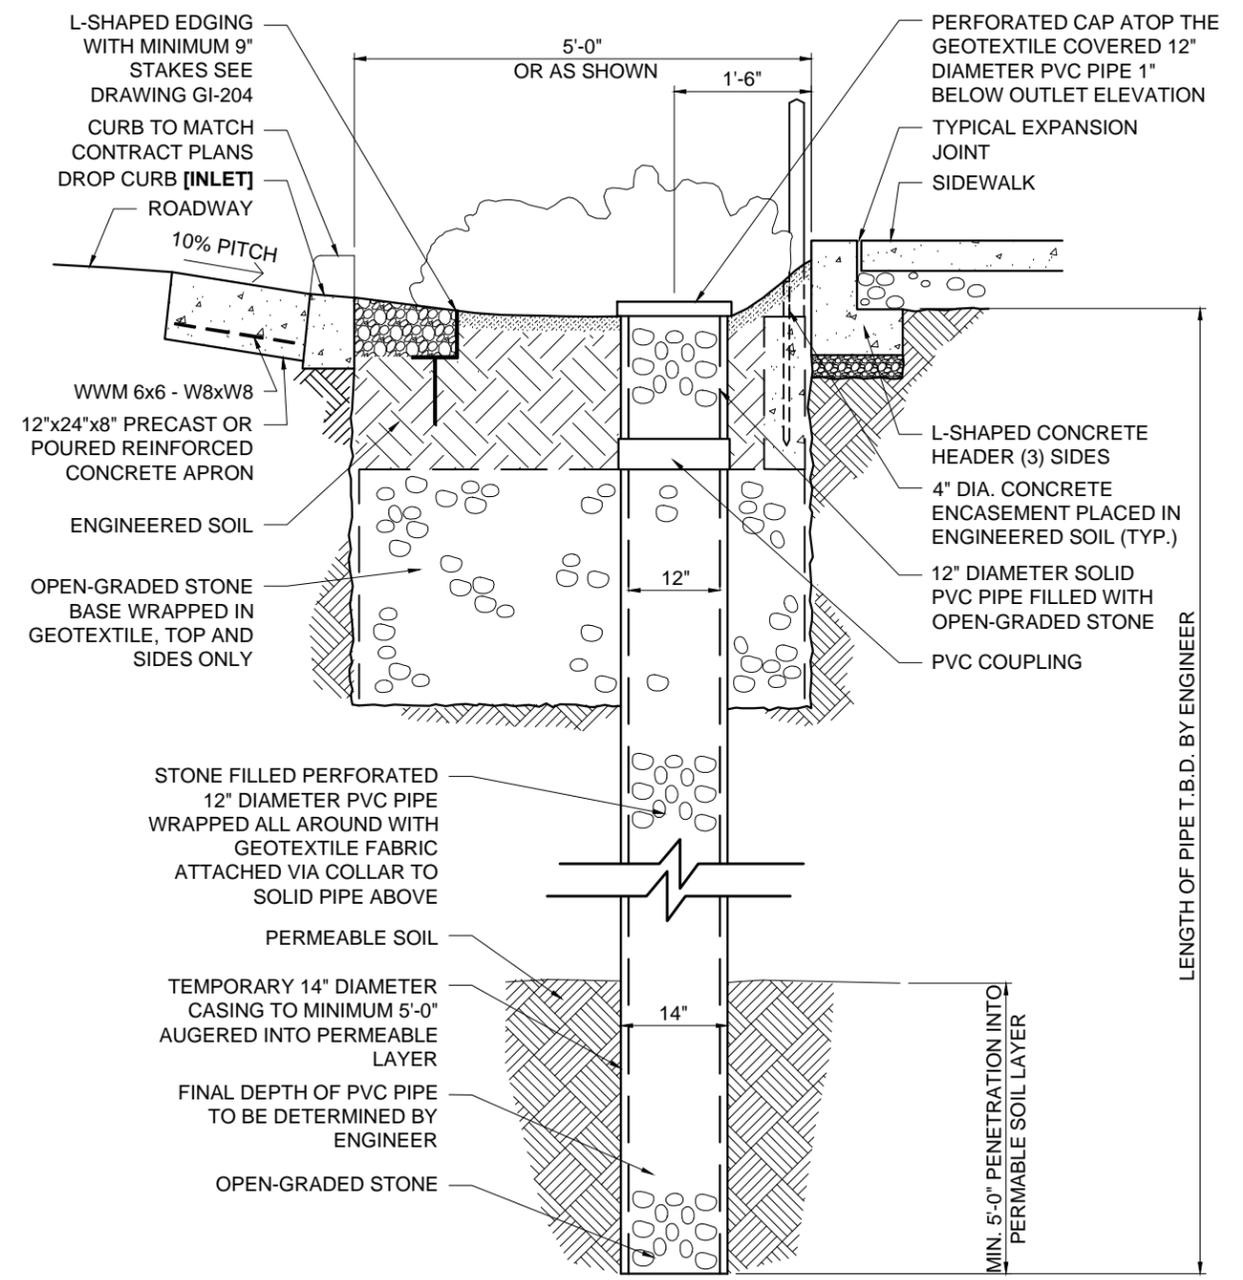


SECTION A-A AT BIOSWALE VERTICAL DRAIN

Medi Taha
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 10'X5' R.O.W. BIOSWALE TYPE 3A - WITH STONE COLUMNS
 - NO CONNECTION TO SEWERS

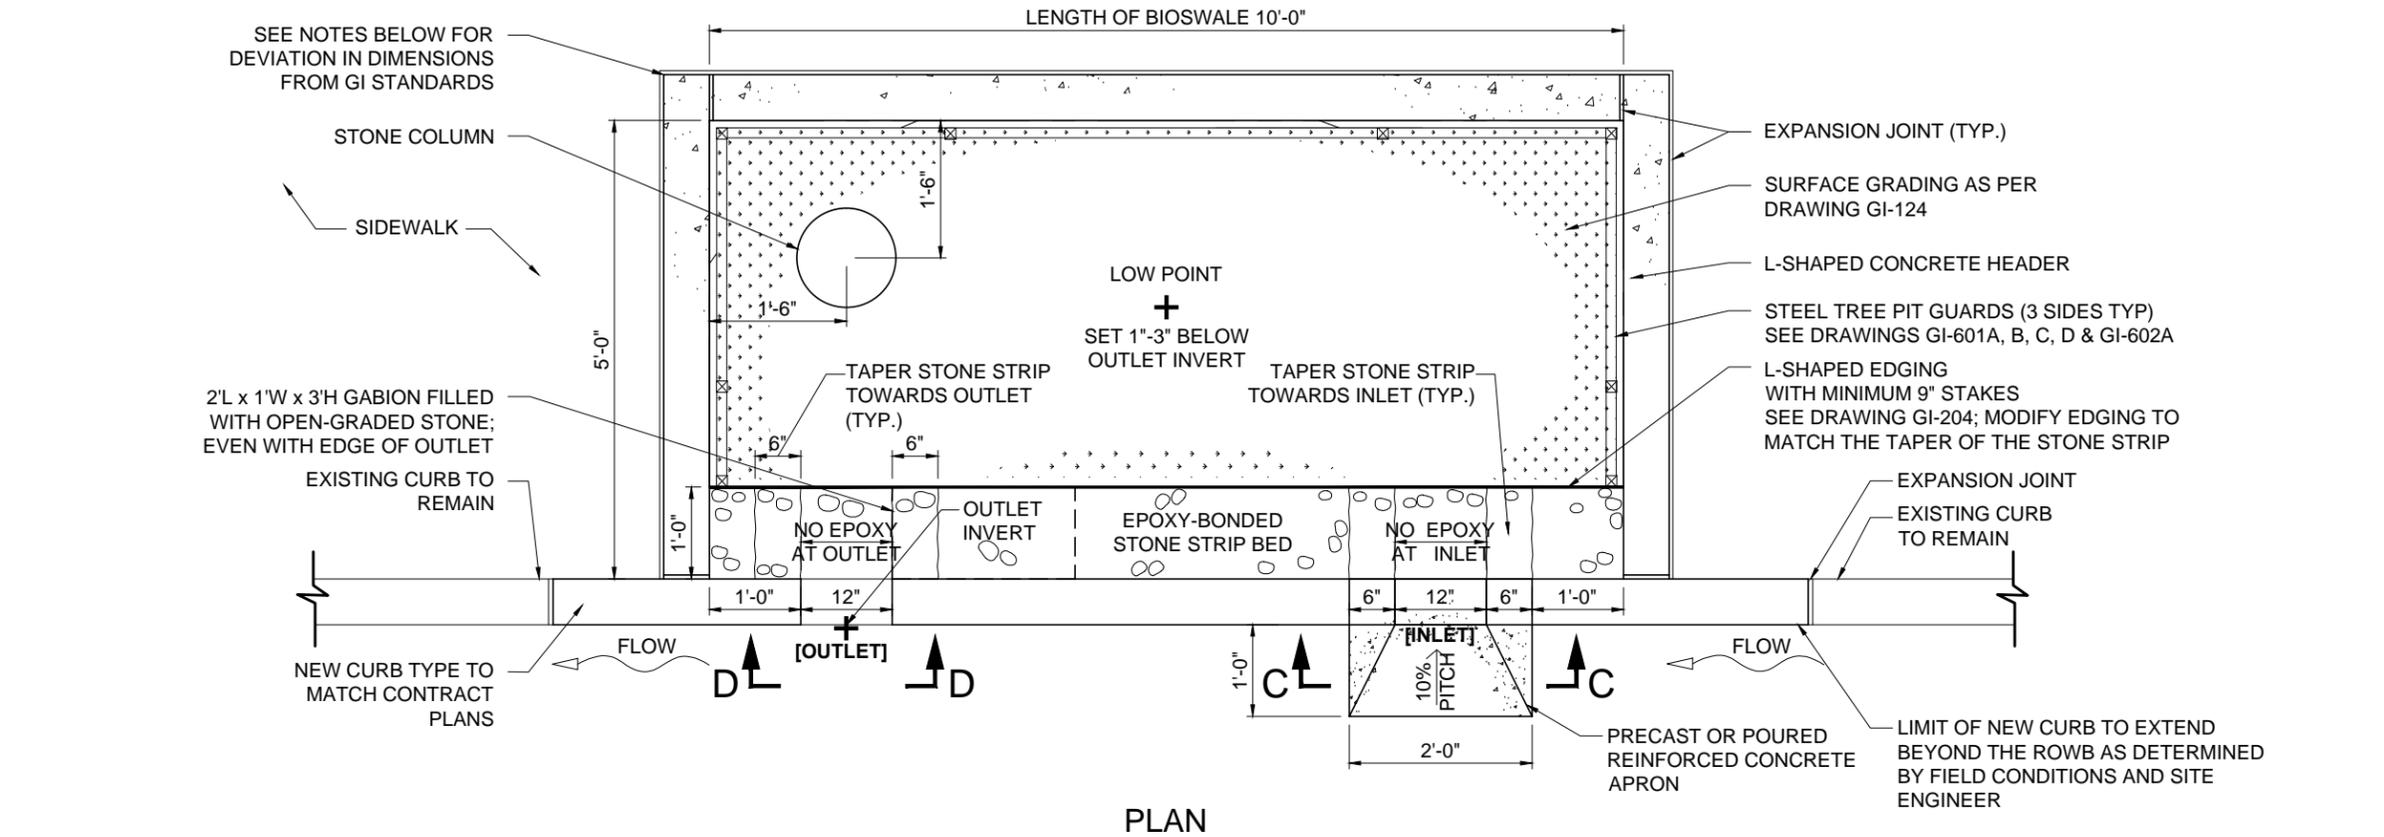

PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE ALL EXISTING FULL SIDEWALK FLAGS ADJACENT TO THE PERIMETER OF THE BIOSWALE IN ADDITION TO ANY PARTIAL FLAG AREAS LEFTOVER DUE TO CONSTRUCTION. THE CONTRACTOR SHALL REPLACE THE SIDEWALK IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY TREE PLANTING PERMIT FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) PRIOR TO THE START OF WORK. ALL NECESSARY TREE PLANTING SHALL BE SUPERVISED BY CERTIFIED ARBORISTS.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. TREES SHALL BE STAKED AS PER DOT STANDARD DETAILS OF CONSTRUCTION. TREE STAKES ARE TO BE REMOVED BY THE CONTRACTOR NOT LESS THAN ONE YEAR AFTER PLANTING.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
7. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING TREE PIT OR R.O.W. BIOSWALE.
8. REPLACEMENT TREES SHALL BE PLANTED WITHIN THE PROJECT AS DIRECTED BY THE ENGINEER IN ACCORDANCE WITH STANDARD HIGHWAY SPECIFICATIONS.
9. STONE STRIP BED TO BE BONDED WITH EPOXY TO KEEP STONES IN PLACE. STONES IN FRONT OF INLETS AND OUTLETS ARE TO BE LEFT LOOSE AND UNBONDED
10. 14" DIAMETER CASING TO BE AUGERED TO DEPTH AS DIRECTED BY ENGINEER. 12" DIAMETER PVC PIPE WRAPPED ALL AROUND WITH GEOTEXTILE FABRIC INSERTED IN THE 14" CASING
11. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-122 AND SPECIFICATIONS

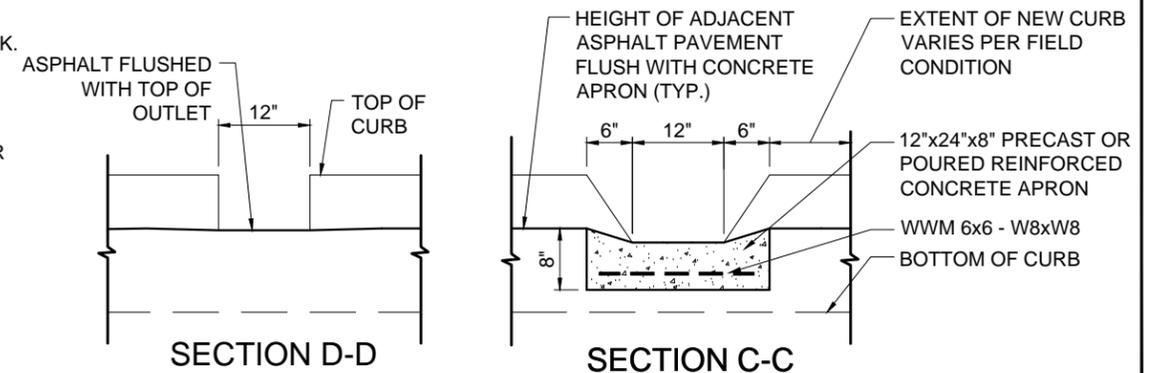


Maedi Taha
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. RAIN GARDEN TYPE 1, TYPE 2, AND TYPE 3


- NO CONNECTION TO SEWERS

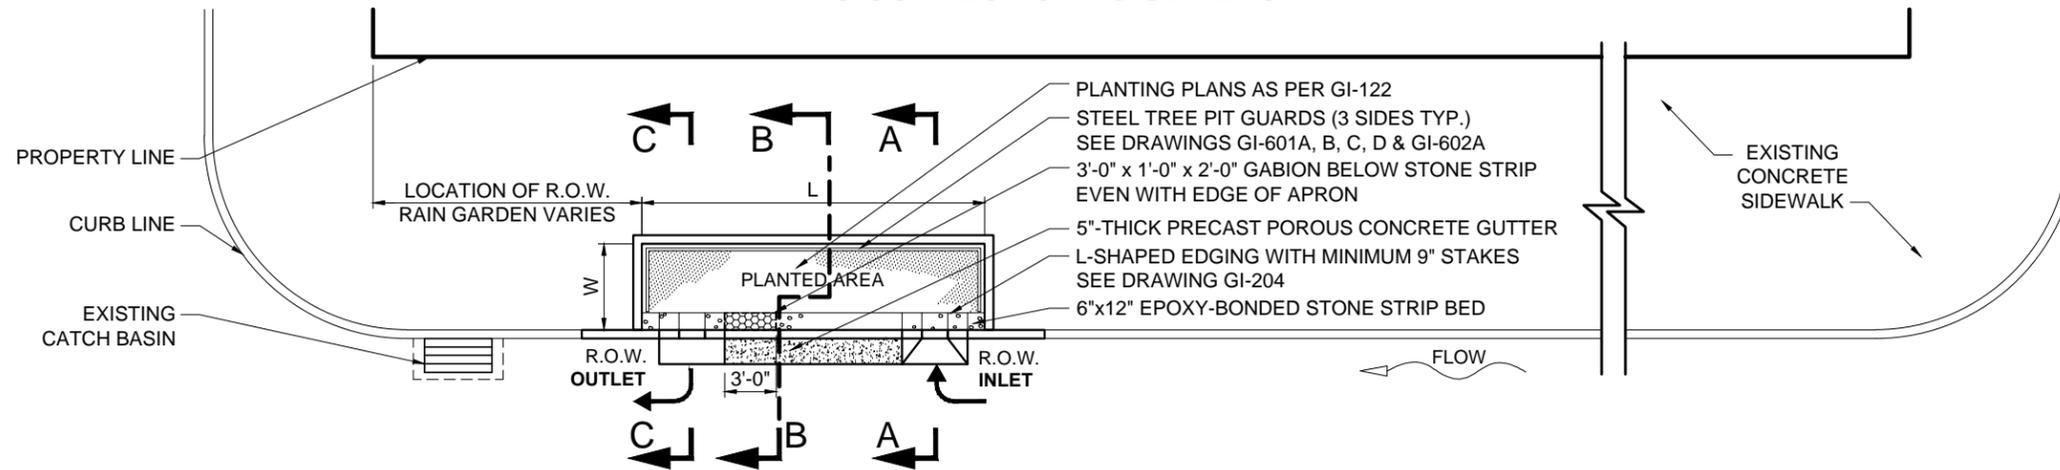


PLAN

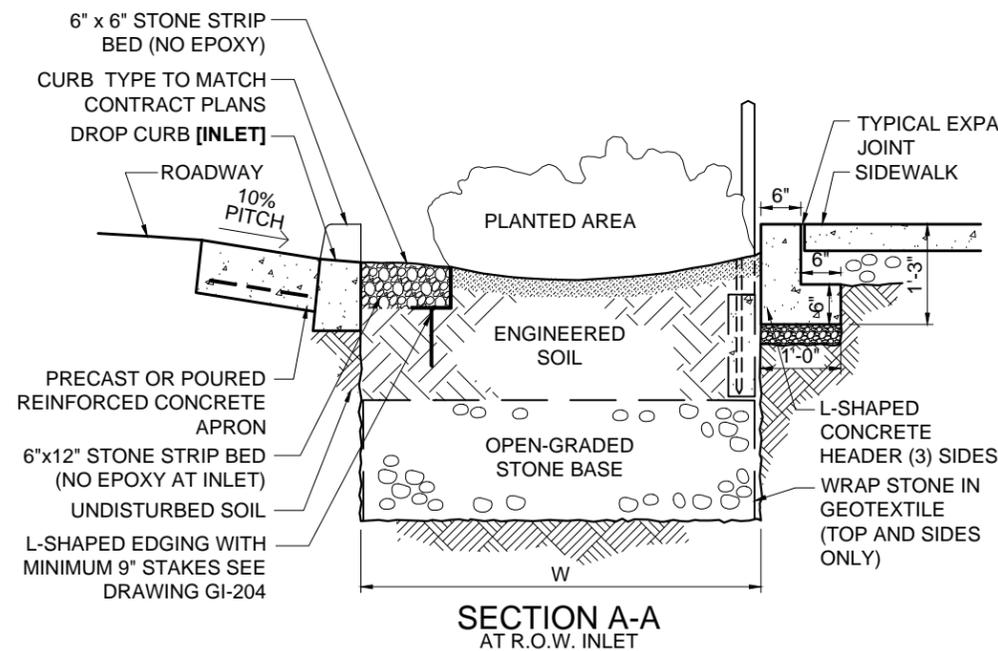

SECTION A-A
AT R.O.W. INLET

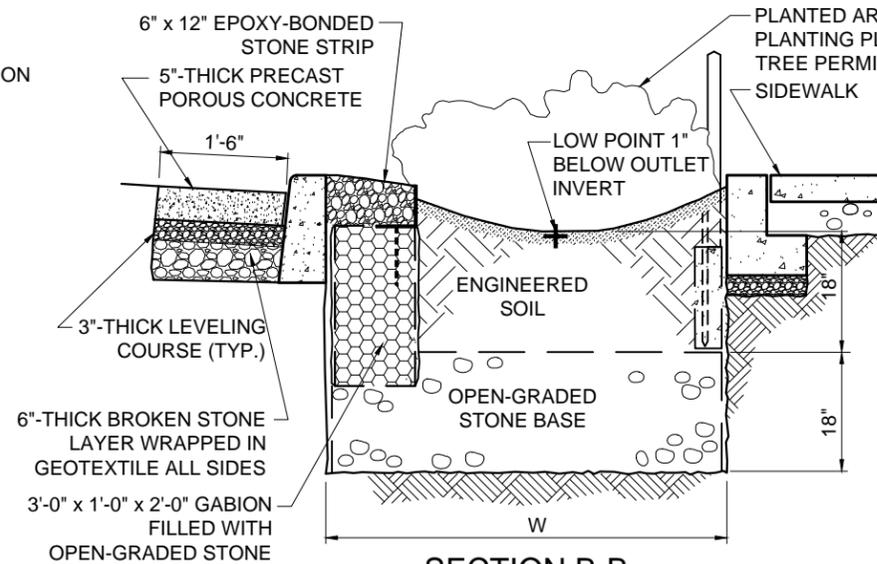

SECTION B-B
AT MIDSECTION [LOWEST POINT]

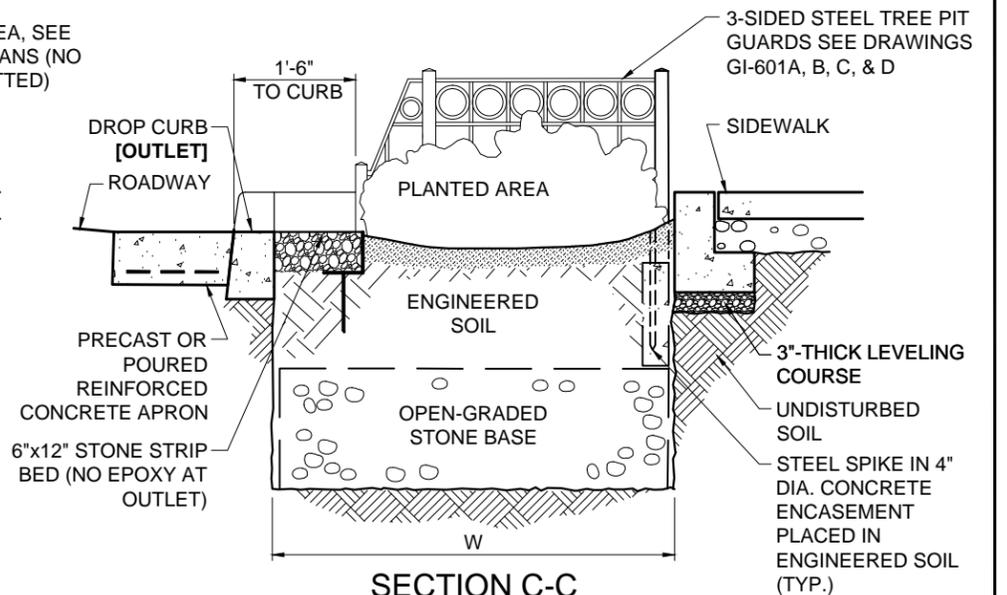

SECTION C-C
AT R.O.W. OUTLET

R.O.W. RAIN GARDEN DETAILS		
LENGTH (L), 1FT INCREMENT	WIDTH (W), 6 IN INCREMENT	TYPE
17' ≤ L ≤ 20'	4'-0" TO 6'-0"	TYPE 1
13' ≤ L ≤ 16'	4'-0" TO 6'-0"	TYPE 2
10' ≤ L ≤ 12'	4'-0" TO 6'-0"	TYPE 3

NOTE:
PLAN LAYOUT DIMENSIONS AND PLANTING
PLAN AS PER GI-122 FOR THE R.O.W. RAIN
GARDEN TYPE SPECIFIED.


Mae di Tura
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

DIMENSION SCHEDULE FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

- NO CONNECTION TO SEWERS

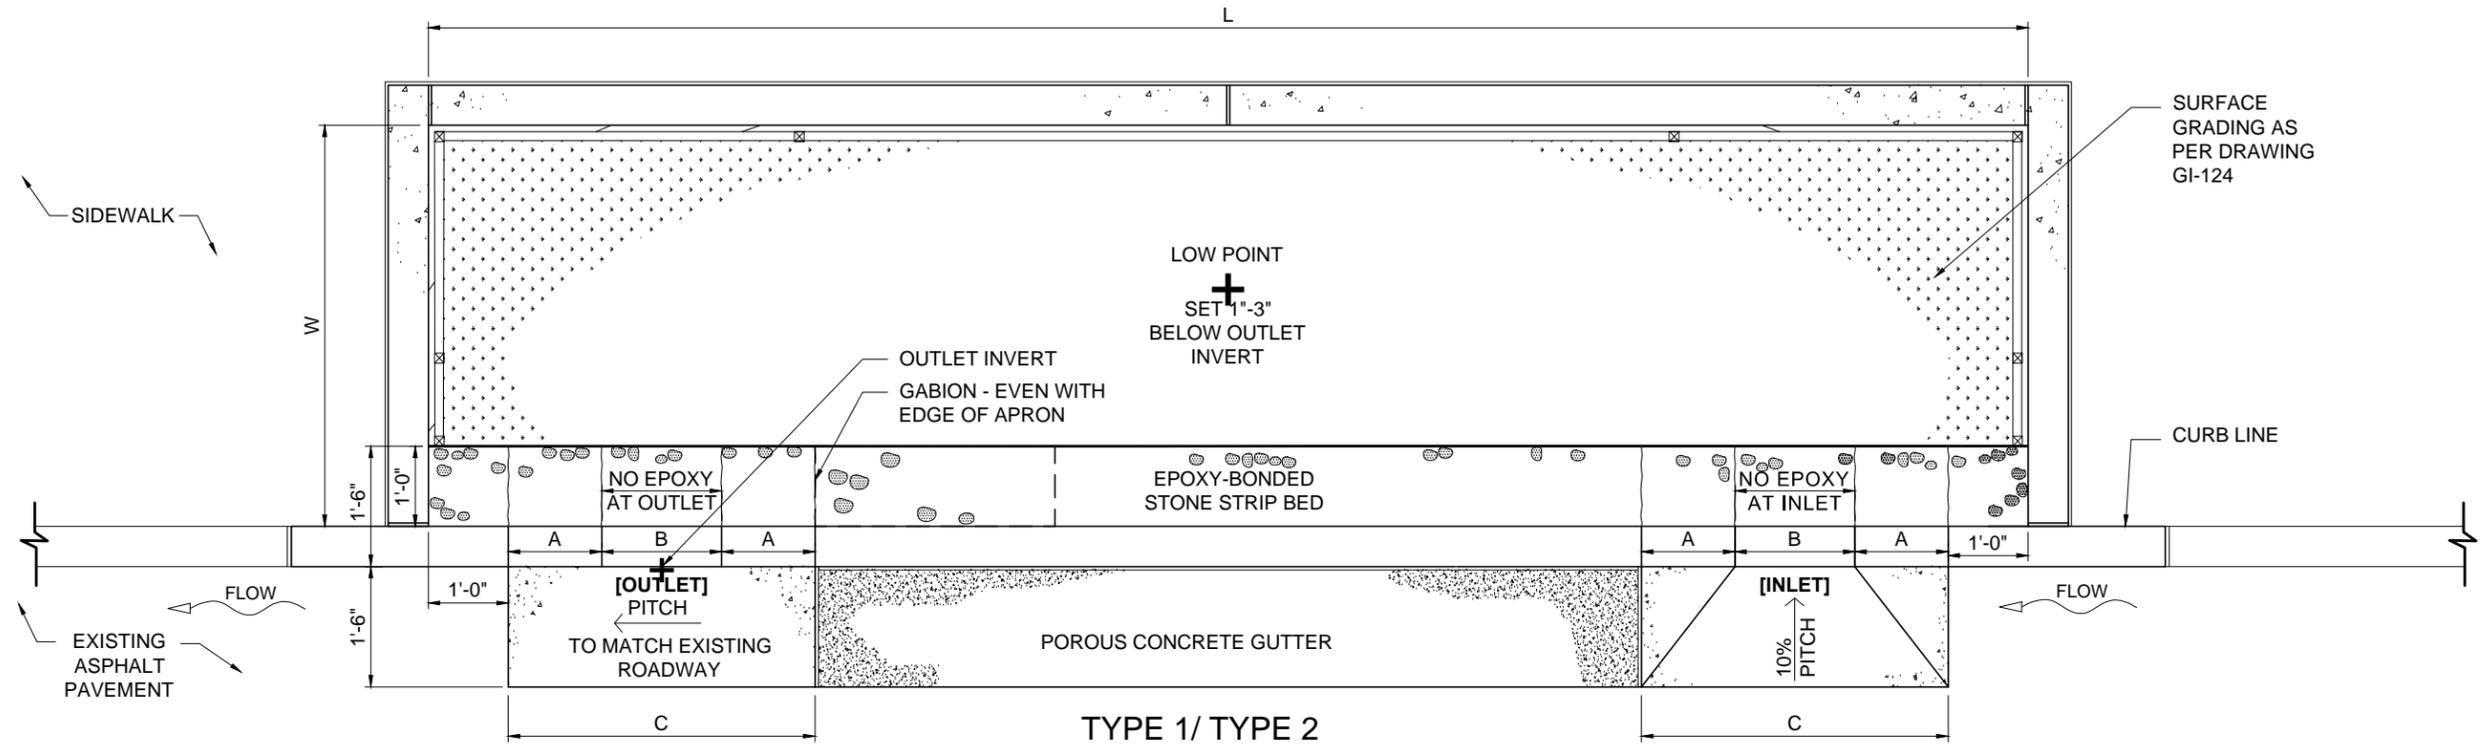


R.O.W. BIOSWALE OR RAIN GARDEN DETAILS			INLET/OUTLET DIMENSIONS			PLANTING PLAN
LENGTH (L), 1FT. INCREMENT	WIDTH (W), 6 IN. INCREMENT	TYPE	A	B	C	TYPE / PAGE NUMBER
17' ≤ L ≤ 20'	4'-0" TO 6'-0"	TYPE 1	14"	18"	3'-10"	TYPE 1 / GI-501A-D
13' ≤ L ≤ 16'	4'-0" TO 6'-0"	TYPE 2	10"	14"	2'-10"	TYPE 2 / GI-502A-D
10' ≤ L ≤ 12'	4'-0" TO 6'-0"	TYPE 3	6" *	12"	2'-0" *	TYPE 3 / GI-503A-D

DIMENSION AND PLANTING PLAN SCHEDULE

NOTES:

- STANDARD CROSS-SECTIONAL DETAILS AND NOTES AS PER THE R.O.W. BIOSWALE OR R.O.W. RAIN GARDEN TYPE SPECIFIED.
- PRIOR TO CONSTRUCTION, THE CONTRACTOR WILL CONFIRM THE LEVELS OF THE R.O.W. BIOSWALE OR R.O.W. RAIN GARDEN TO PREVENT FLOODING.
- DOT APPROVAL REQUIRED FOR ALL WIDTHS GREATER THAN 5'.
- PLANTING QUANTITIES AND PLANS FOR VARIABLE WIDTH R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS AS PER THE PAGE NUMBERS SPECIFIED, DISTRIBUTED EVENLY.
- TREES SPECIES AS DIRECTED BY DPR. TREES ARE ONLY PERMITTED IN R.O.W. BIOSWALES WITH AN ENGINEERED SOIL LAYER 24" DEEP.
- * INLET DIMENSIONS ONLY

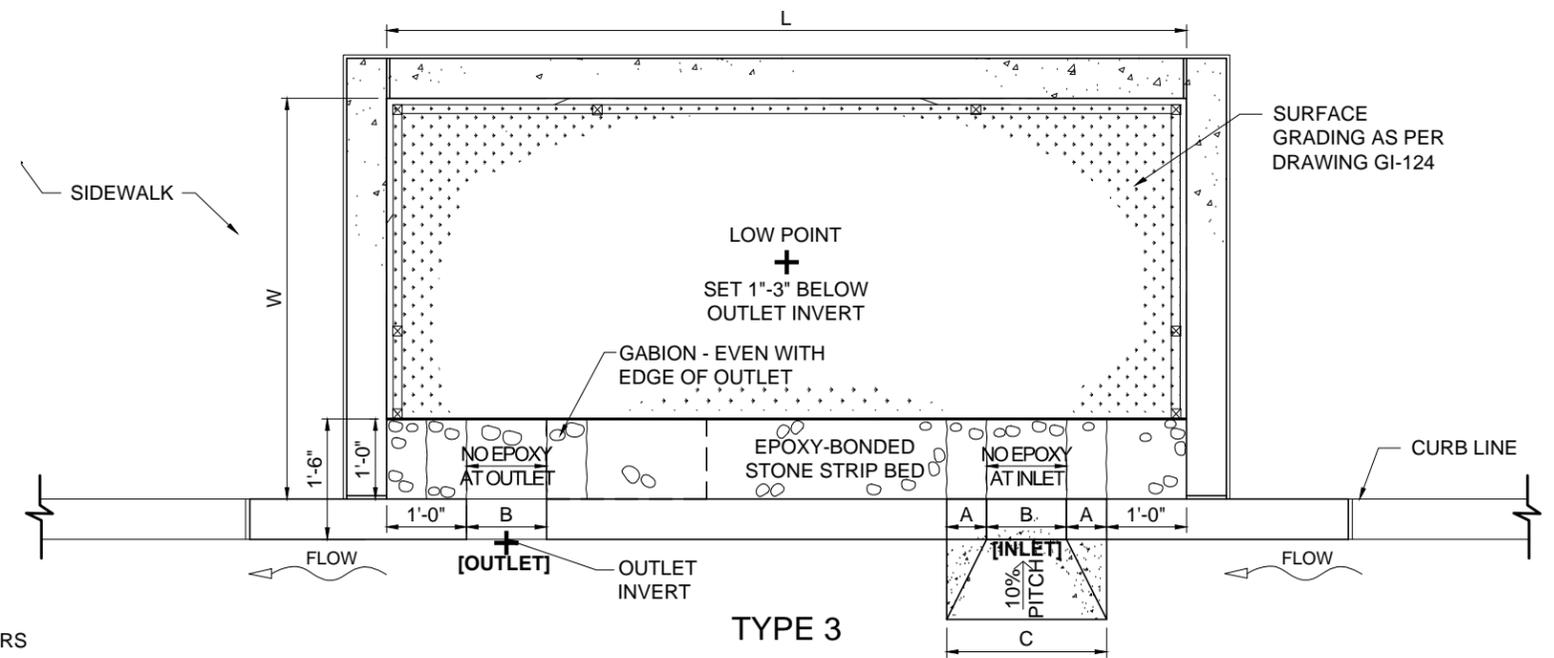


Mae di Tura
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE

STONE COLUMN SCHEDULE FOR VARIABLE SIZE R.O.W. BIOSWALE

- NO CONNECTION TO SEWERS

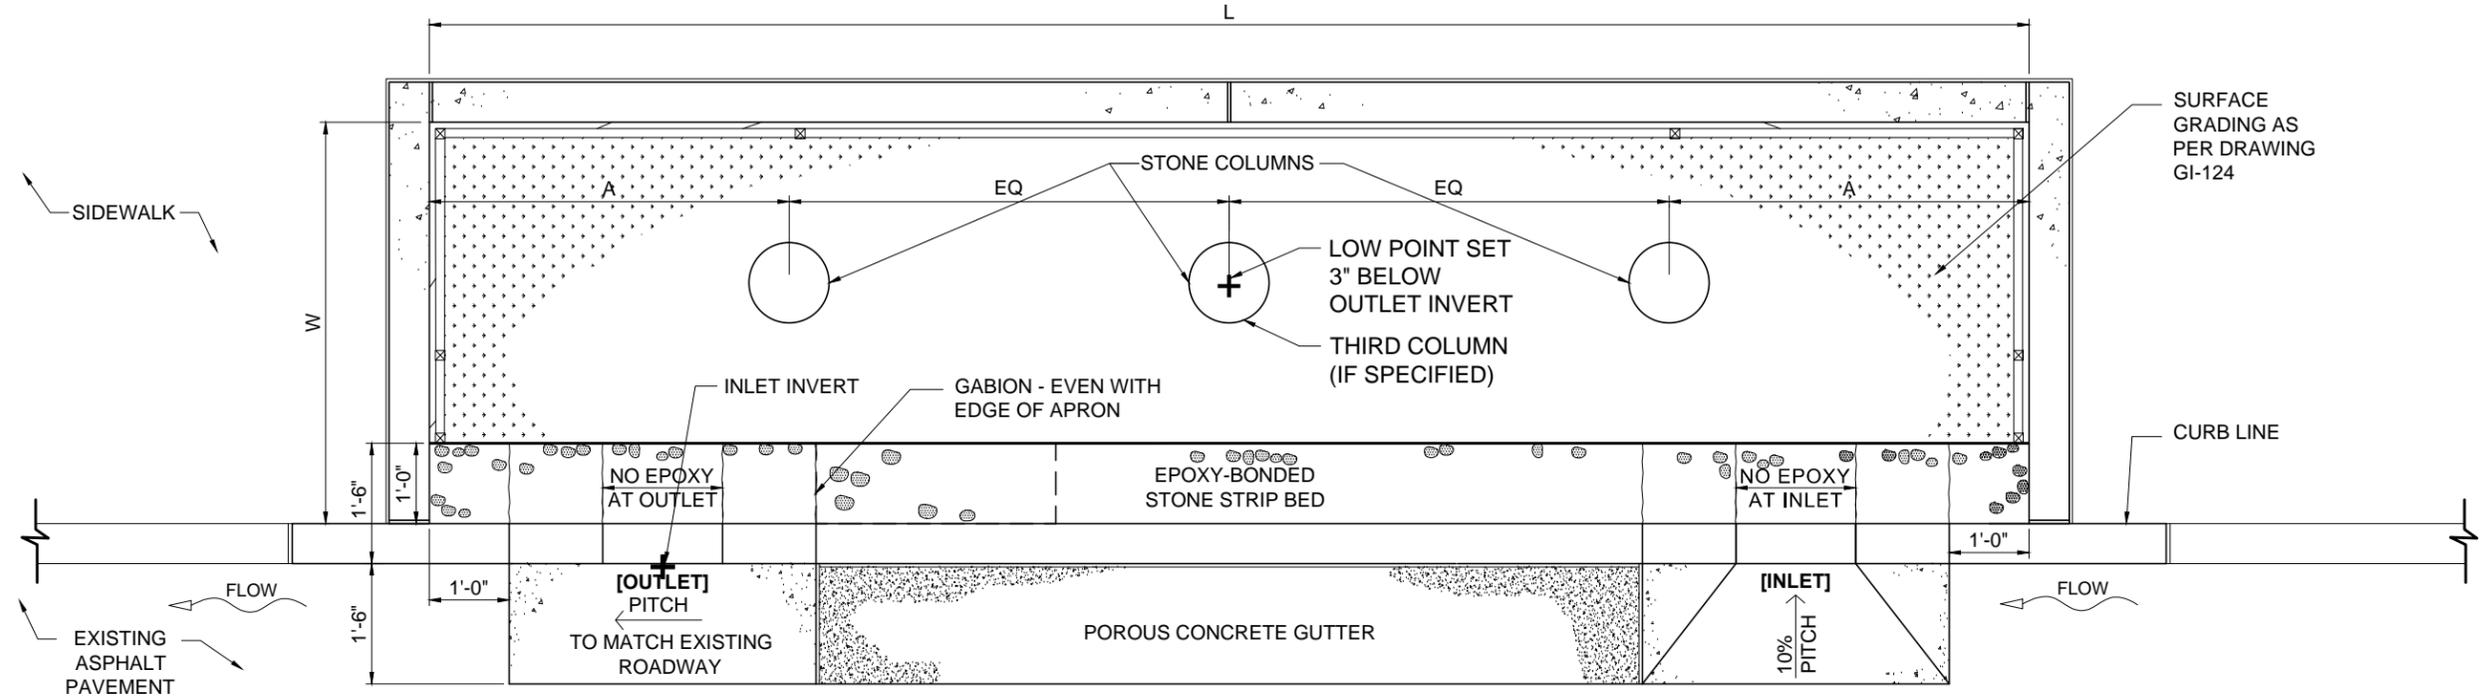


TYPE 1/ TYPE 2

R.O.W. BIOSWALE OR RAIN GARDEN DETAILS			STONE COLUMN DETAILS	
LENGTH (L), 1FT. INCREMENT	WIDTH (W), 6 IN. INCREMENT	TYPE	NUMBER OF COLUMNS	A
17' ≤ L ≤ 20'	4'-0" TO 6'-0"	TYPE 1	3	4'-6"
13' ≤ L ≤ 16'	4'-0" TO 6'-0"	TYPE 2	2	3'-6"
10' ≤ L ≤ 12'	4'-0" TO 6'-0"	TYPE 3	1	1'-6"

DIMENSION SCHEDULE

NOTES:

- STANDARD STONE COLUMN CROSS SECTIONAL DETAILS AS SPECIFIED.
- THIRD COLUMN LOCATED IN CENTER OF ROWB.
- ROWB WITH THREE COLUMNS WILL NOT CONTAIN A TREE.

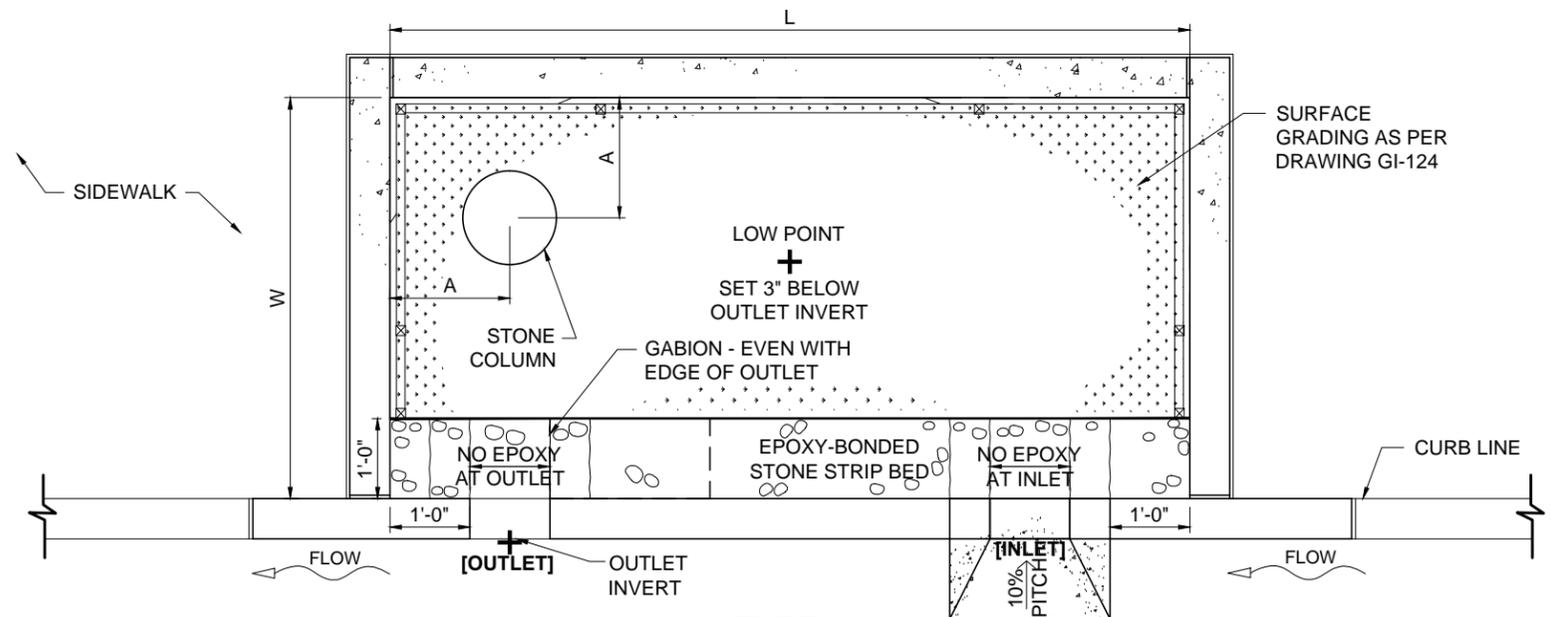

TYPE 3


Mae di Tura
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

SURFACE GRADING PLANS FOR R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

- NO CONNECTION TO SEWERS

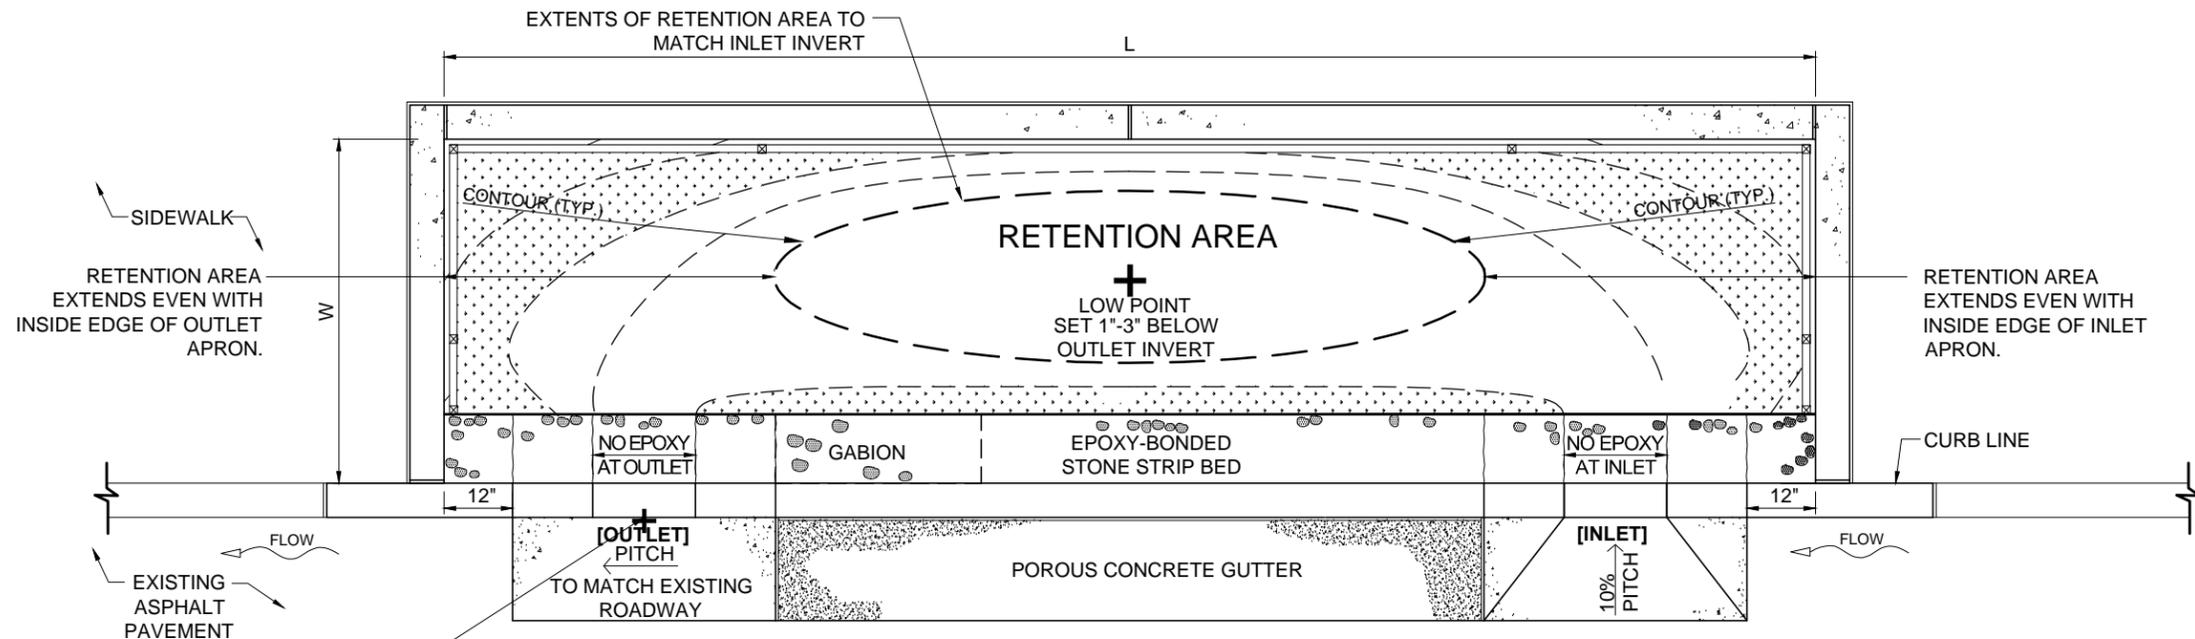


GRADING PLAN 1

FOR ALL ROWB WITH
L = 13' OR GREATER


NOTES:

1. ALL SURFACE GRADING TO TAPER TOWARD THE LOW POINT.
2. CONTOUR LINES SHOWN ON THIS DRAWING ARE SCHEMATIC ONLY AND DEPEND ON THE STREET GRADE.

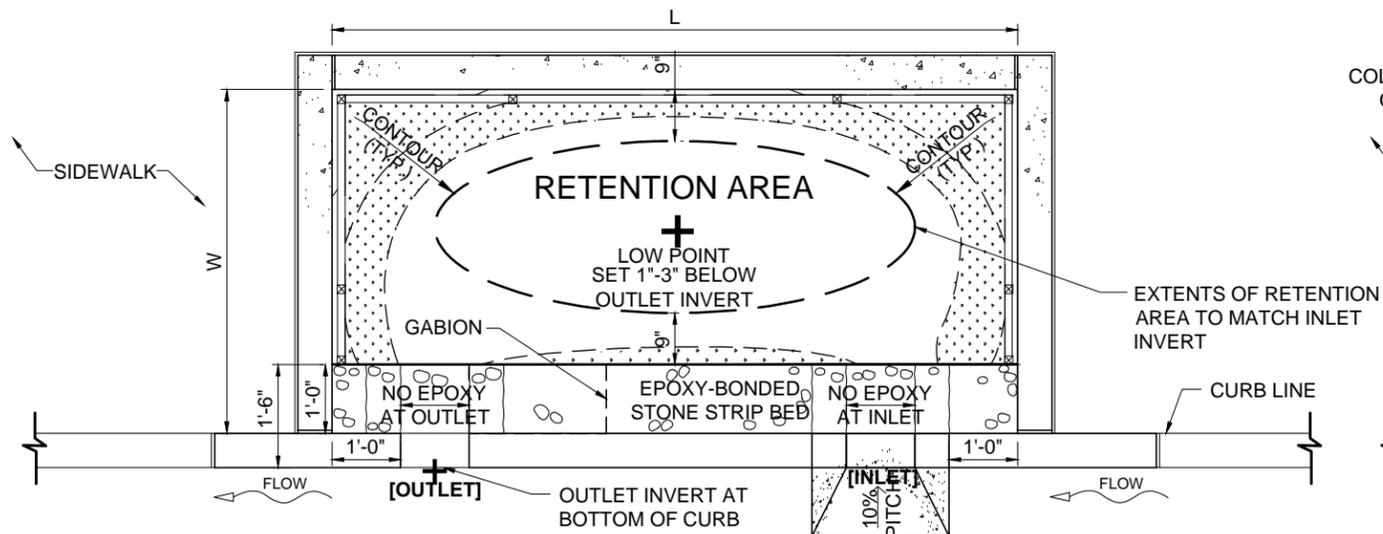

GRADING PLAN 2

FOR ROWB WITHOUT STONE COLUMN AND
L = LESS THAN 13'

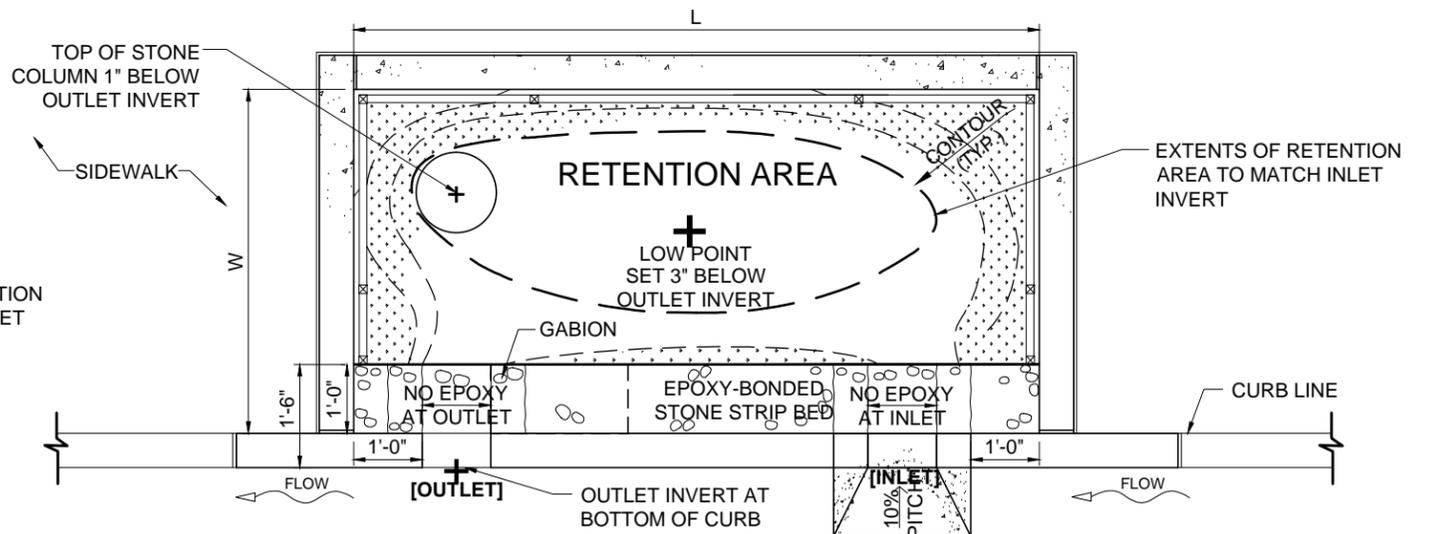

GRADING PLAN 3

FOR ROWB WITH STONE COLUMN AND
L = LESS THAN 13'


Mae di Tura
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. STORMWATER INFILTRATION BASIN WITH TYPE 2 CATCH BASIN


- NO CONNECTION TO SEWERS

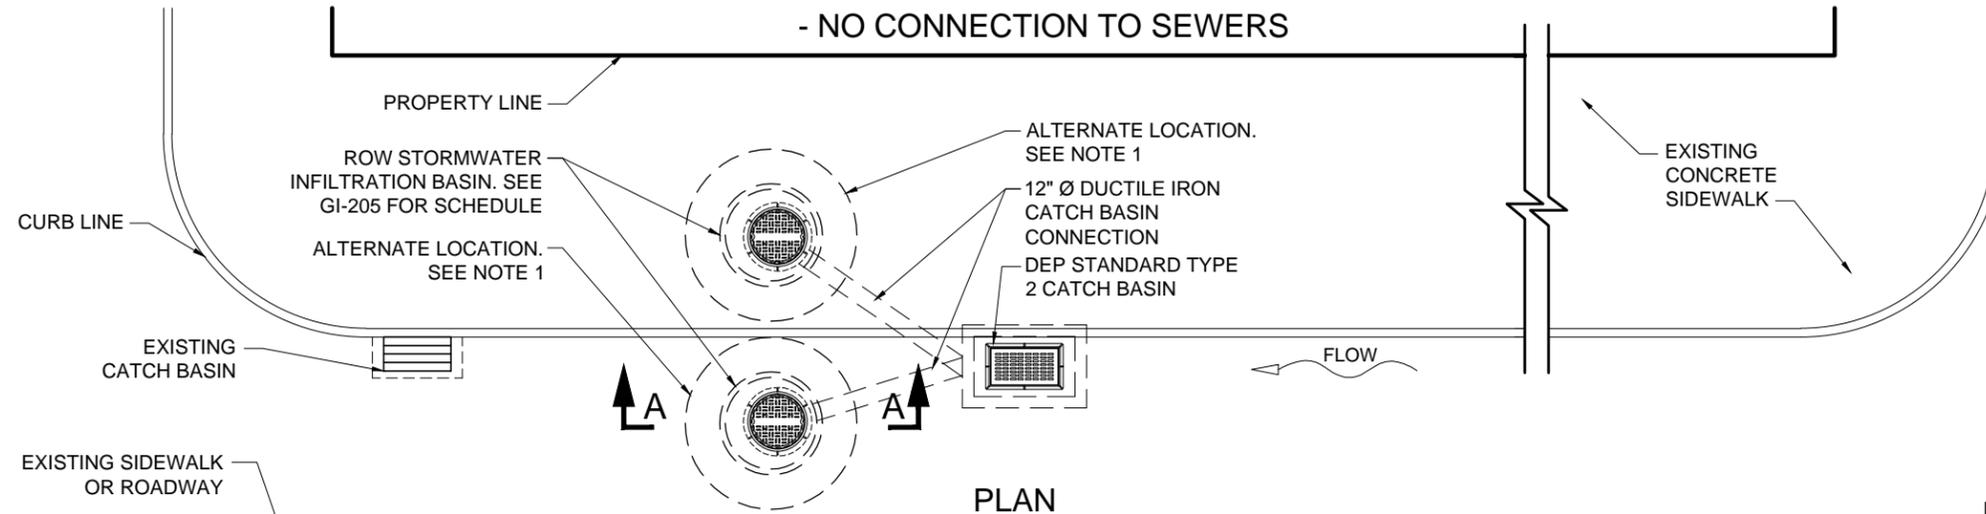


PLAN

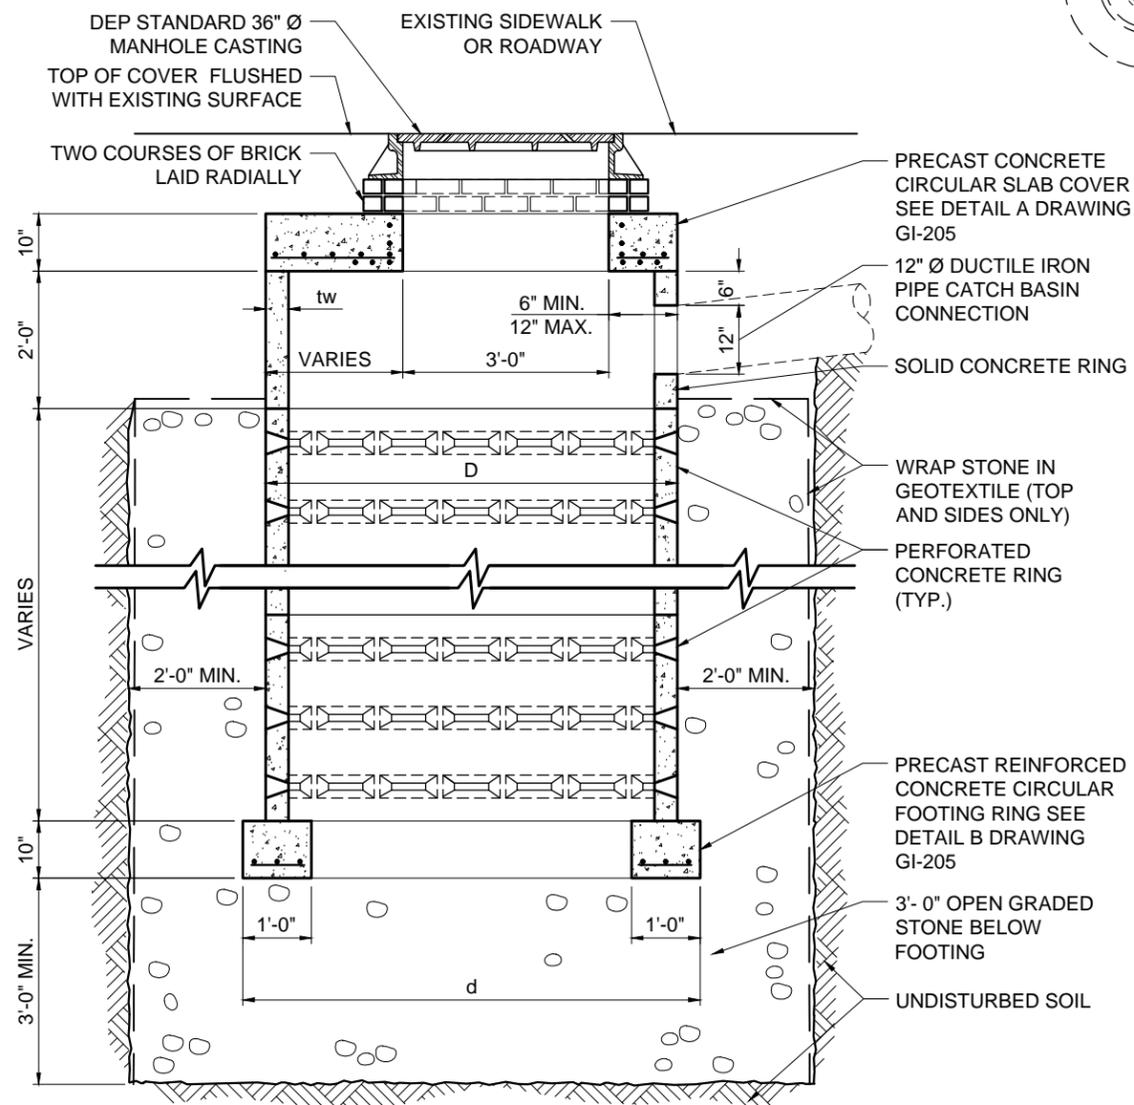

SECTION A-A

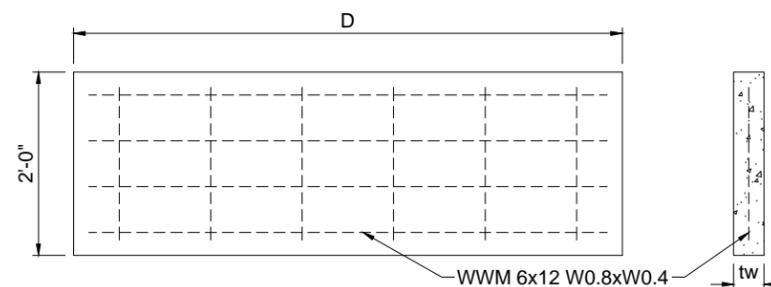

PRECAST SOLID CONCRETE RING

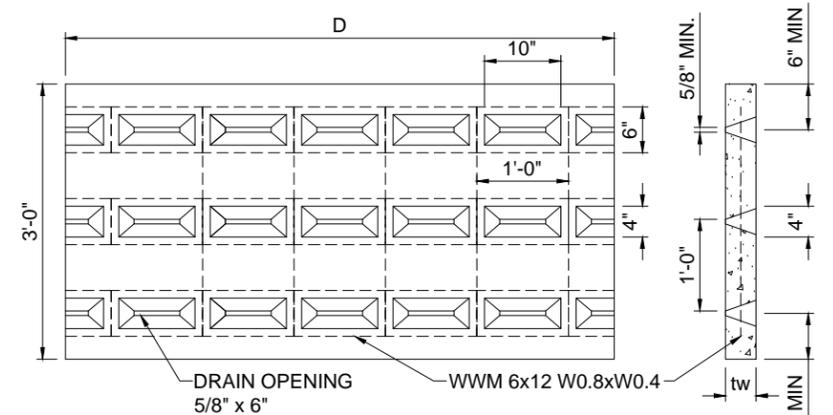

PRECAST PERFORATED CONCRETE RING


NOTES:

1. THE LOCATION OF THE ROW INFILTRATION BASIN SHALL BE SUCH THAT THE OPENING IN THE TOP SLAB TOGETHER WITH FRAME AND COVER SHALL BE ENTIRELY IN THE ROADWAY AREA OR ENTIRELY IN THE SIDEWALK AREA.
2. ALL SLABS AND RINGS SHALL BE PLACED ON A ONE HALF (1/2) INCH THICK FULL BED OF FRESH MORTAR.
3. INFILTRATION BASIN SOLID RING AND INFILTRATION RING REINFORCING COMPLIES WITH AREA REQUIREMENTS OF ASTM C478. EXCEPT THAT ALL WALL SECTIONS SHALL BE REINFORCED WITH WWM 6x12 W0.8xW0.4 PLACED IN CENTER OF WALL. IN SOLID RING 1-#4 HOOP SHALL BE PLACED AROUND ALL CAST PIPE OPENINGS. (THE 1-#4 HOOP WILL BE REQUIRED AT CORED OPENINGS FOR BASIN CONNECTIONS IN SOLID RINGS.) (ALL VALUES OF AREA OF STEEL (AS) ARE IN SQUARE INCHES AND ARE A MINIMUM.)
4. PRECAST PIPE OPENINGS AND CORED OPENINGS FOR CATCH BASIN CONNECTION WILL BE PLACED IN SOLID RING ONLY. NO CORED OPENING WILL BE ALLOWED IN SEEPAGE RINGS.
5. CORED OPENINGS IN SOLID RING WILL BE PERMITTED FOR UP TO 12" DIA. DUCTILE IRON CATCH BASIN CONNECTION ONLY.
6. PIPE OPENINGS WILL NOT BE PERMITTED THROUGH JOINTS. DISTANCE FROM TOP OR BOTTOM OF ANY SOLID RING SECTION SHALL BE A MINIMUM OF 6" FOR CORED OPENINGS FOR BASIN CONNECTIONS.
7. CONCRETE DESIGN MIX = 5,000 PSI (MIN. 28 DAY STRENGTH=4,000 PSI; MAX. W/C=0.47). REBARS - FS = 60,000 PSI. WWM - FS=65,000 PSI.
8. OPENINGS FOR SPACING AND HANDLING WILL BE ALLOWED IN UPPER PORTION OF SOLID RING. HOWEVER, THE CONTRACTOR SHALL FILL ALL SUCH OPENINGS WITH NON SHRINK GROUT IMMEDIATELY AFTER INSTALLATION.
9. IN NO CASE SHALL THE AREA OF THE DRAIN OPENING BE LESS THAN 3.0 SQ. IN.




Mehdi Taha
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 20'x3' R.O.W. GREENSTRIP TYPE 1
 - NO CONNECTION TO SEWERS

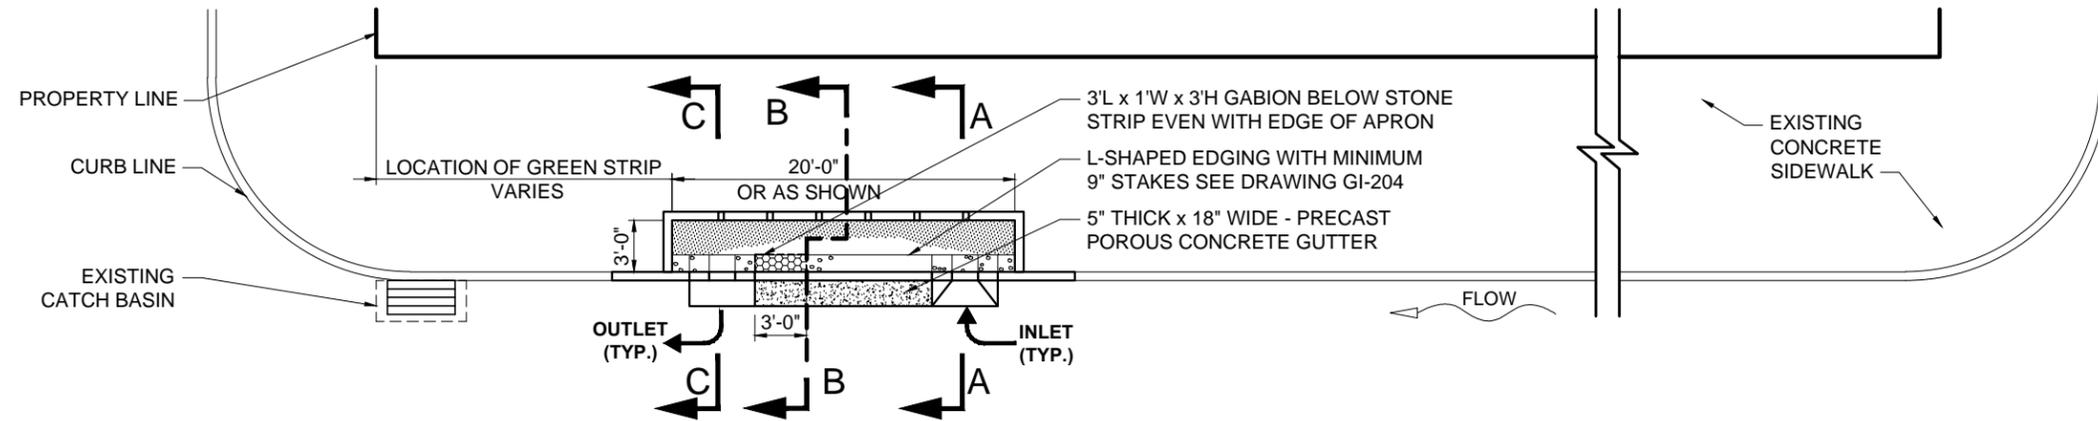


PLAN

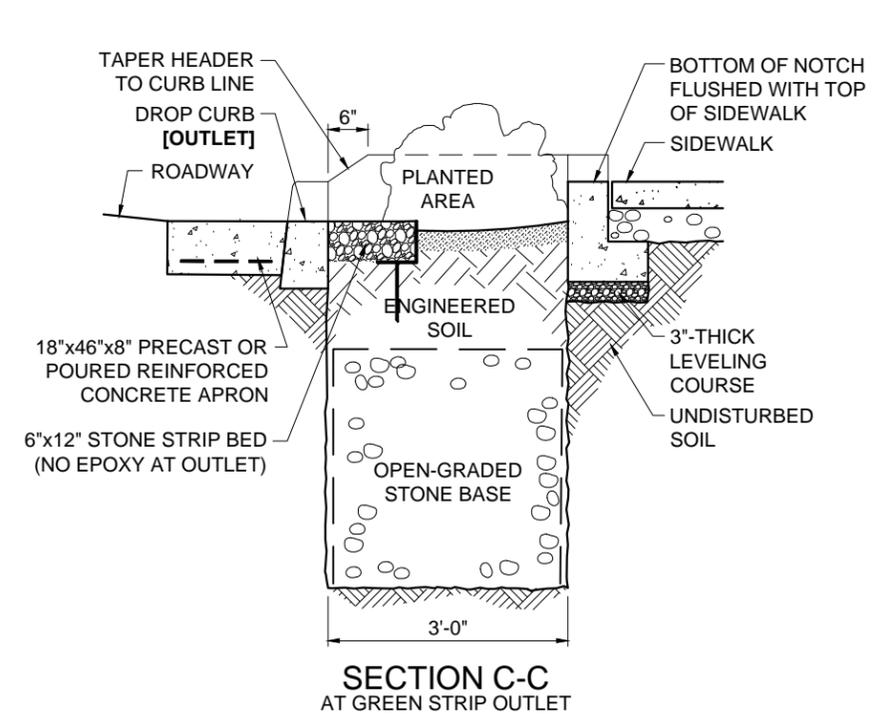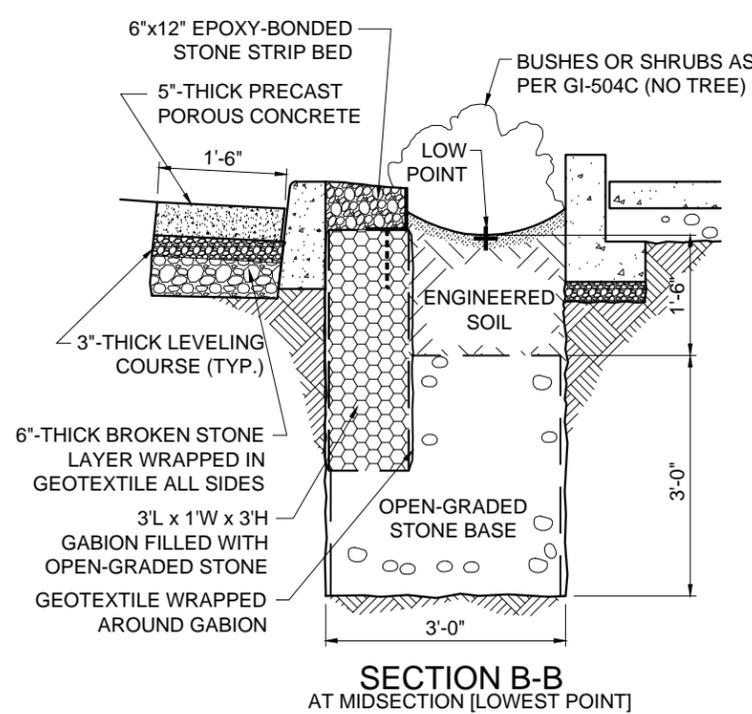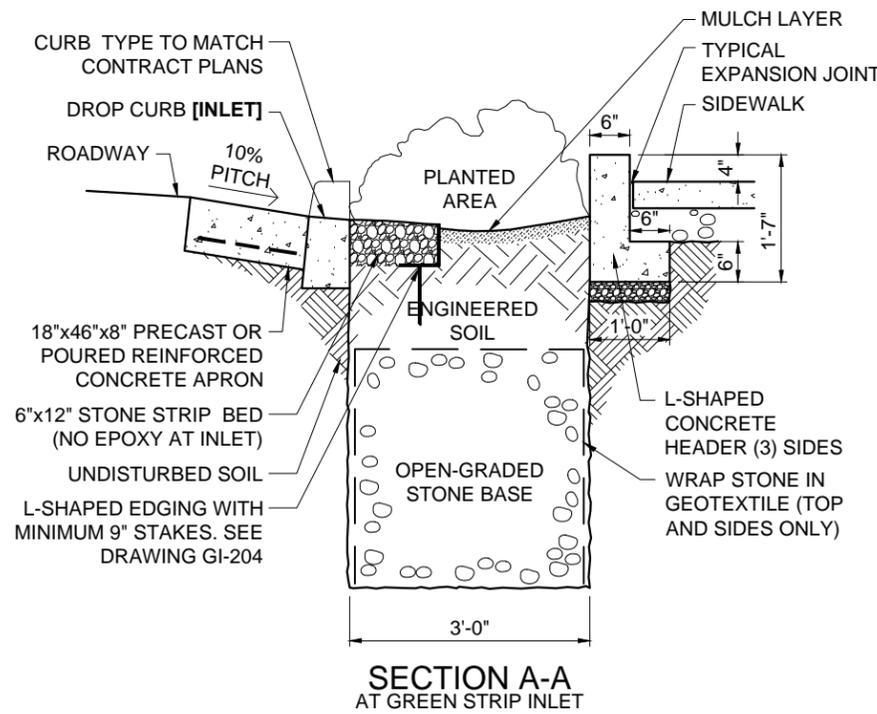

Maedi Tuna
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 20'x3' R.O.W. GREENSTRIP TYPE 1
 - NO CONNECTION TO SEWERS

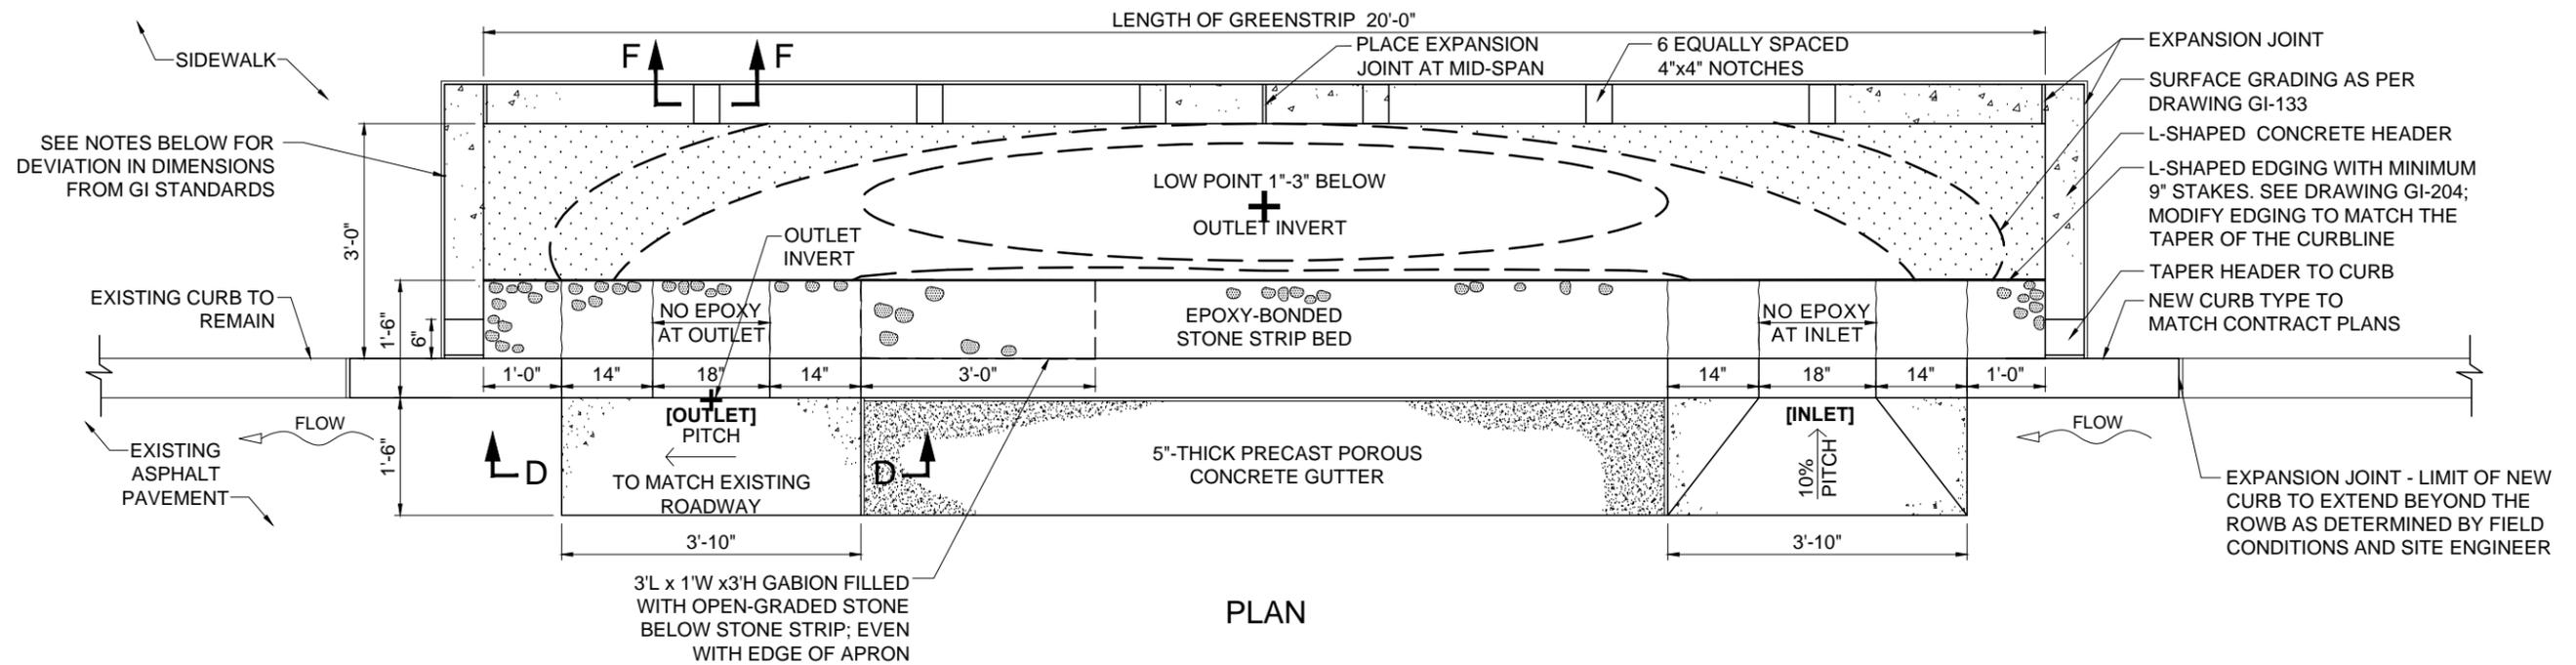


PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE THE ADJACENT EXISTING SIDEWALK FLAG TO NEAREST SIDEWALK JOINT BEYOND THE LIMITS OF THE BIOSWALE. THE CONTRACTOR SHALL REPLACE THAT SIDEWALK IN KIND IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF STANDARD HIGHWAY SPECIFICATION.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY PLANTING PERMITS FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) AND NYC DEPARTMENT OF TRANSPORTATION (DOT) PRIOR TO THE START OF WORK.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING R.O.W. GREEN STRIP
7. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-133 AND SPECIFICATIONS

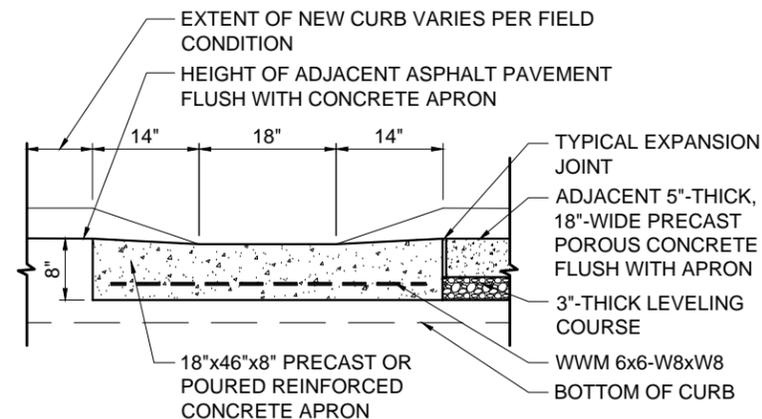

SECTION D-D




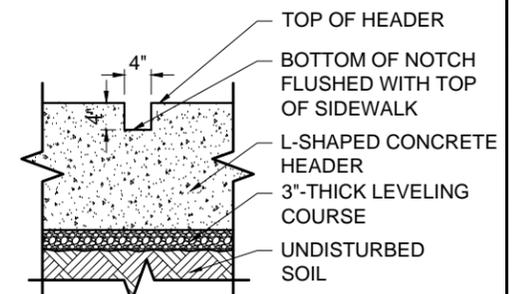


SECTION F-F
TYPICAL NOTCH AT HEADER

Maedi Tuna
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 15'x3' R.O.W. GREENSTRIP TYPE 2
 - NO CONNECTION TO SEWERS

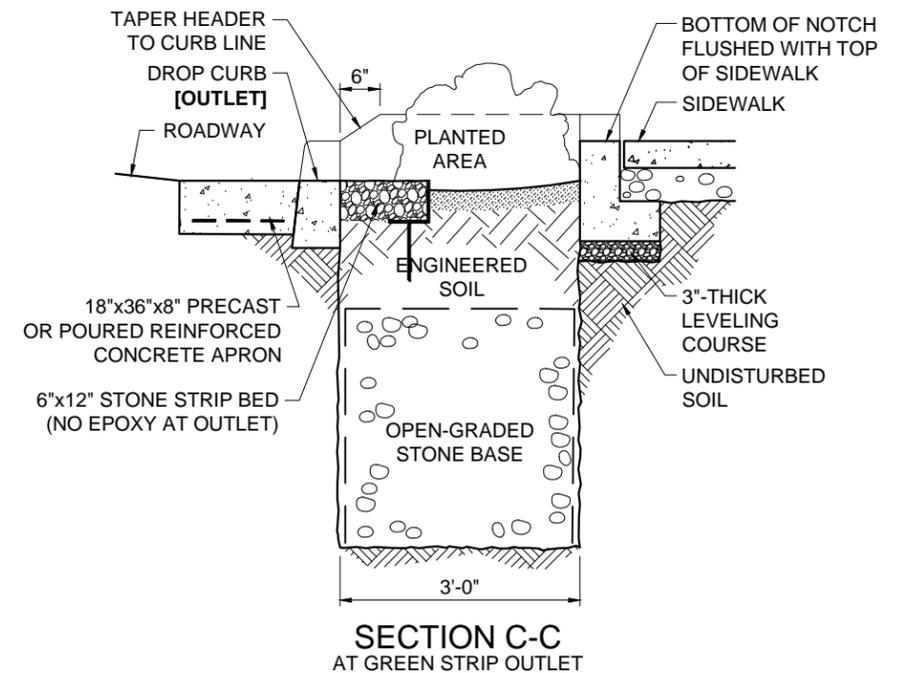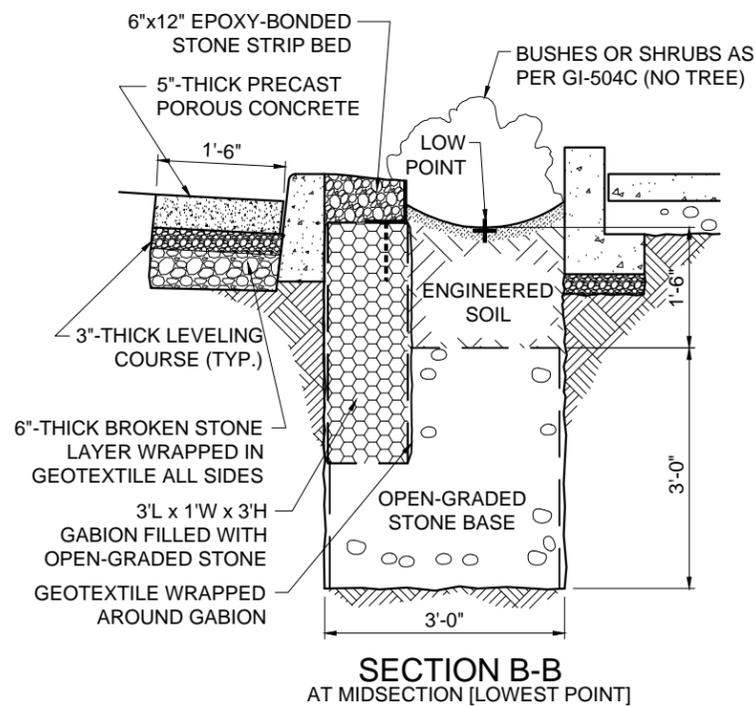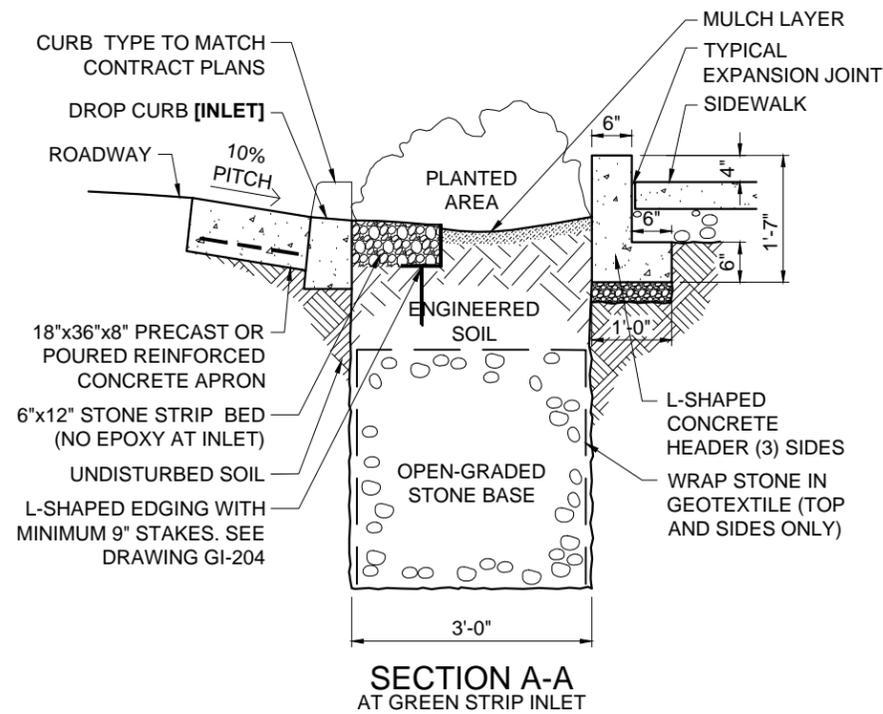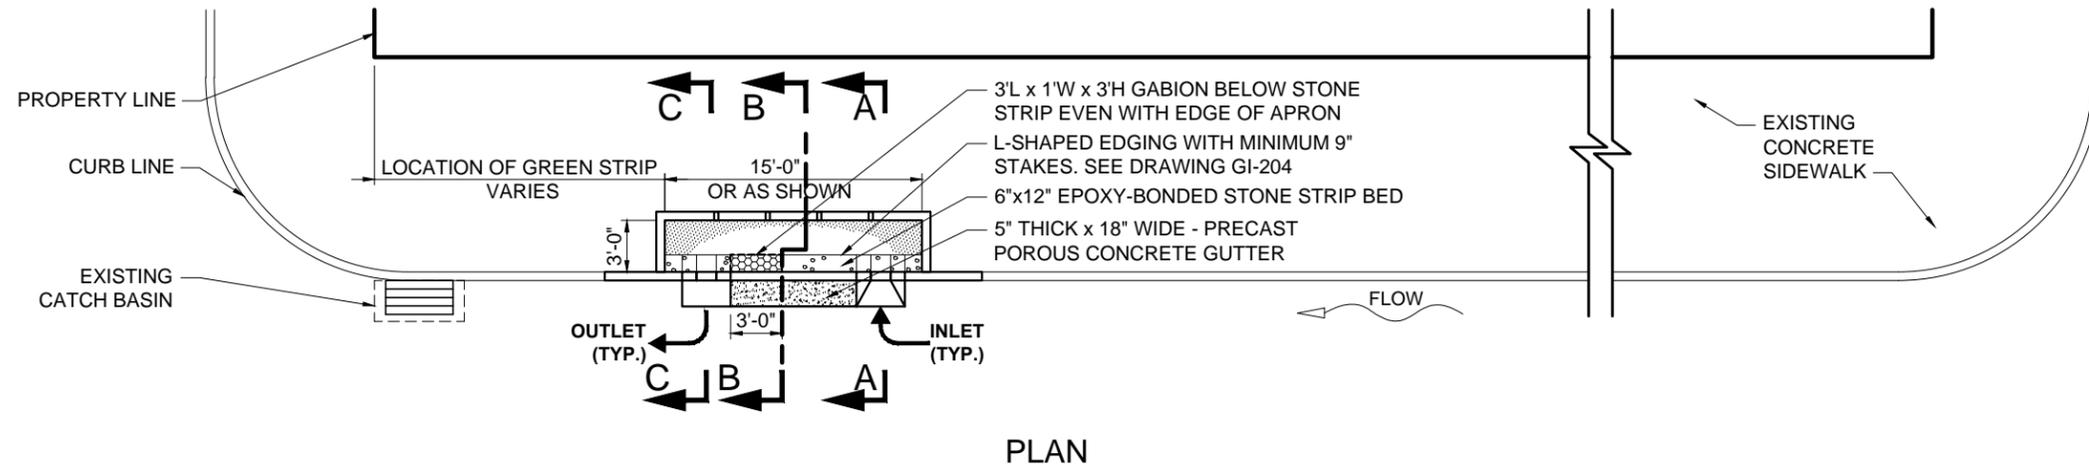

Maedi Tuna
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 15'x3' R.O.W. GREENSTRIP TYPE 2
- NO CONNECTION TO SEWERS

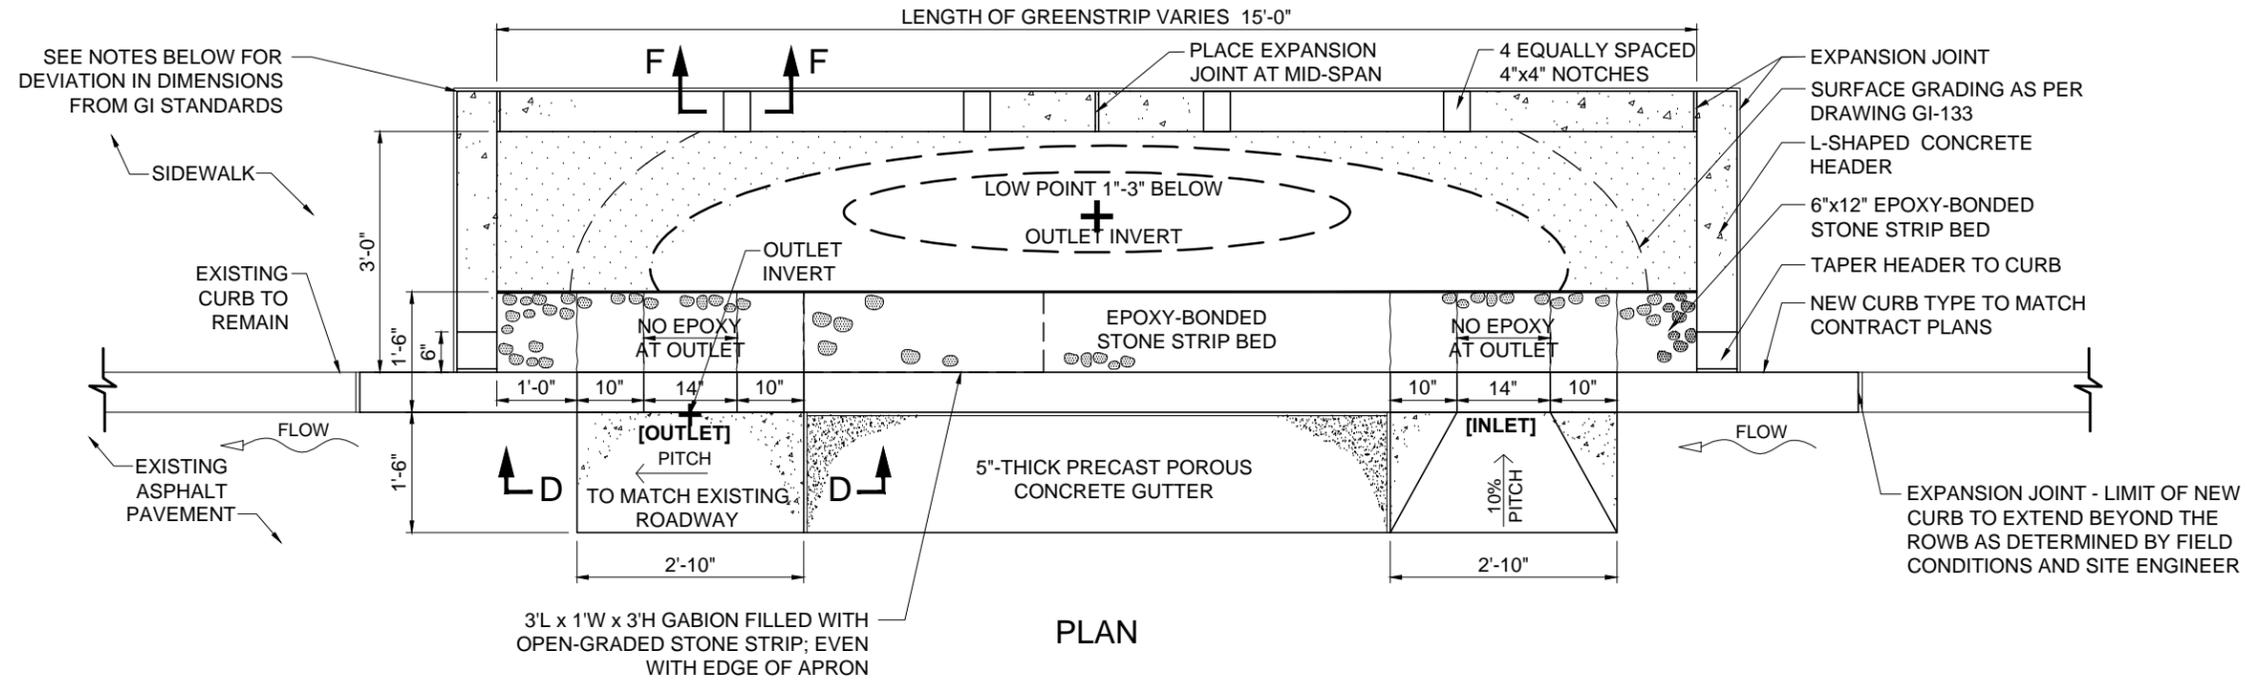


PLAN

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE THE ADJACENT EXISTING SIDEWALK FLAG TO NEAREST SIDEWALK JOINT BEYOND THE LIMITS OF THE BIOSWALE. THE CONTRACTOR SHALL REPLACE THAT SIDEWALK IN KIND IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF STANDARD HIGHWAY SPECIFICATION.
2. THE CONTRACTOR SHALL REMOVE AND RESTORE ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF THE WEARING COURSE AND ONE-AND-A-HALF (1 1/2) FOOT WIDTH OF ROADWAY CONCRETE PAVEMENT BASE ALONG THE CURB LINE AND ADJACENT TO THE CONCRETE APRONS, WHERE REQUIRED. ALL WORK MUST BE COMPLETED IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD HIGHWAY SPECIFICATIONS.
3. THE CONTRACTOR SHALL OBTAIN THE NECESSARY PLANTING PERMITS FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) AND NYC DEPARTMENT OF TRANSPORTATION (DOT) PRIOR TO THE START OF WORK.
4. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
5. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
6. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING R.O.W. GREEN STRIP
7. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-133 AND SPECIFICATIONS

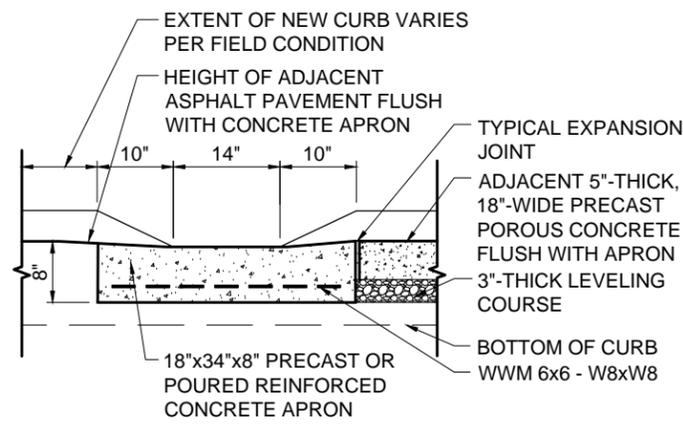

SECTION D-D

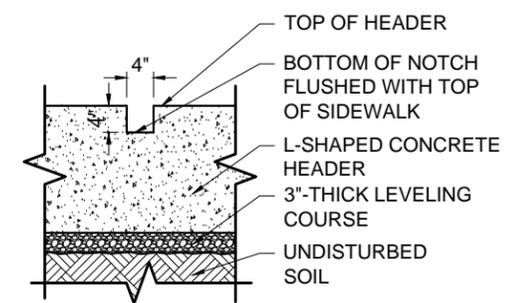


SECTION F-F
TYPICAL NOTCH AT HEADER




Maedi Turaq
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 10'x3' R.O.W. GREENSTRIP TYPE 3
 - NO CONNECTION TO SEWERS

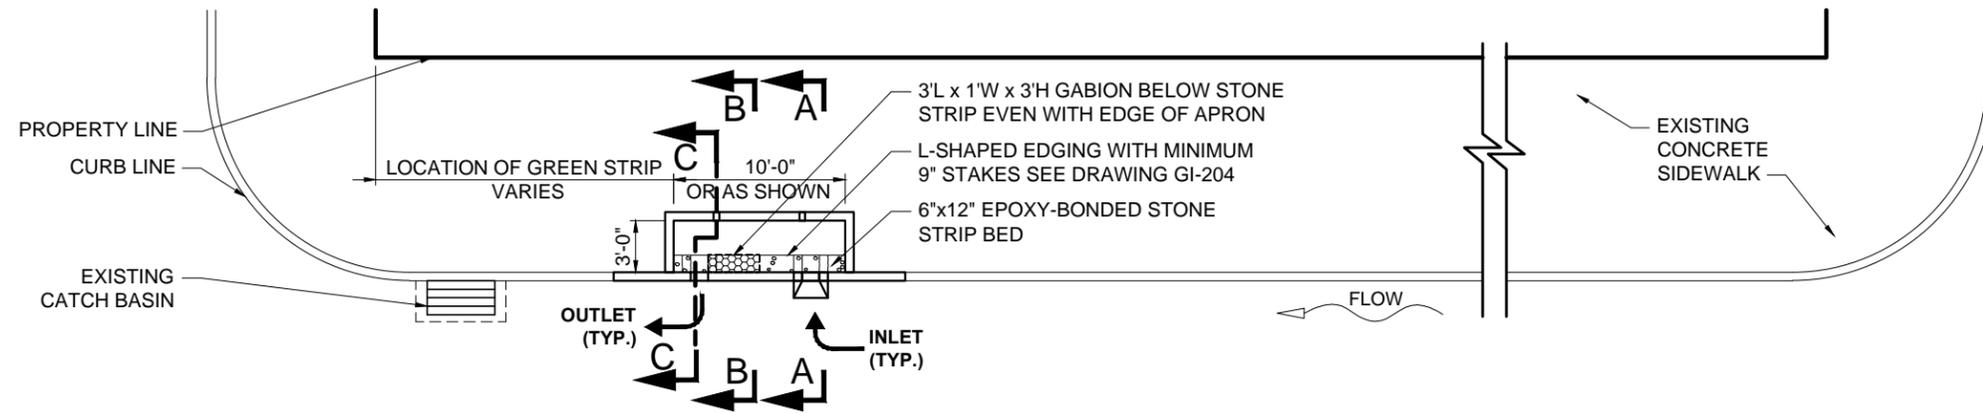





PLAN

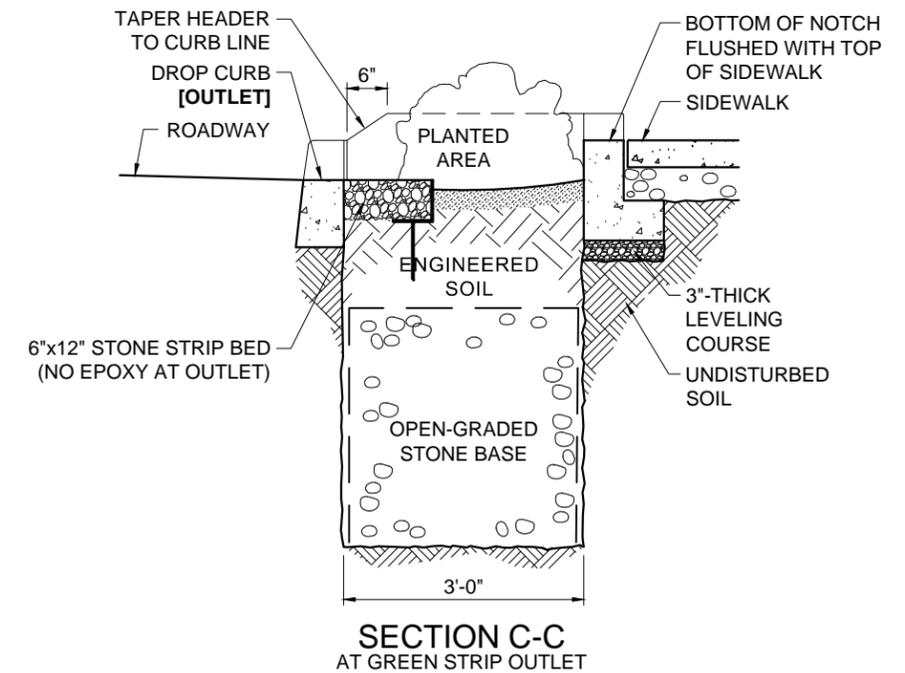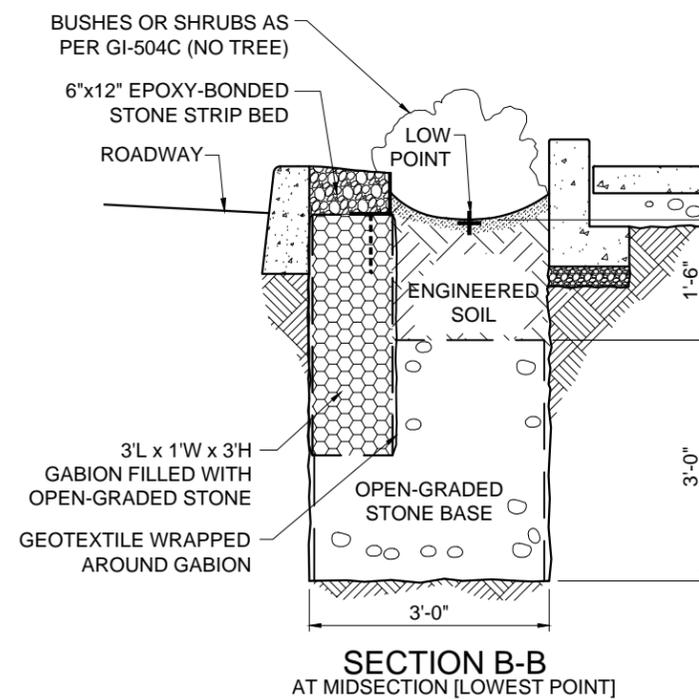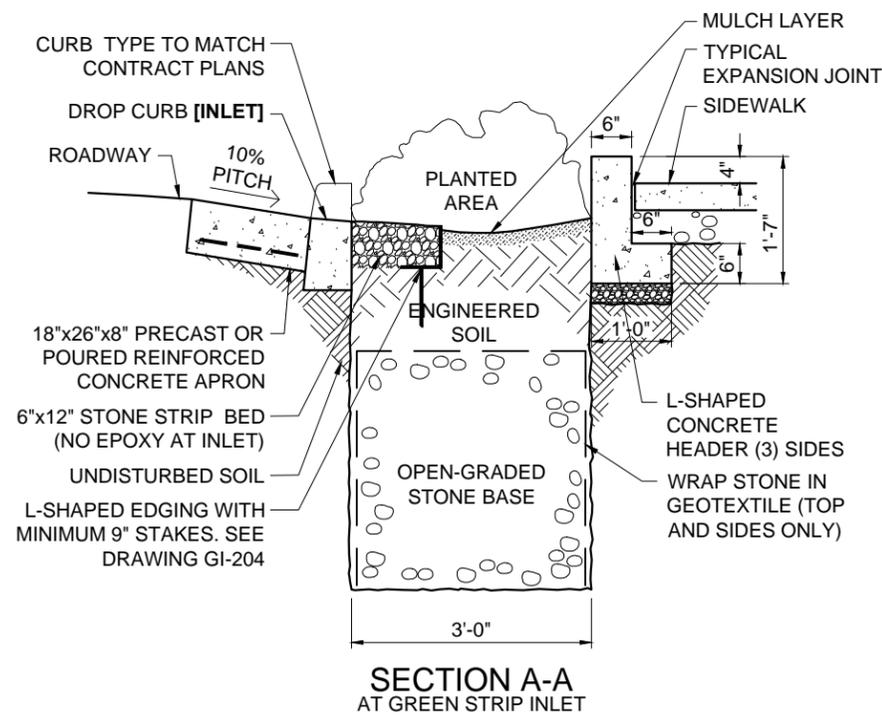

Medi Tuna P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR 10'x3' R.O.W. GREENSTRIP TYPE 3
 - NO CONNECTION TO SEWERS

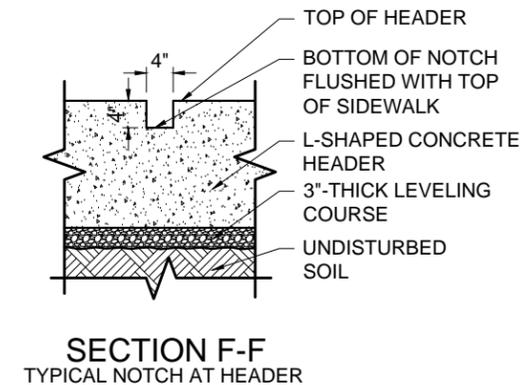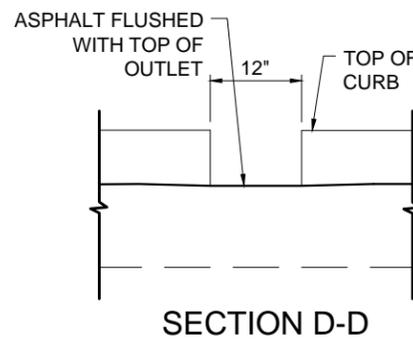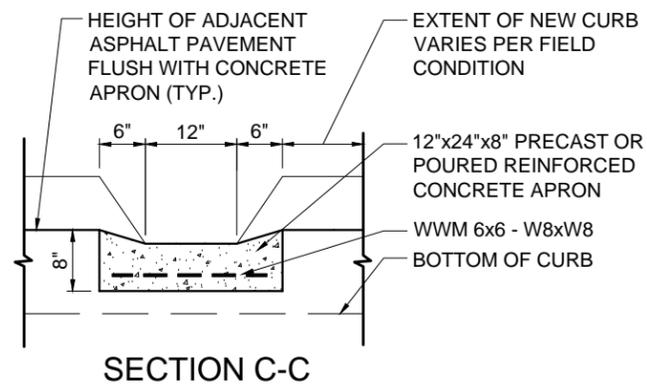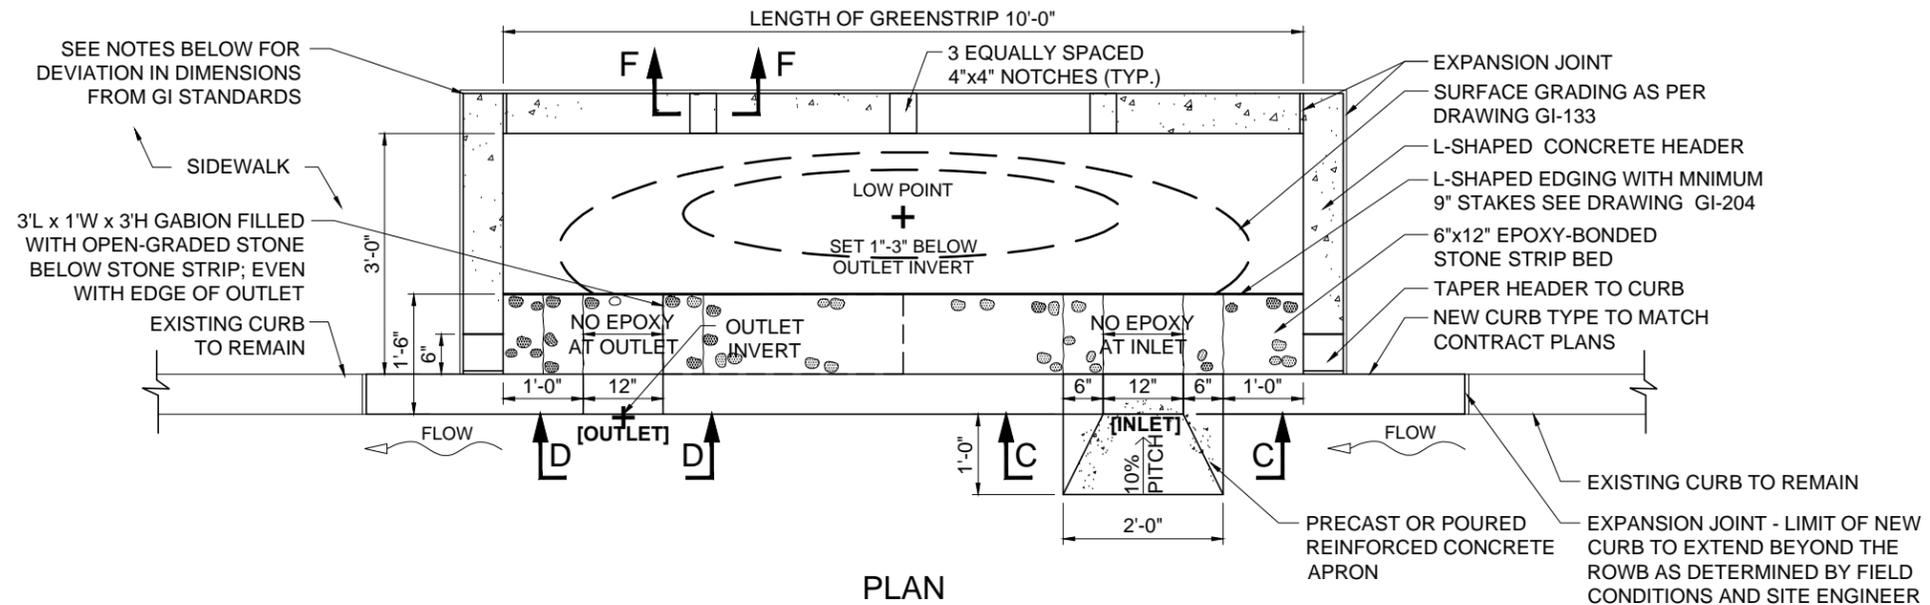

NOTES:

1. THE CONTRACTOR SHALL BE REQUIRED TO REMOVE AND REPLACE THE ADJACENT EXISTING SIDEWALK FLAG TO NEAREST SIDEWALK JOINT BEYOND THE LIMITS OF THE BIOSWALE. THE CONTRACTOR SHALL REPLACE THAT SIDEWALK IN KIND IN FULL COMPLIANCE WITH THE APPLICABLE SECTIONS OF STANDARD HIGHWAY SPECIFICATION.
2. THE CONTRACTOR SHALL OBTAIN THE NECESSARY PLANTING PERMITS FROM THE NYC DEPARTMENT OF PARKS AND RECREATION (DPR) AND NYC DEPARTMENT OF TRANSPORTATION (DOT) PRIOR TO THE START OF WORK.
3. NO TREE SHALL BE REMOVED BY THE CONTRACTOR UNTIL SPECIFICALLY ORDERED IN WRITING TO DO SO BY THE ENGINEER AND WITH APPROVAL FROM DPR.
4. THE CONTRACTOR SHALL NOT BE PERMITTED TO OPERATE AUXILIARY EQUIPMENT WHICH GENERATES EXHAUST OR OTHER HEAT UPWARD (E.G., GENERATORS AND COMPRESSORS), UNDER THE BRANCHES OF TREES WHERE THE BRANCHES ARE LESS THAN 25' ABOVE THE GROUND, UNLESS APPROVED BY THE ENGINEER IN CONSULTATION WITH THE CERTIFIED ARBORIST.
5. THE CONTRACTOR SHALL NOT BE PERMITTED TO STORE, STOCKPILE, OR LAY DOWN, ANY CONSTRUCTION MATERIAL INCLUDING, BUT NOT LIMITED TO, LUMBER, FUEL, AND OIL CONTAINERS, PIPES, AND/OR PIPE FITTINGS, BARRICADES, HAND TOOLS, HOSES, RECEPTACLES, AND ASPHALT WITHIN ANY EXISTING R.O.W. GREEN STRIP
6. FOR R.O.W. GI PRACTICES WITH DIMENSIONS THAT DEVIATE FROM THE GI STANDARDS AS SHOWN ON CONTRACT PLANS DUE TO FIELD CONDITIONS, REFER TO THE DIMENSION SCHEDULE ON GI-133 AND SPECIFICATIONS


Mae di Tuna
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

SURFACE GRADING & DIMENSION SCHEDULE PLANS FOR R.O.W. GREENSTRIPS

- NO CONNECTION TO SEWERS

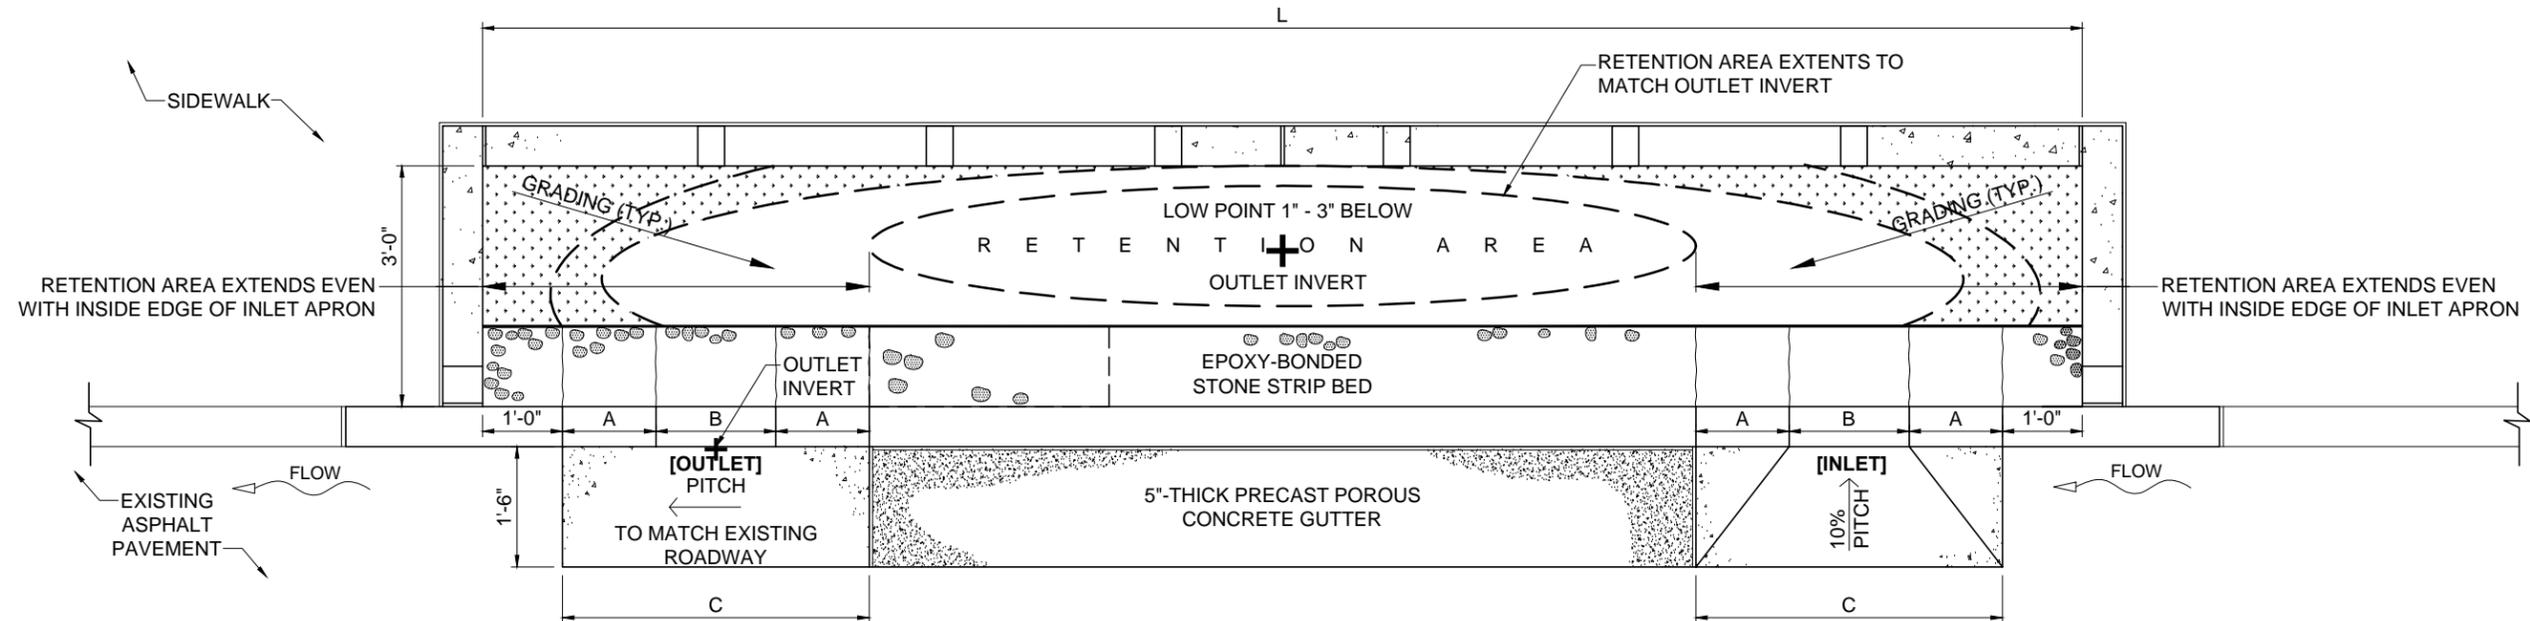

TYPE 1 & TYPE 2 GRADING PLAN

GRADING NOTES:


1. ALL SURFACE GRADING TO TAPER TOWARDS THE LOW POINT.
2. CONTOUR LINES SHOWN ON THIS DRAWING ARE SCHEMATIC ONLY AND DEPEND ON THE STREET GRADE.

R.O.W. GREEN STRIP		INLET/OUTLET DIMENSIONS			PLANTING PLAN
LENGTH (L), 1FT. INCREMENT	TYPE	A	B	C	TYPE / PAGE NUMBER
$17' \leq L \leq 20'$	TYPE 1	14"	18"	3'-10"	GI-504A & B
$13' \leq L \leq 16'$	TYPE 2	10"	14"	2'-10"	GI-504A & B
$10' \leq L \leq 12'$	TYPE 3	6" *	12"	6" *	504C

DIMENSION AND PLANTING PLAN SCHEDULE

DIMENSION AND PLANTING NOTES:

1. STANDARD CROSS-SECTIONAL DETAILS AND NOTES AS PER THE R.O.W. GREENSTRIP TYPE SPECIFIED.
2. PRIOR TO CONSTRUCTION, THE CONTRACTOR WILL CONFIRM THE LEVELS OF THE R.O.W. GREEN STRIP TO PREVENT FLOODING.
3. * INLET DIMENSIONS ONLY

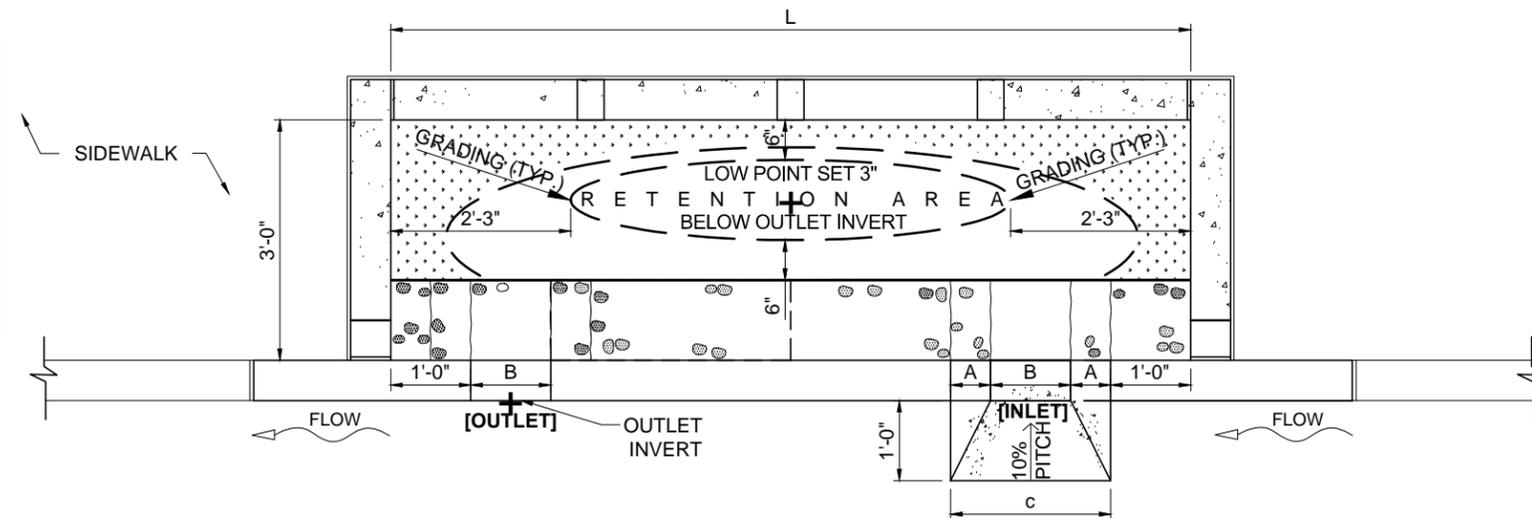

TYPE 3 GRADING PLAN


Maedi Turaq
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. PRECAST CONCRETE PANEL POROUS PAVEMENT


- NO CONNECTION TO SEWERS

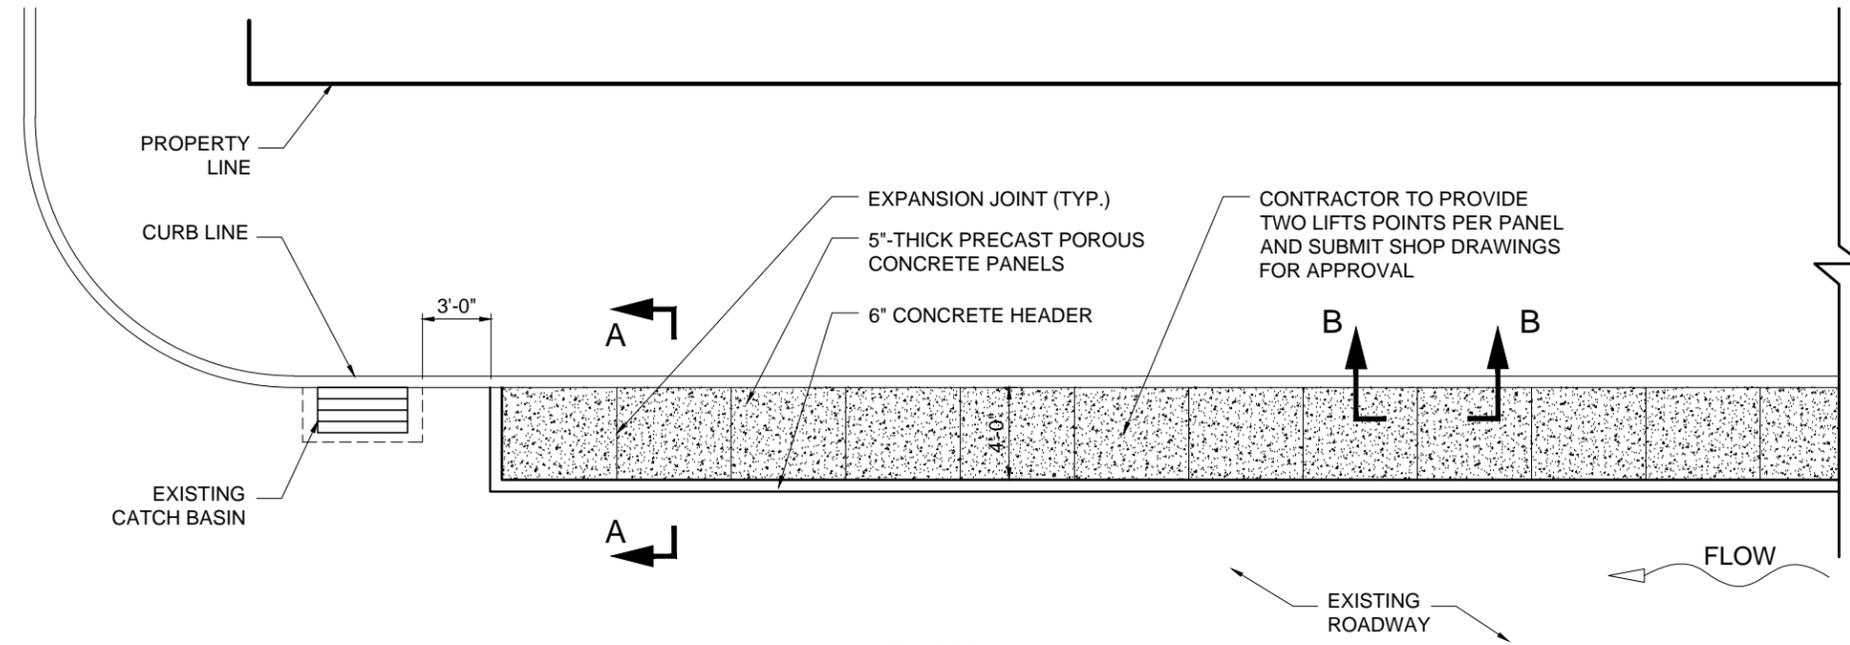


PLAN

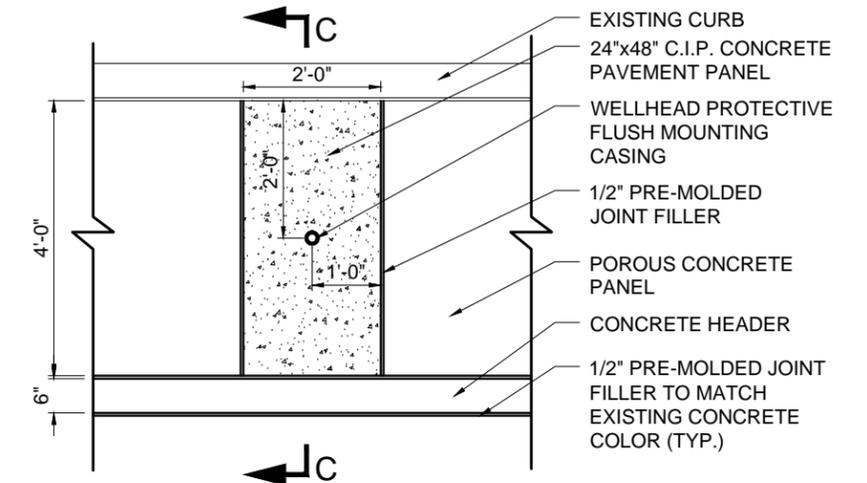


TYPICAL CAST IN PLACE CONCRETE AT PIEZOMETER PART PLAN

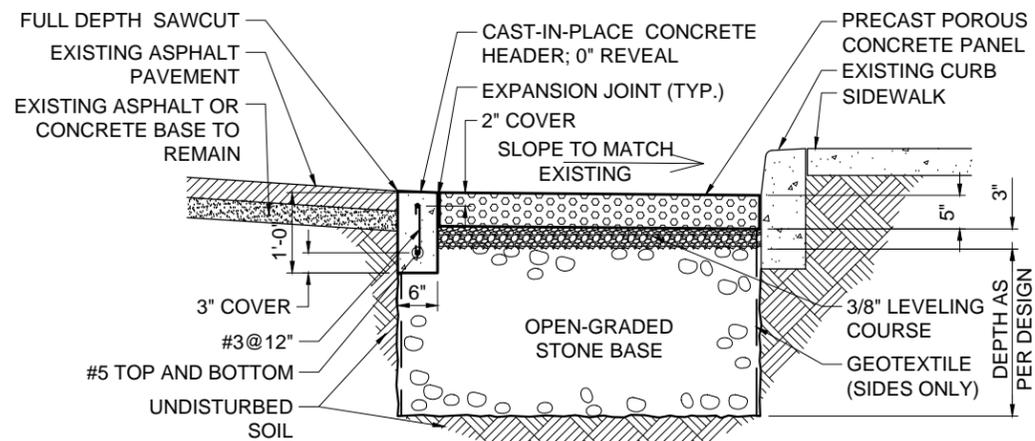

SECTION A-A

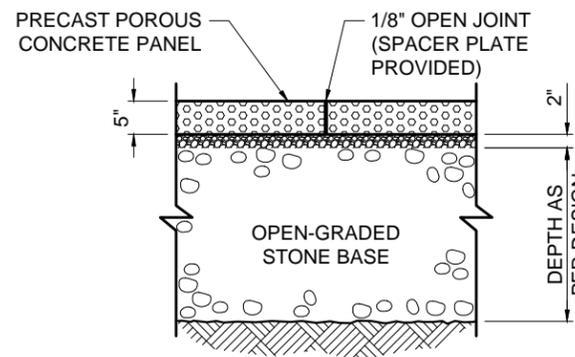

SECTION B-B

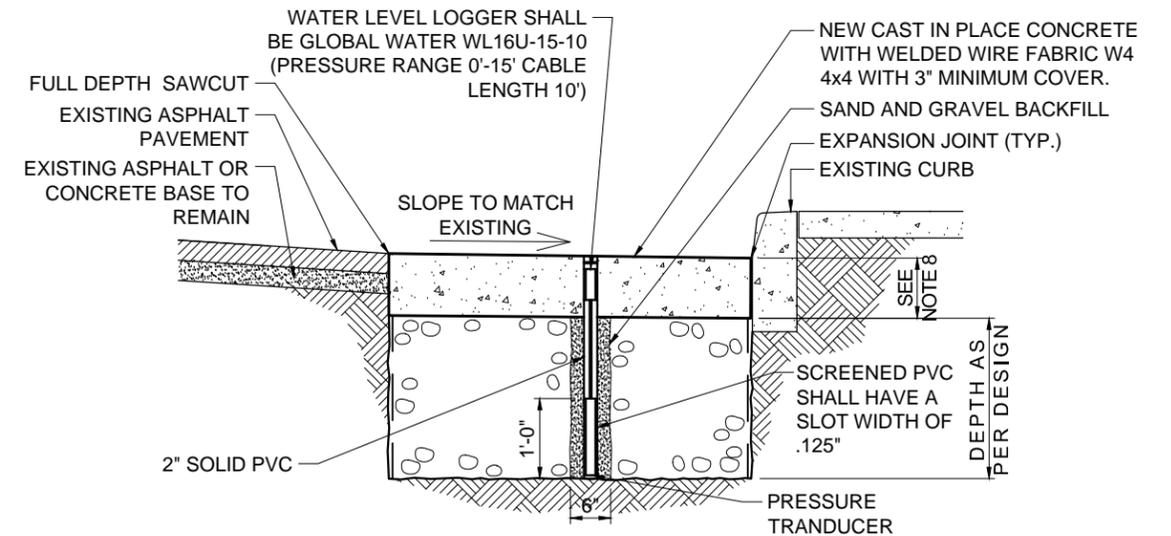

TYPICAL CAST IN PLACE CONCRETE AT PIEZOMETER SECTION C-C

- NOTES:
1. MAXIMUM JOINT SPACE IS 1"
 2. CONTRACTOR SHALL TRIM (VIA SAWCUT) POROUS CONCRETE PANELS TO NO MORE THAN 6" ON ANY END
 3. NO POROUS CONCRETE PANEL SHALL BE LESS THAN 4FT IN LENGTH WITHOUT THE ENGINEER'S APPROVAL
 4. ADJUST THE LIMIT OF WORK TO AVOID END PANELS LESS THAN 4' IN LENGTH
 5. CONTRACTOR SHALL INSTALL 3/4" STONE IN LIFTS OF 12" (MAX.) AND SHALL MAKE TWO PASSES OF A PLATE COMPACTOR (200 LBS MIN.) OVER EACH LIFT PRIOR TO INSTALLATION OF 3/8" LEVELING COURSE
 6. AT THE DIRECTION OF THE ENGINEER, CONTRACTOR TO REPLACE ANY CURB OR DRIVEWAY APRON THAT IS DAMAGED DURING CONSTRUCTION AS PER NYCDOT STANDARDS.
 7. SEAL EDGES OF ANY SAWCUTS IN THE WEARING COURSE WITH LIQUID ASPHALT CEMENT AS PER TITLE 34 NYCDOT HIGHWAY RULES (PAGE 71, SECTION 2-11(E)(VIII))
 8. CAST IN PLACE CONCRETE TO BE INSTALLED TO A DEPTH OF 9" IF THE EXISTING PAVEMENT BASE IS ASPHALT AND TO A DEPTH OF 12" IF THE EXISTING BASE IS CONCRETE


Maedi Tuna
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE


**GI-200
MISCELLANEOUS DETAILS FOR
RIGHT-OF-WAY GREEN INFRASTRUCTURE
PRACTICES**

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD FOR R.O.W. BIOSWALE INLET WITH SEDIMENT PAD

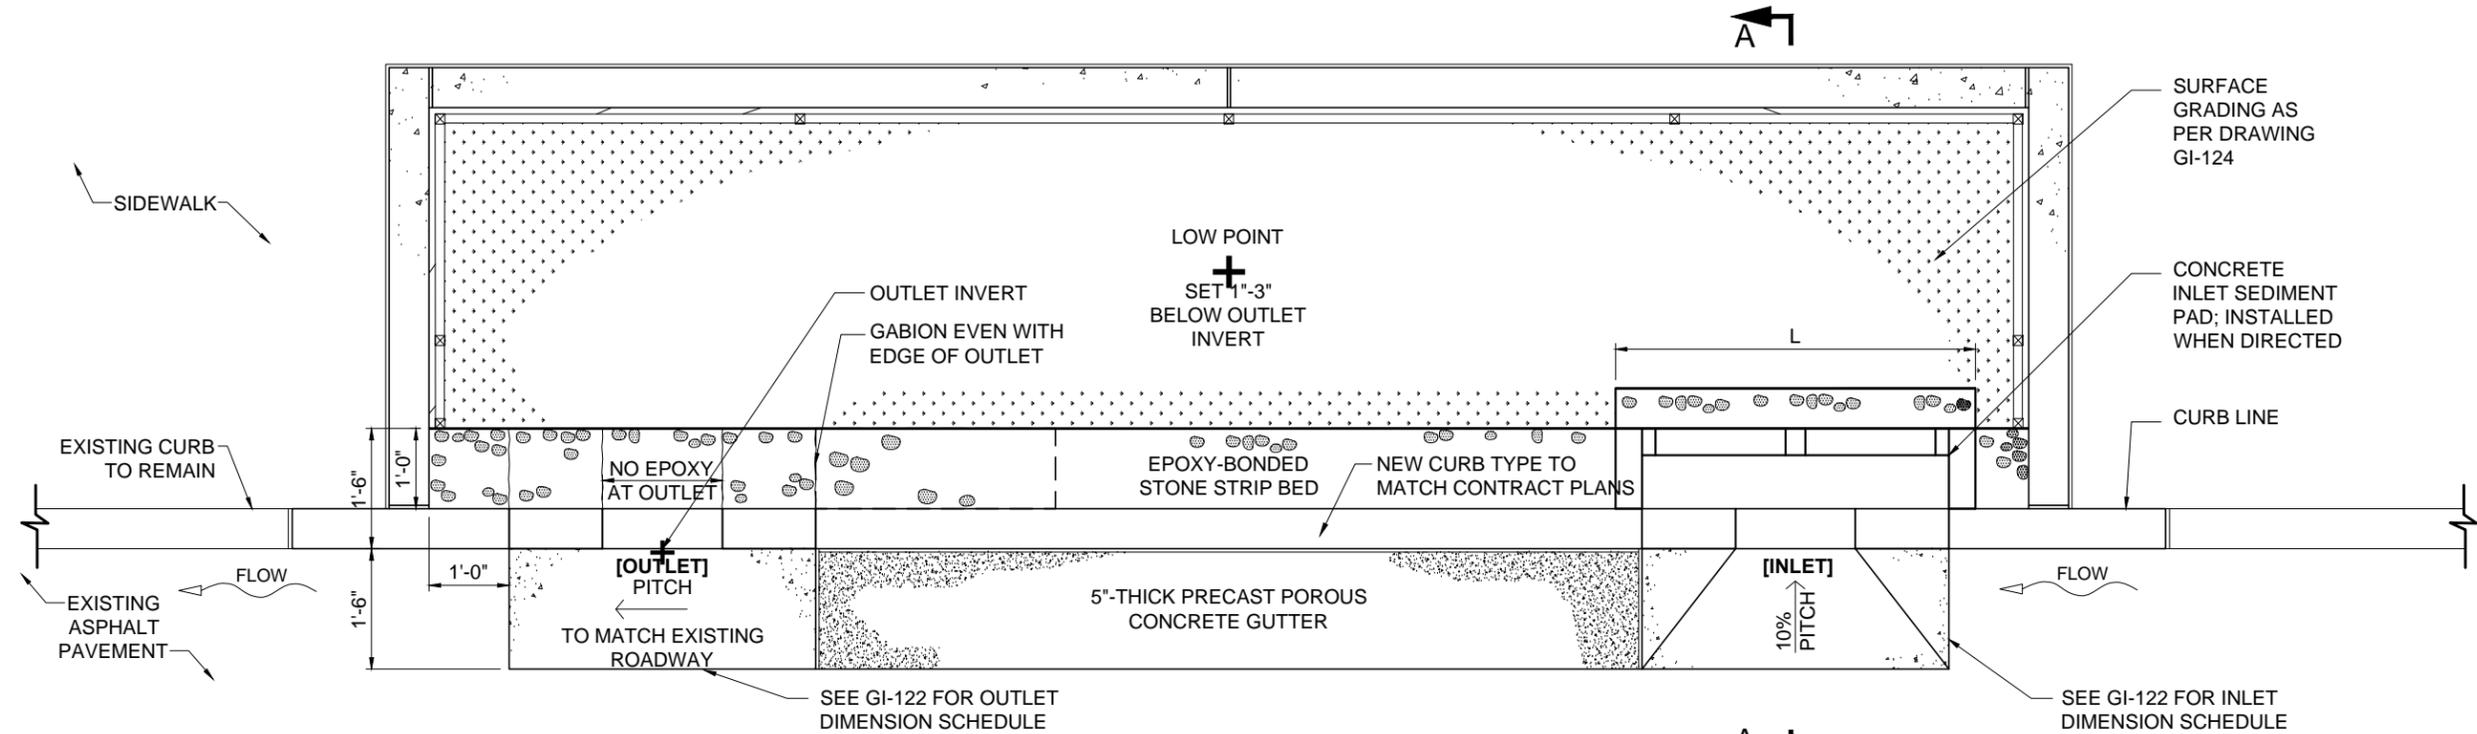

PLAN

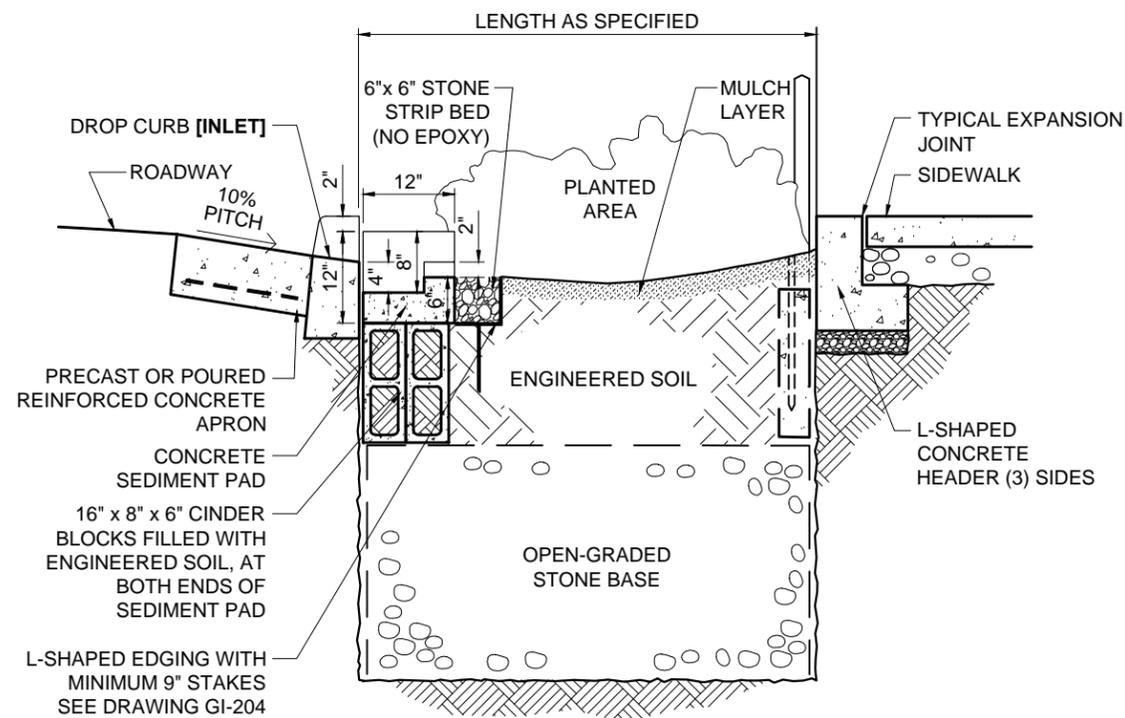

SECTION A-A
AT BIOSWALE INLET




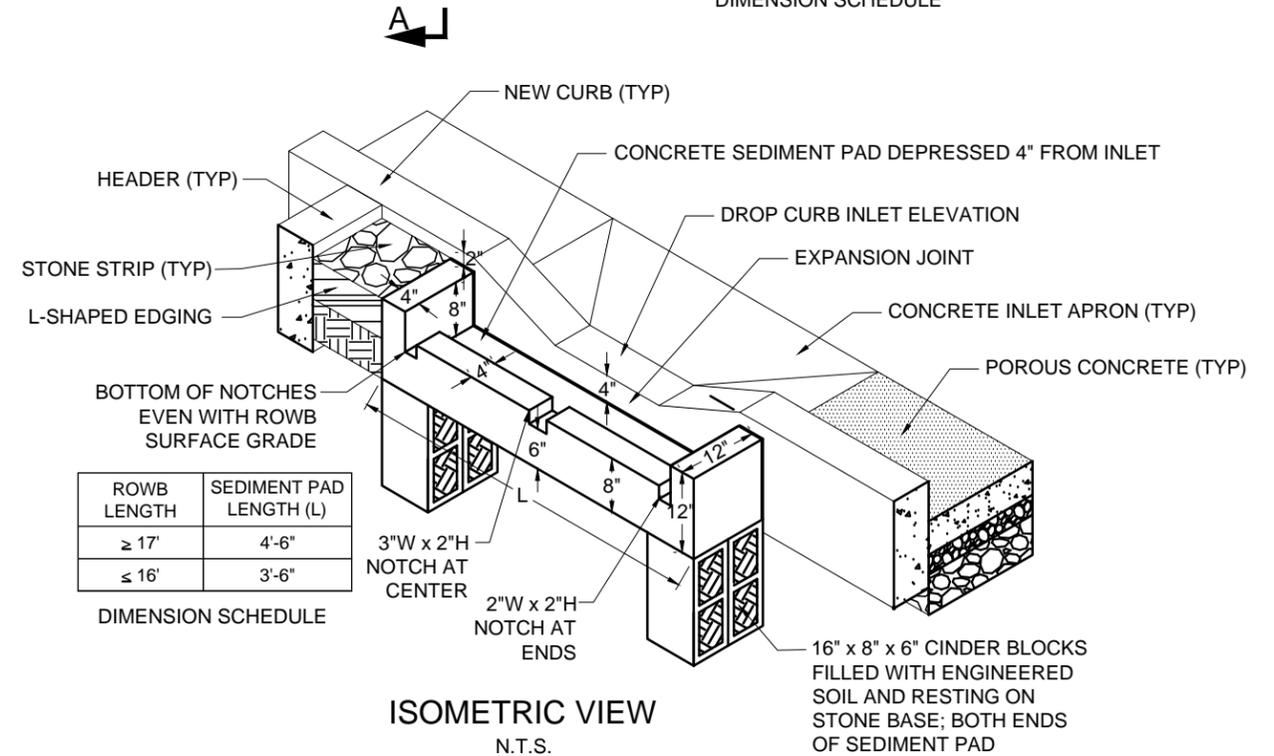


ISOMETRIC VIEW
N.T.S.

Maedi Taha
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR STORMWATER INLET
 FOR R.O.W. BIOSWALE TYPE 1B AND TYPE 2B - NO CONNECTION TO SEWERS

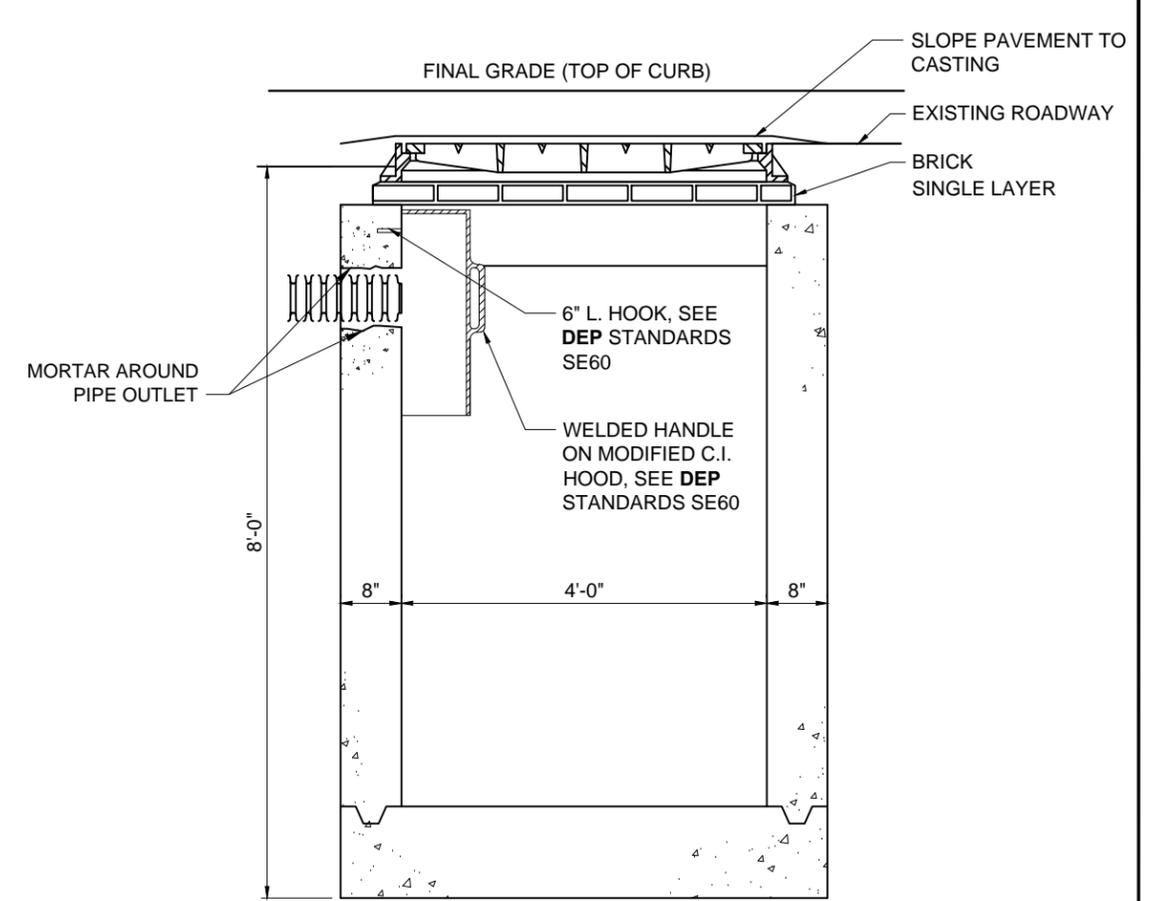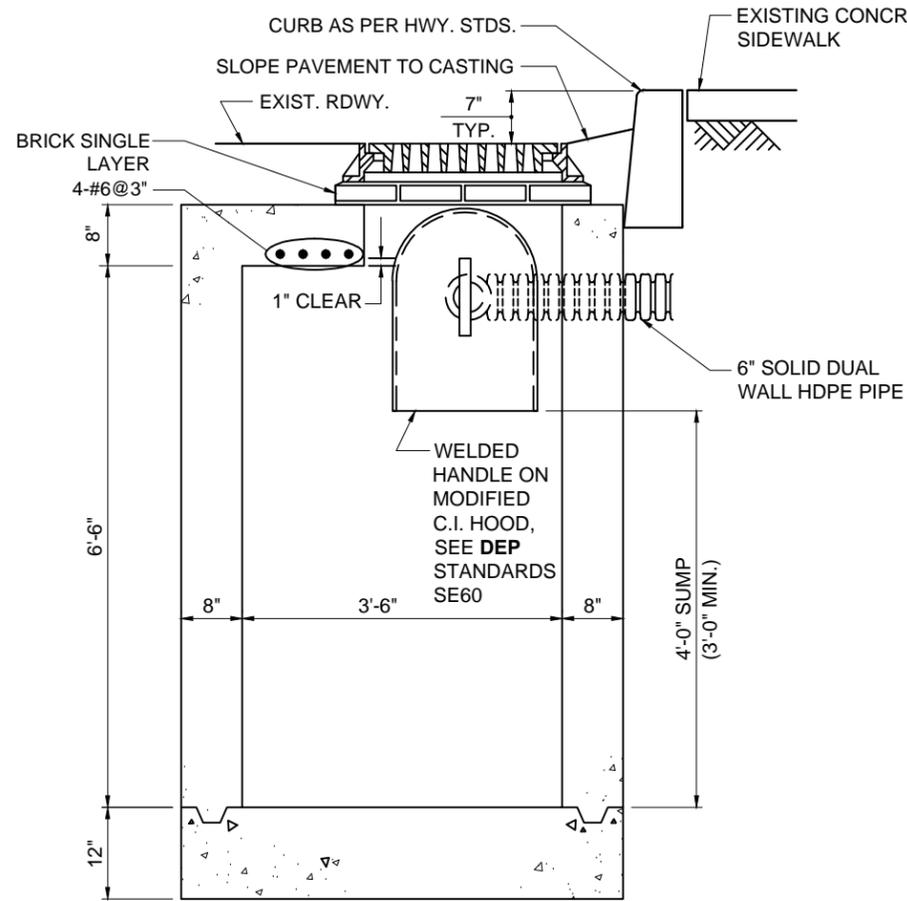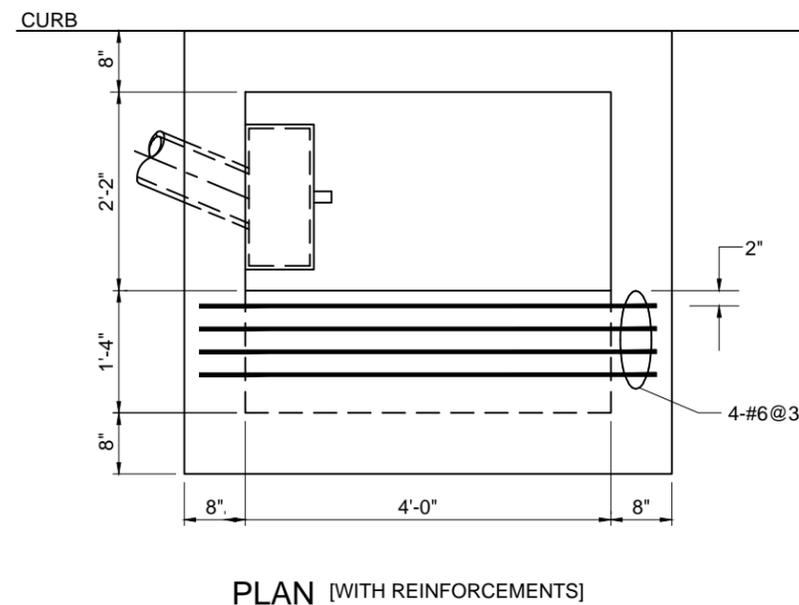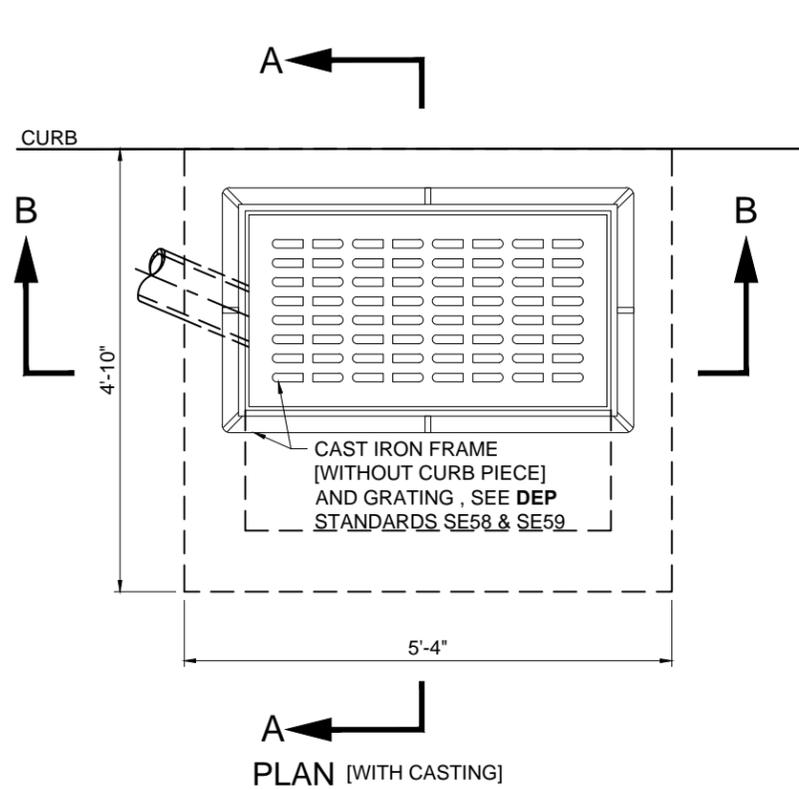


NOTES:

- (1) LOCATION OF CURB SHALL BE AS SHOWN UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
- (2) LOCATION AND ANGLE OF 6" PVC OUTLET PIPE MAY BE VARIED TO SUIT FIELD CONDITIONS.
- (3) KEYED CONSTRUCTION JOINTS ARE REQUIRED BETWEEN ANY SUCCESSIVE POURS.
- (4) CONCRETE IS TO BE CLASS 40. REBARS-GRADE 60.


Maedi Taha
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD FOR PRECAST STORMWATER INLET
 FOR R.O.W. BIOSWALE TYPE 1B AND 2B - NO CONNECTION TO SEWERS

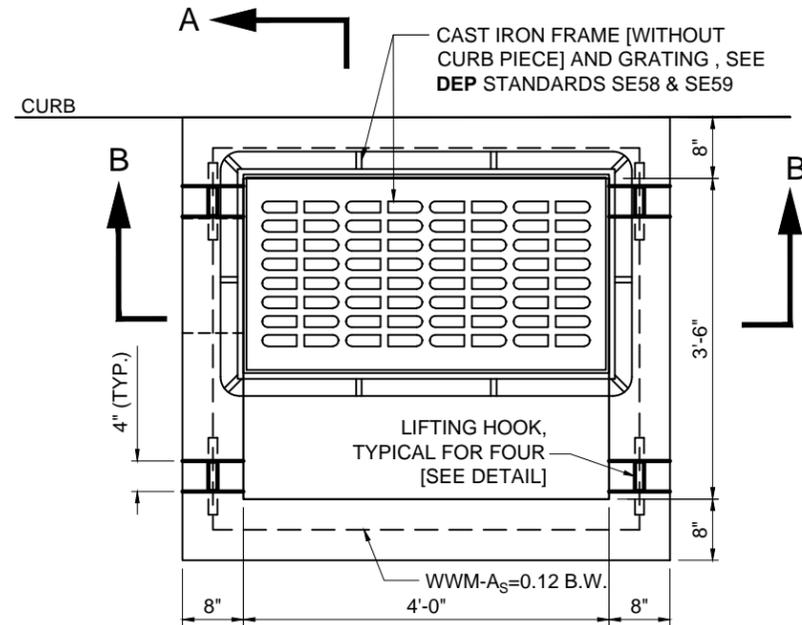




PLAN

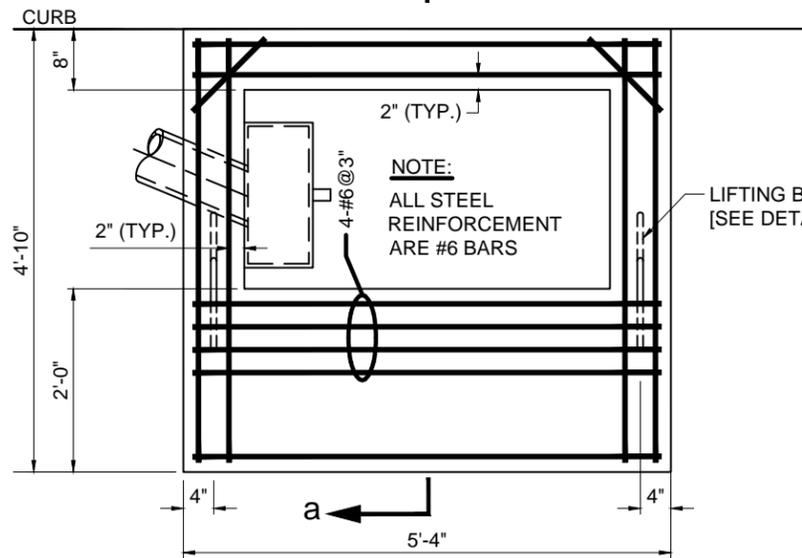


REINFORCEMENT PLAN
[REMOVABLE PRECAST TYPE 2 SLAB]

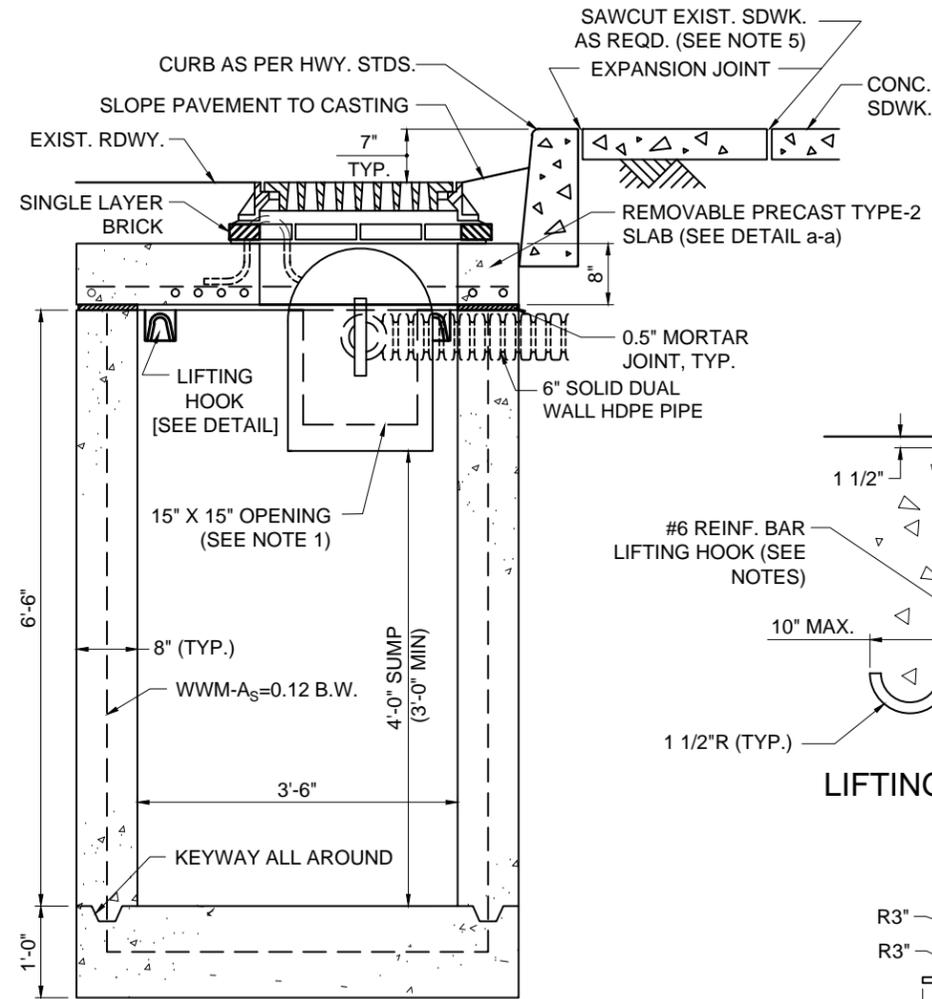

SECTION A-A

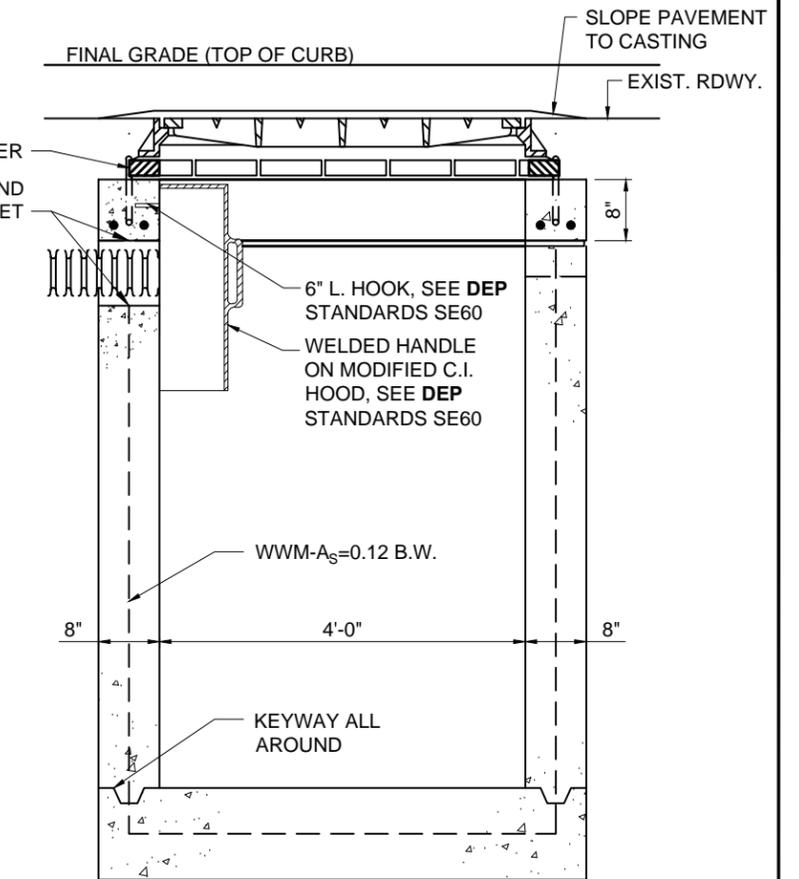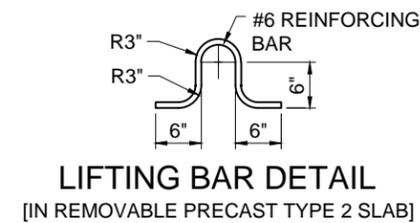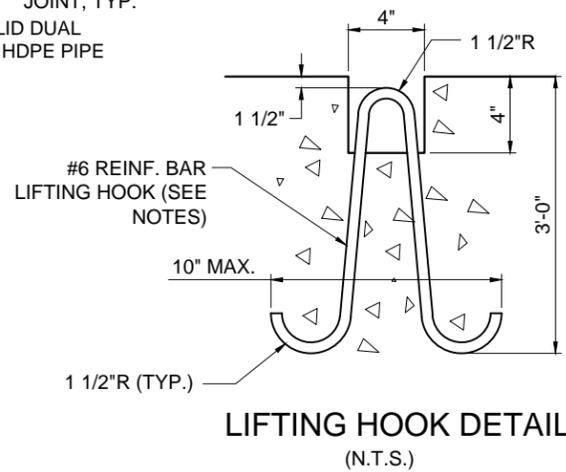

SECTION B-B

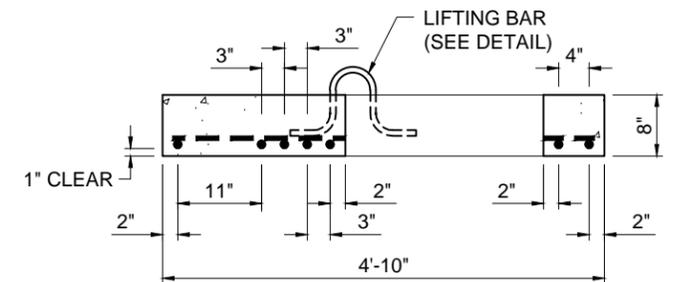

DETAIL a-a

NOTES:

1. LOCATION OF OPENING SHALL BE DETERMINED PRIOR TO THE MANUFACTURING OF BASIN BY FIELD MEASUREMENTS.
2. LOCATION OF CURB SHALL BE AS SHOWN UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
3. LOCATION AND ANGLE OF 6" PVC OUTLET PIPE MAY BE VARIED TO SUIT FIELD CONDITIONS.
4. LIFTING HOOKS SHALL BE LOCATED IN THE SECTION AS PER MANUFACTURERS RECOMMENDATIONS AND GROUTED PRIOR TO BACKFILLING. (FOUR (4) LIFTING HOOKS SHALL BE PROVIDED FOR EACH SECTION AND SHALL BE PLACED SYMMETRICALLY AND IN SUCH A MANNER AS TO PROVIDE FOR THE EVEN LIFTING OF THE SECTION.)
5. LIFTING BAR TO BE CUT FLUSH TO SURFACE AFTER PLACEMENT OF PRECAST TYPE 2 SLAB.
6. CONCRETE IS TO BE CLASS 40 AND 5% AIR ENTRAINED. REBARS-GRADE 60. WWM-F_s = 65,000 PSI.
7. MODIFY STANDARD CAST IRON HOOD AND HOOKS [SE60] AS PER DRAWING

Maedi Tava


P.E., F. ASCE

03-07-2016


ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD R.O.W. BIOSWALE DETAILS

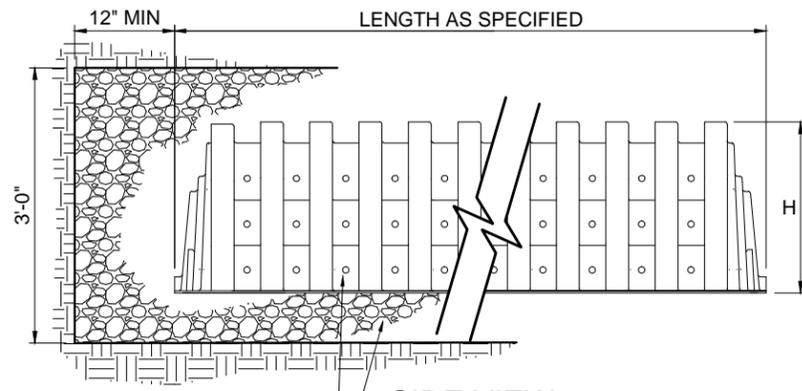

SIDE VIEW
 BOTH ENDS OF STORMWATER CHAMBER TO BE SEALED WITH END CAPS
 5" MINIMUM STONE BEDDING

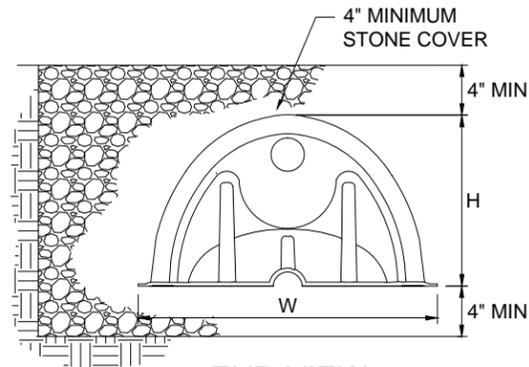


END VIEW


ROWB WIDTH	W	H
≥ 5'	47"	26.5"
≤ 4'-6"	36"	20.5"

DIMENSION SCHEDULE

STORMWATER CHAMBER
 N.T.S.

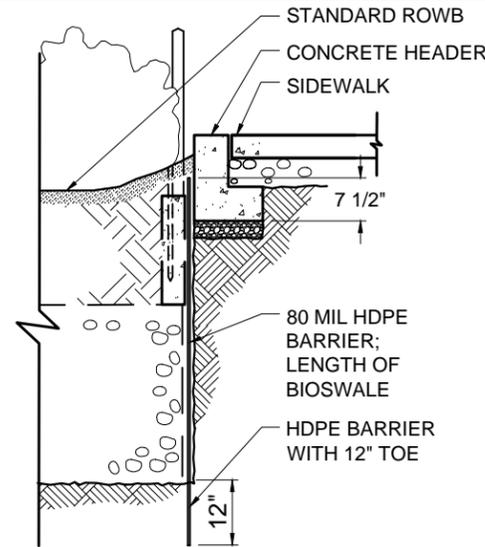


CROSS-SECTION AT MIDSECTION [LOWEST POINT] HDPE BARRIER DETAILS
 AGAINST SIDEWALK (ONLY IF DIRECTED)
 N.T.S.

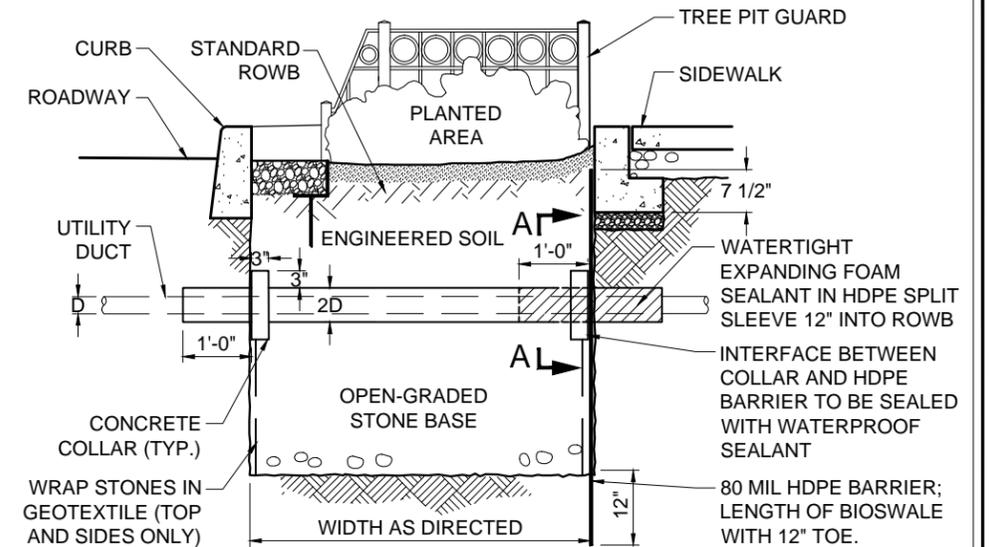


CROSS-SECTION


NOTE:
 ANY SEAMS IN THE HDPE BARRIER MUST HAVE A 1'-0" OVERLAP AND BE SEALED WITH WATERTIGHT SEALANT

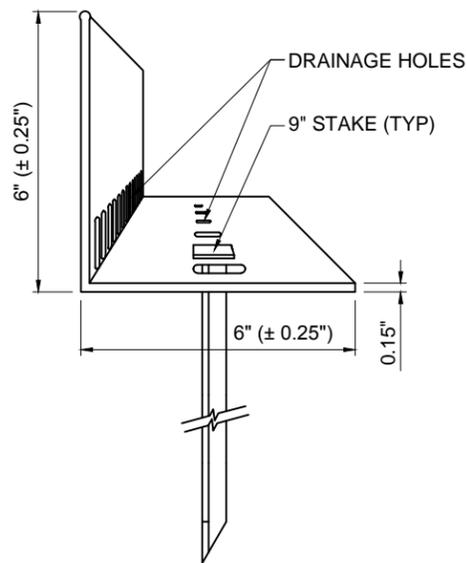

L-SHAPED EDGING
 N.T.S.

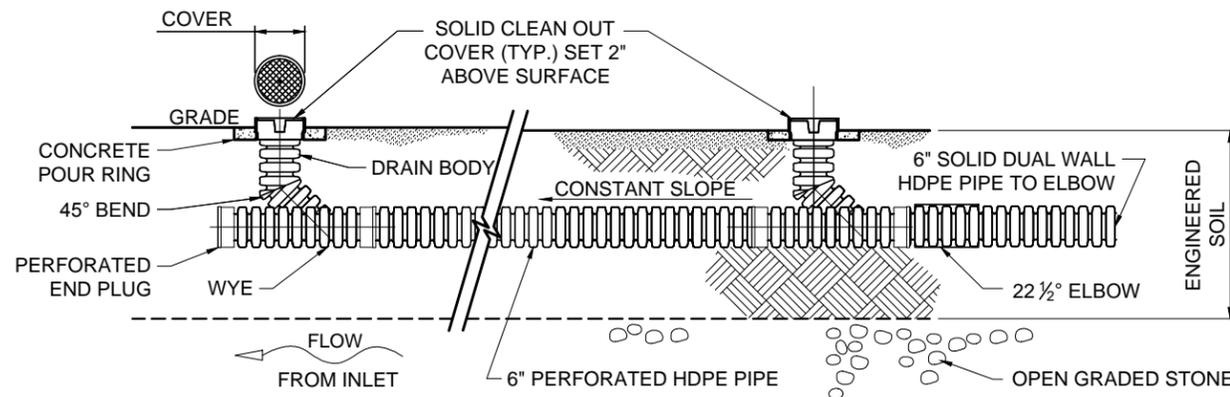

CLEAN-OUT DETAIL - HDPE PIPE
 N.T.S.

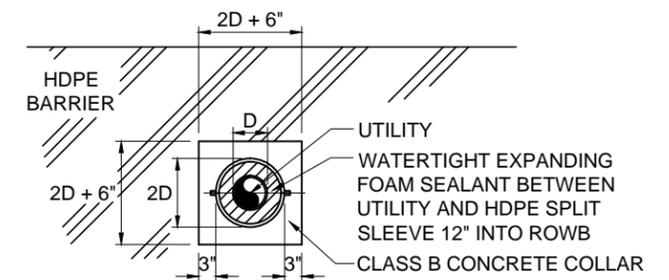


CROSS SECTION A-A

UTILITY CROSSING DETAIL
 N.T.S.


Maedi Taha
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE
STANDARD DETAILS FOR R.O.W. STORMWATER INFILTRATION BASIN
 CIRCULAR REINFORCED CONCRETE SLAB AND FOOTING

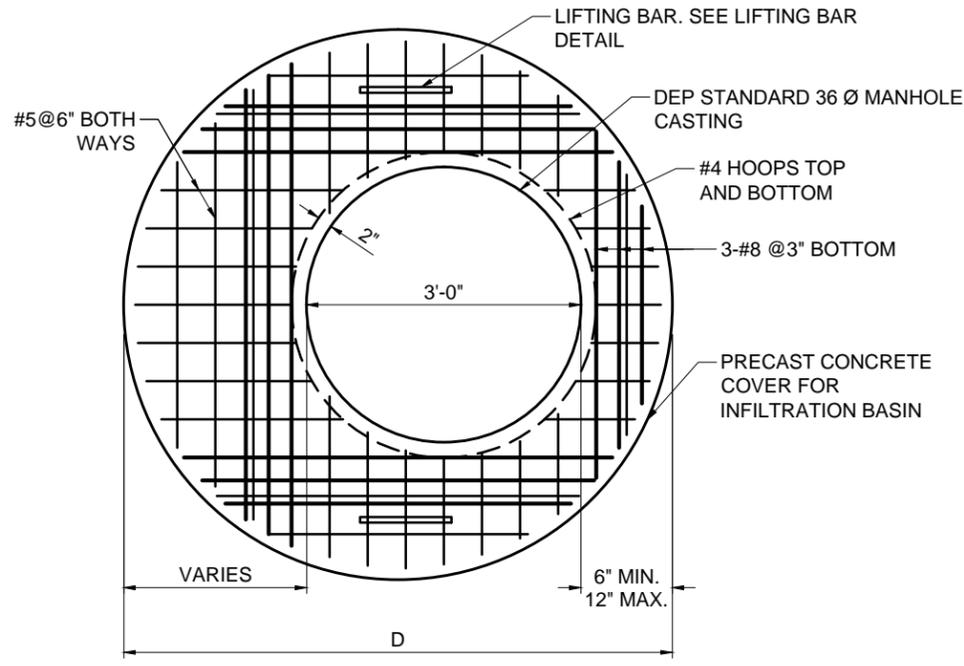

PLAN OF CIRCULAR SLAB

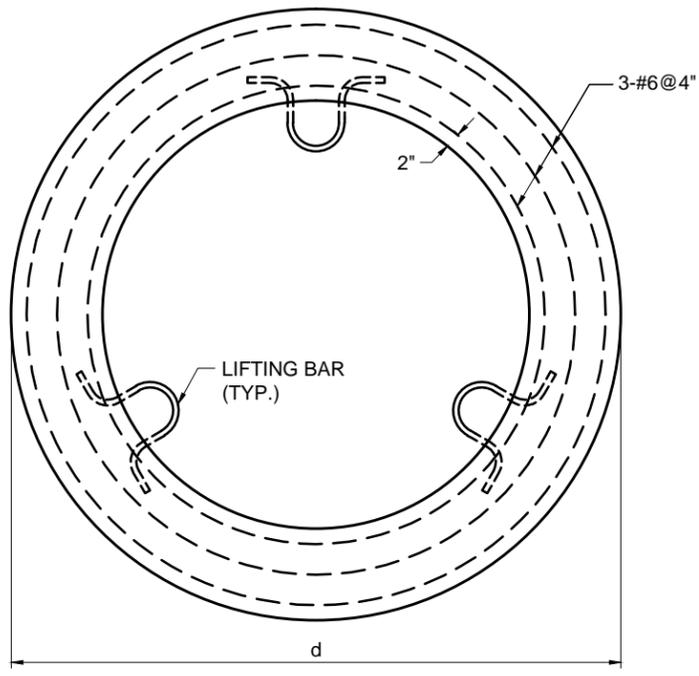


PLAN OF PRECAST CIRCULAR FOOTING RING

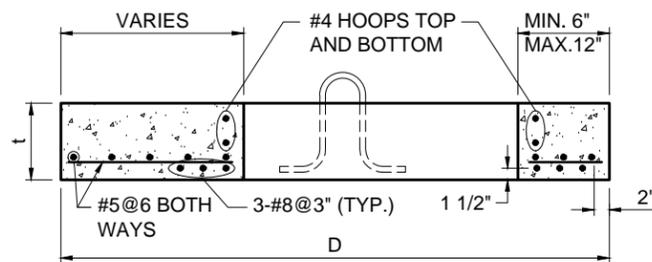

SECTION IN CIRCULAR SLAB
 DETAIL A



SECTION IN PRECAST CIRCULAR FOOTING RING
 DETAIL B

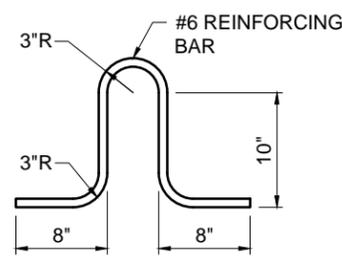

LIFTING BAR DETAIL

PRECAST INFILTRATION BASIN SCHEDULE				
PRECAST RING TYPE	HEIGHT	VOLUME, CF	VOLUME, GAL	tw, IN
D = 4'- 0" O.D.				
SOLID	2'-0"	17.4	130	4"
PERFORATED*	3'-0"	26.2	195	4"
D = 6'- 0" O.D.				
SOLID	2'-0"	45.0	337	4"
PERFORATED*	3'-0"	67.0	496	4"
D = 8'- 0" O.D.				
SOLID	2'-0"	84.4	631	4"
PERFORATED*	3'-0"	126.7	947	4"

* REFER TO THE MANUFACTURER'S SPECIFICATIONS FOR OPENING DETAILS

PRECAST INFILTRATION BASIN SCHEDULE

PRECAST CIRCULAR SLAB (FT)	PRECAST CIRCULAR FOOTING RING (FT)	THICKNESS (IN)
<u>D</u>	<u>d</u>	<u>t</u>
4'-0"	4'-8"	10"
6'-0"	6'-8"	10"
8'-0"	8'-8"	10"

NOTE: IN NO CASE SHALL "d" BE LESS THAN THE OUTSIDE DIAMETER OF THE INFILTRATION BASIN

CIRCULAR SLAB AND FOOTING SCHEDULE

Maedi Tuma
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
 DATE

GI-300
STORMWATER GREENSTREETS
SUGGESTED LAYOUT GUIDELINES FOR
RIGHT-OF-WAY GREEN INFRASTRUCTURE
PRACTICES


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1 LAYOUT GUIDELINES

- NO CONNECTION TO SEWERS

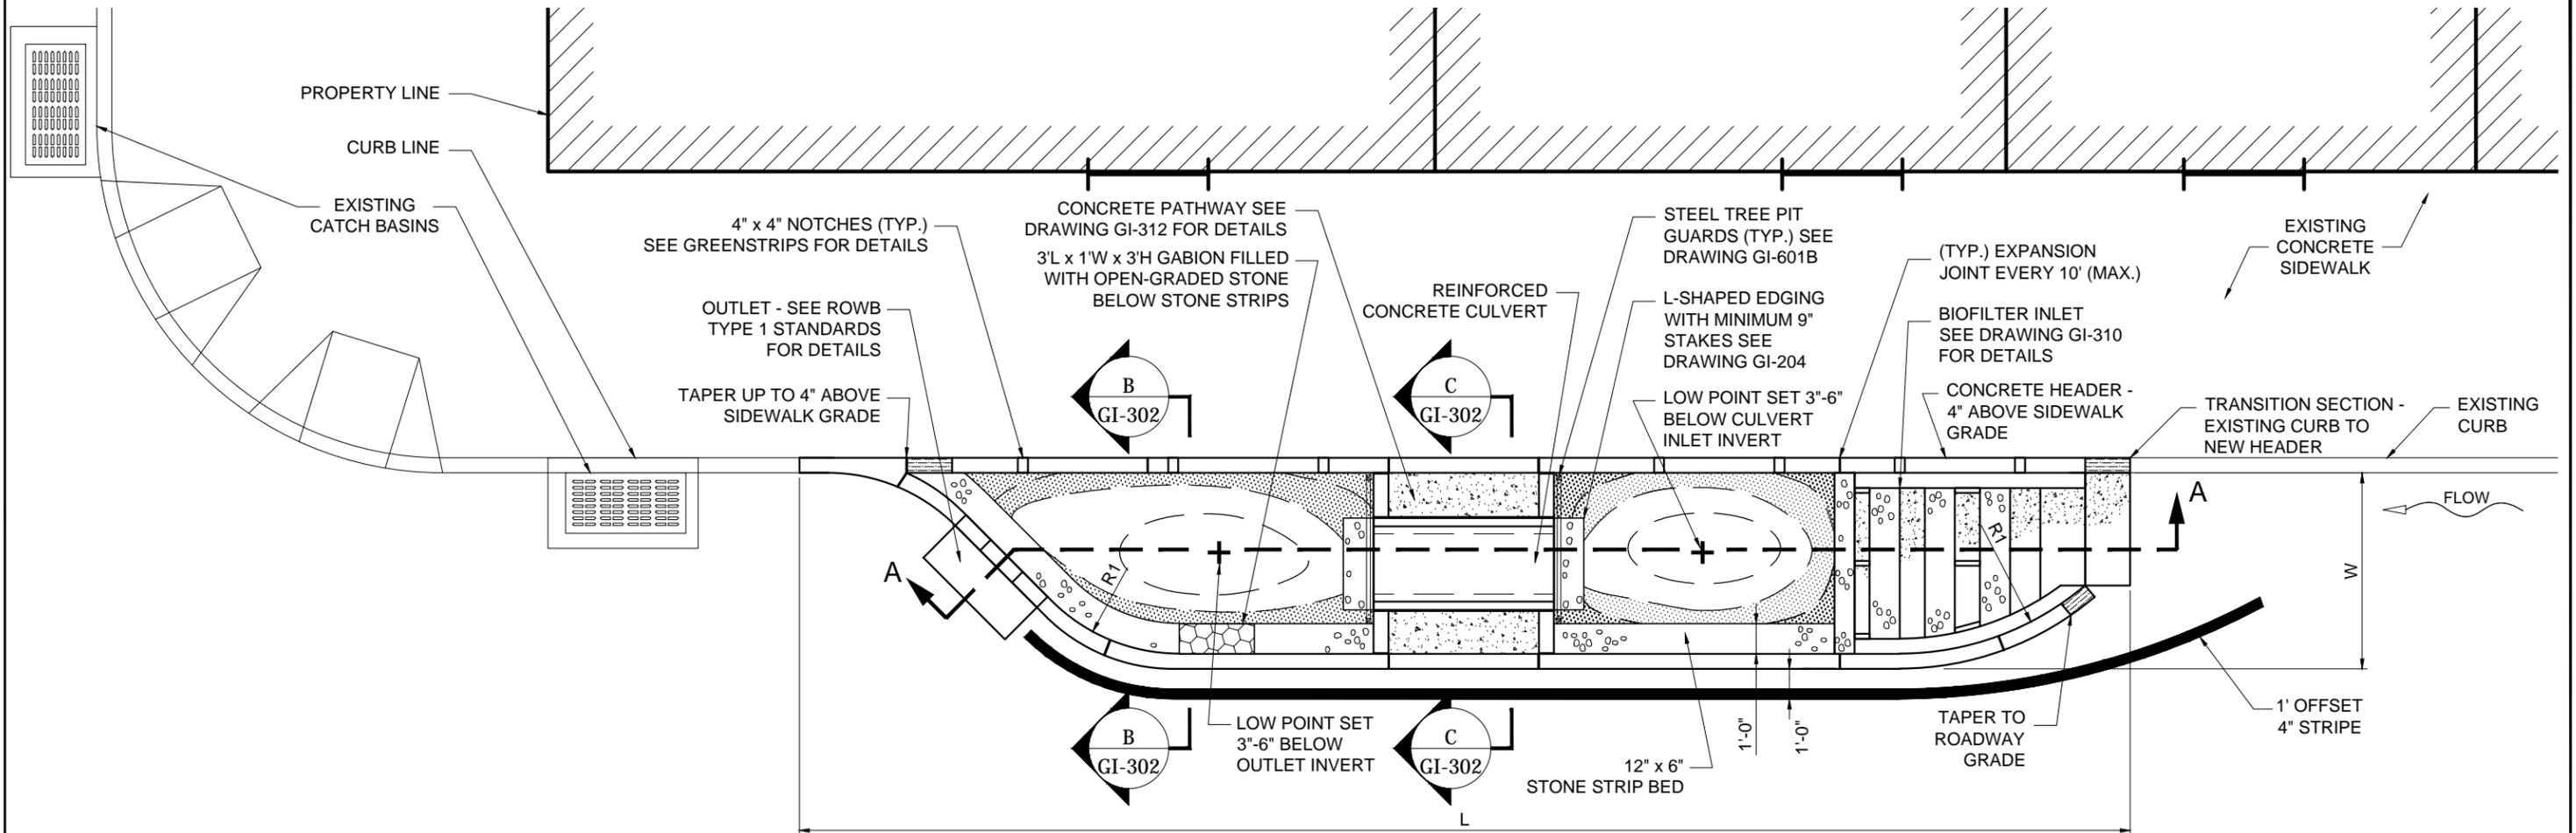

GRADING PLAN

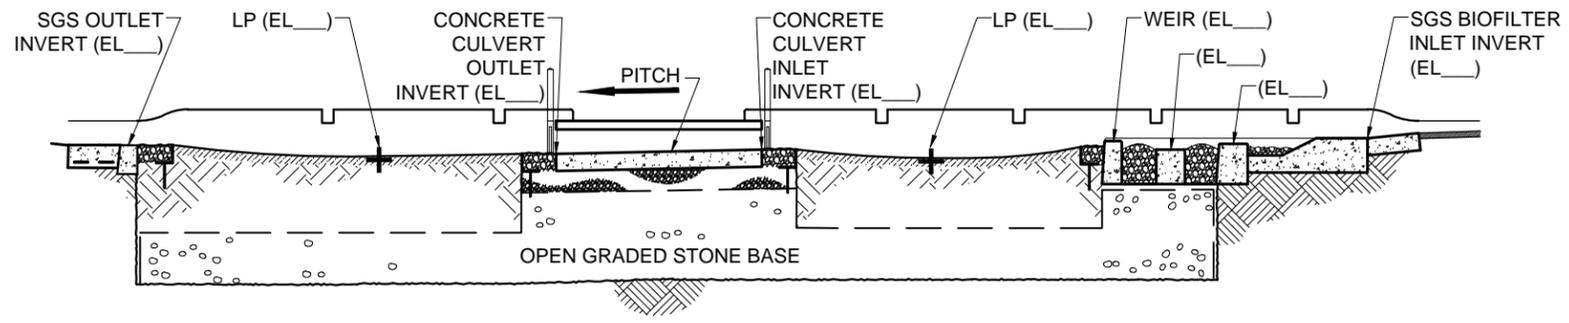


SECTION A-A

- NOTES:
1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
 2. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
 3. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
 4. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
 5. PEDESTRIAN PATHWAY WHEN REQUIRED.
 6. WHERE (EL. ___) IS INDICATED, ELEVATION TO BE SHOWN IN CONTRACT PLANS.
 7. HEADER NOTCHES ARE PLACED EQUALLY SPACED 4' TO 7' APART.

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1 LAYOUT GUIDELINES

- NO CONNECTION TO SEWERS

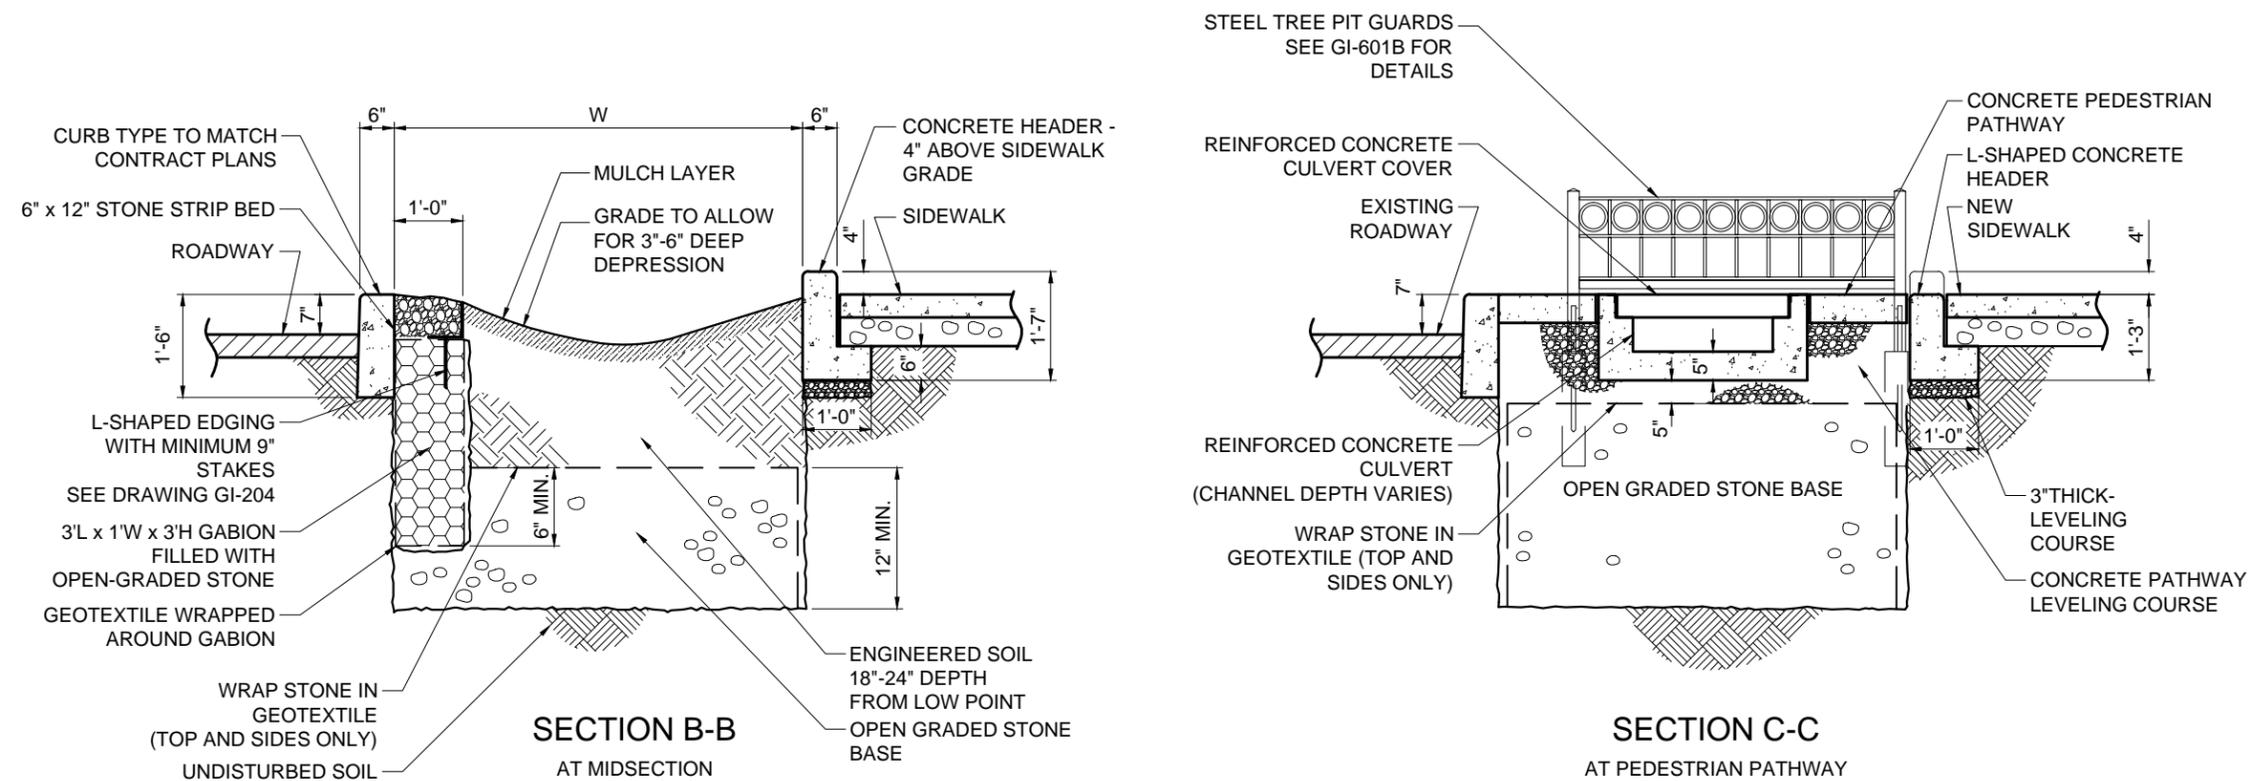


NOTES:

1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. IMPERVIOUS ROW AREA IS CALCULATED IN TDA ANALYSIS SPREADSHEET.
3. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
4. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
5. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
6. PEDESTRIAN PATHWAY WHEN REQUIRED.
7. WHERE (EL___) IS INDICATED. ELEVATION TO BE SHOWN IN CONTRACT PLANS.
8. PEDESTRIAN PATHWAY CULVERT COVER TO BE CONCRETE WHEN ELEVATION AT SIDEWALK CURB IS HIGHER THAN ELEVATION AT ROADWAY CURB; OTHERWISE, CULVERT COVER TO BE METAL GRATED WITH PATHWAY SLOPING TOWARDS GRATING ON EITHER SIDE.

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1A-WITH STONE COLUMNS LAYOUT GUIDELINES


- NO CONNECTION TO SEWERS

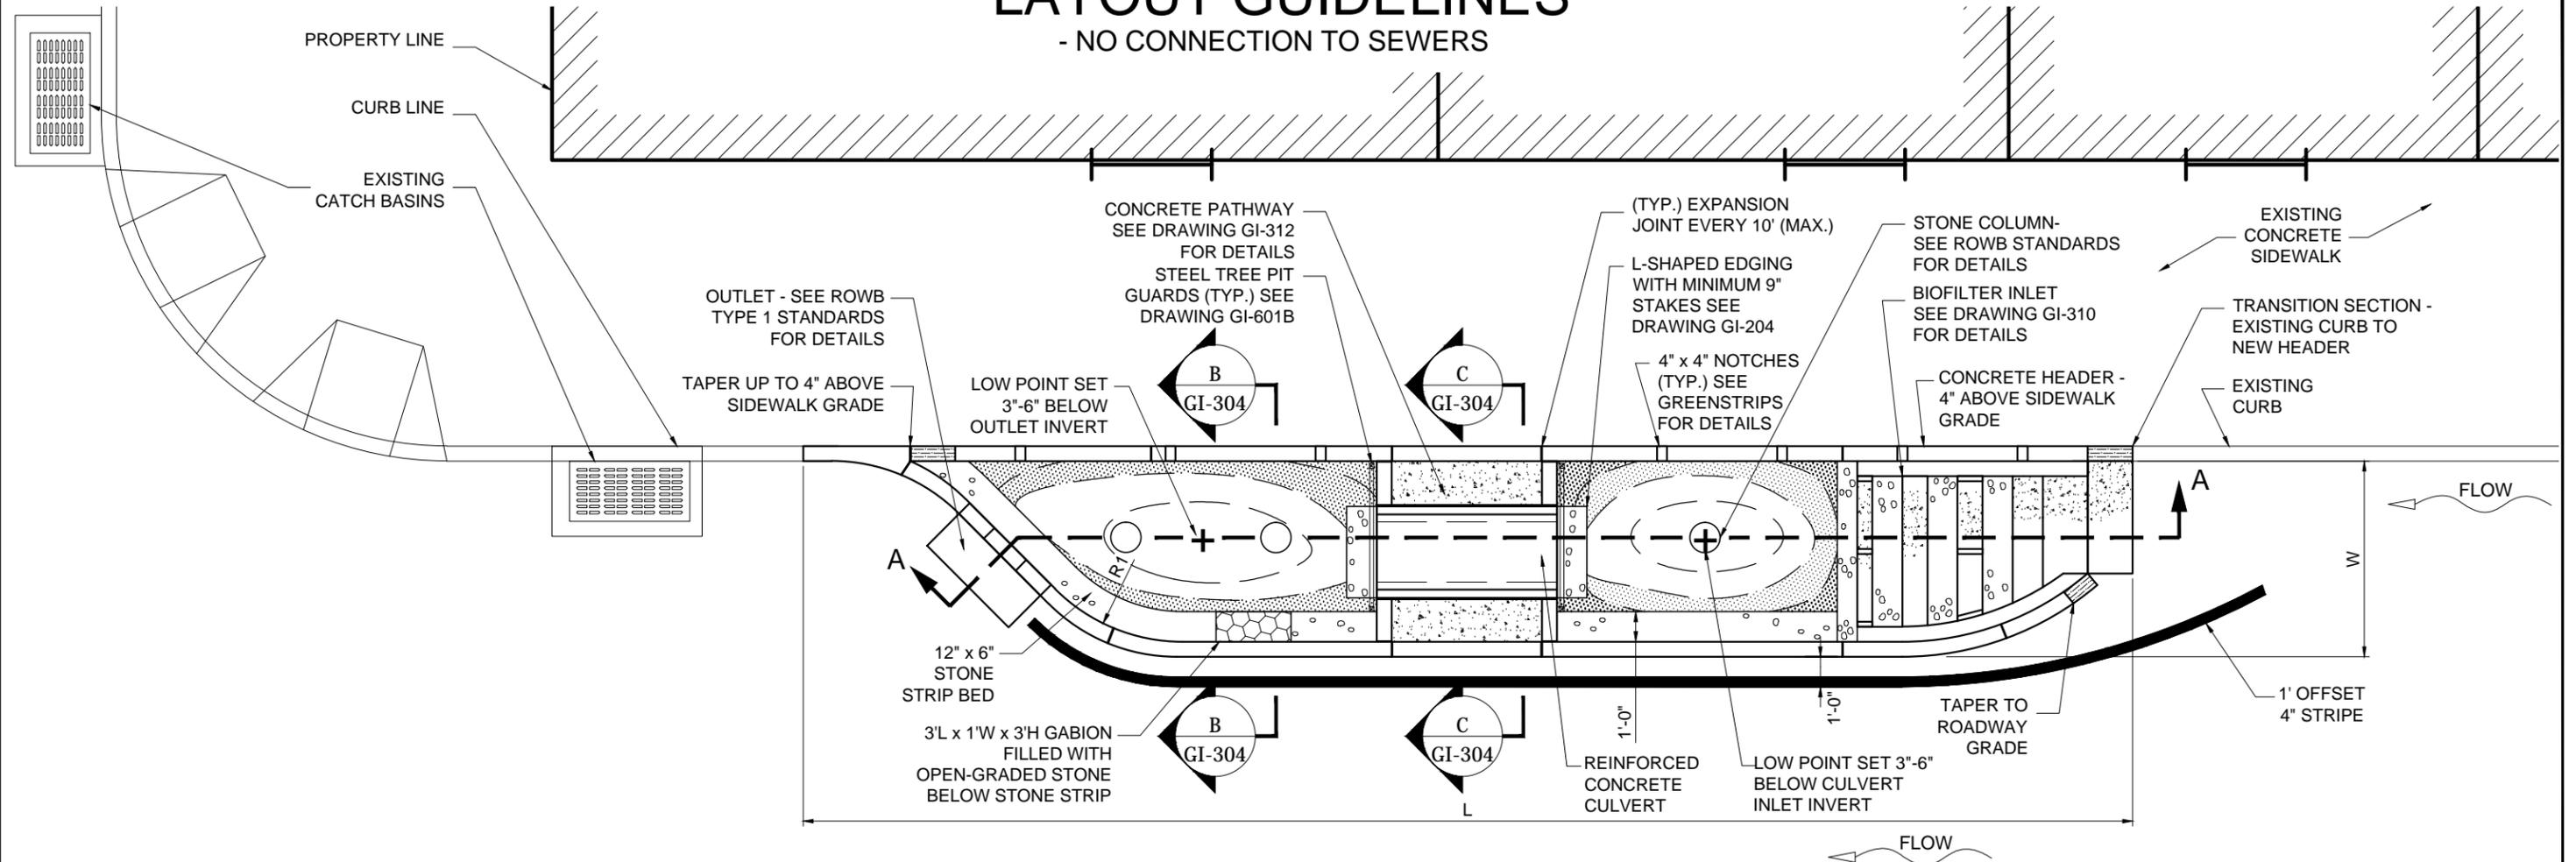

GRADING PLAN

NOTES:

1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
3. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
4. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
5. STONE COLUMN AND/OR PEDESTRIAN PATHWAY WHEN REQUIRED.
6. TOP OF DOWNSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN OUTLET INVERT (TYP.). TOP OF UPSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN CONCRETE CULVERT INLET INVERT (TYP.).
7. WHERE (EL___) IS INDICATED, ELEVATION TO BE SHOWN IN CONTRACT PLANS.
8. HEADER NOTCHES ARE PLACED EQUALLY SPACED 4' TO 7' APART.
9. 5' (MIN.) DISTANCE BETWEEN STONE COLUMNS; NUMBER OF STONE COLUMNS AS REQUIRED BY OGI.


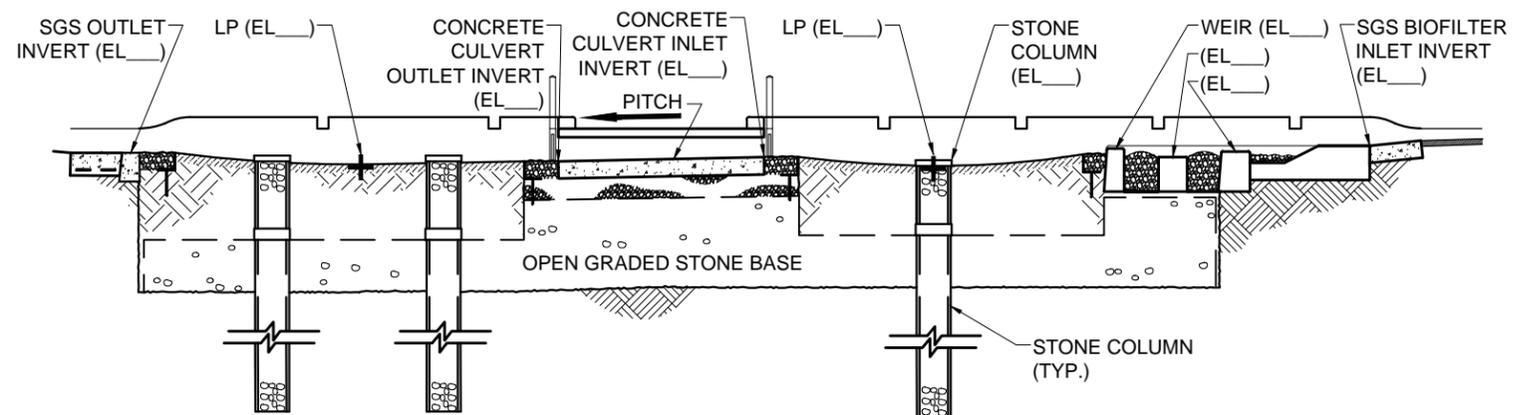


SECTION A-A

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 1A-WITH STONE COLUMNS LAYOUT GUIDELINES

- NO CONNECTION TO SEWERS

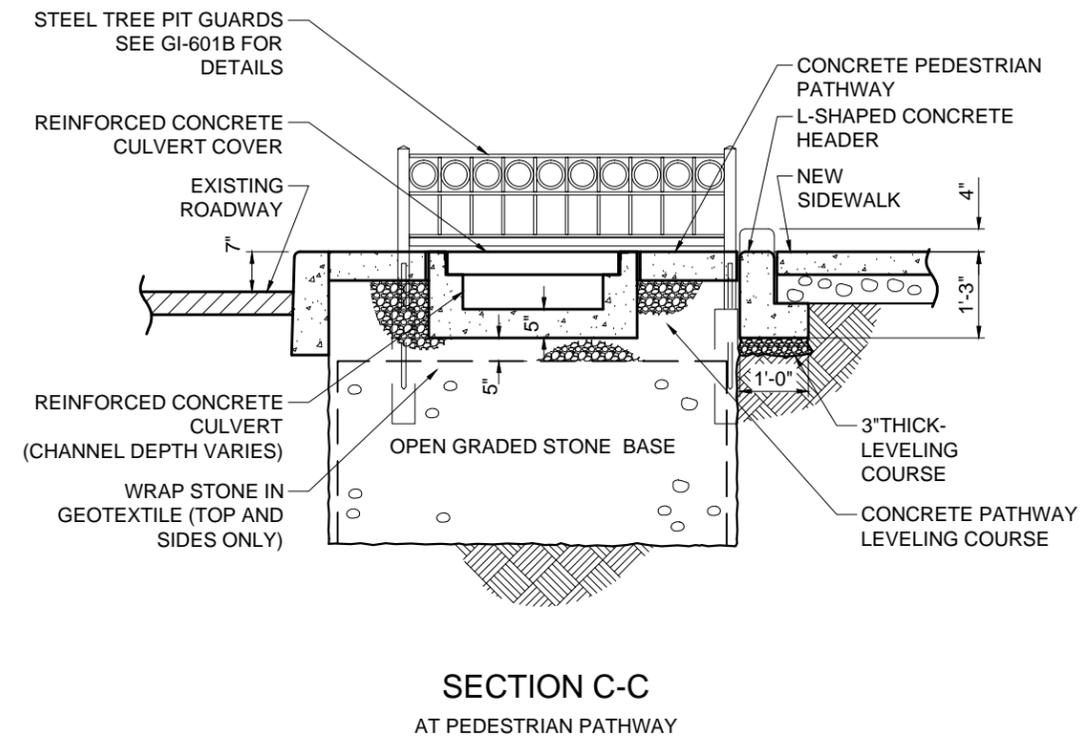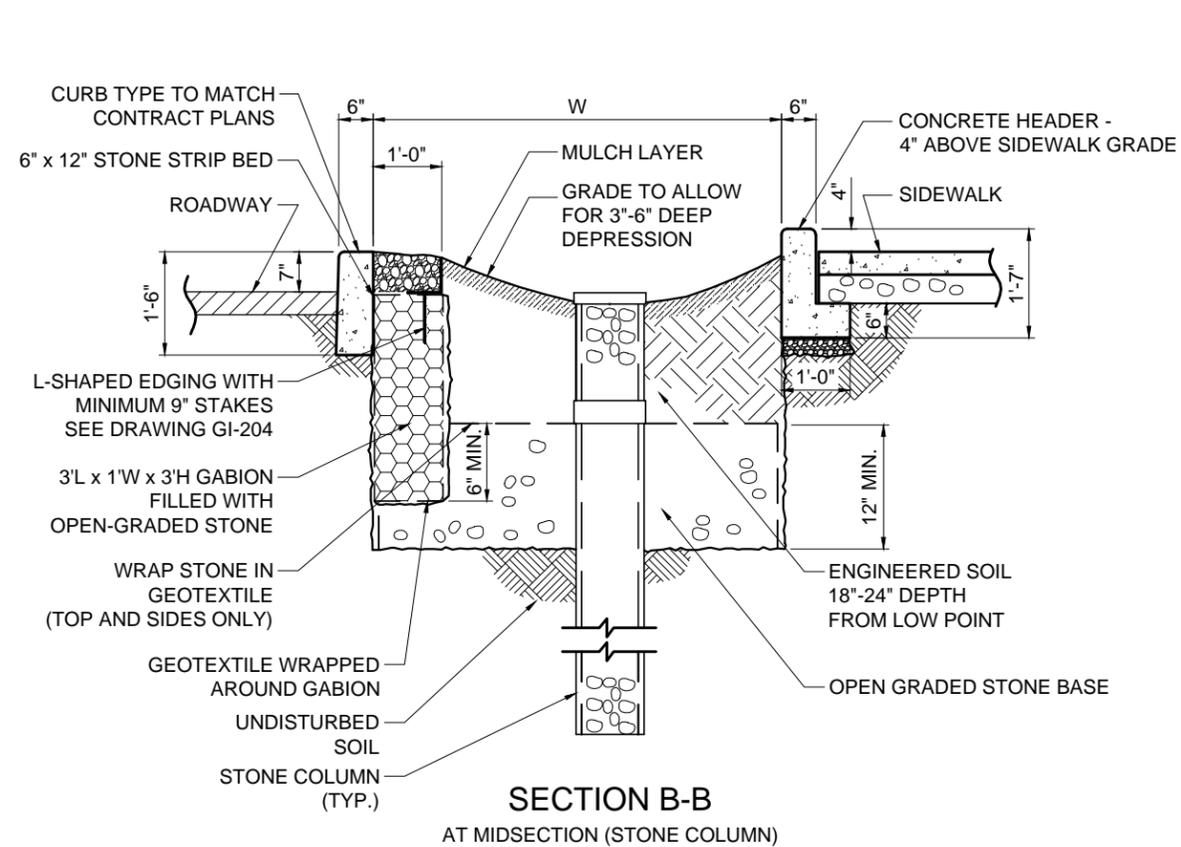


NOTES:

1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. IMPERVIOUS ROW AREA IS CALCULATED IN TDA ANALYSIS SPREADSHEET.
3. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
4. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
5. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
6. STONE COLUMN AND/OR PEDESTRIAN PATHWAY WHEN REQUIRED.
7. TOP OF DOWNSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN OUTLET INVERT (TYP.) TOP OF UPSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN CONCRETE CULVERT INLET INVERT (TYP.)
8. WHERE (EL___) IS INDICATED. ELEVATION TO BE SHOWN IN CONTRACT PLANS.
9. PEDESTRIAN PATHWAY CULVERT COVER TO BE CONCRETE WHEN ELEVATION AT SIDEWALK CURB IS HIGHER THAN ELEVATION AT ROADWAY CURB; OTHERWISE, CULVERT COVER TO BE METAL GRATED WITH PATHWAY SLOPING TOWARDS GRATING ON EITHER SIDE.


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2 LAYOUT GUIDELINES

- NO CONNECTION TO SEWERS

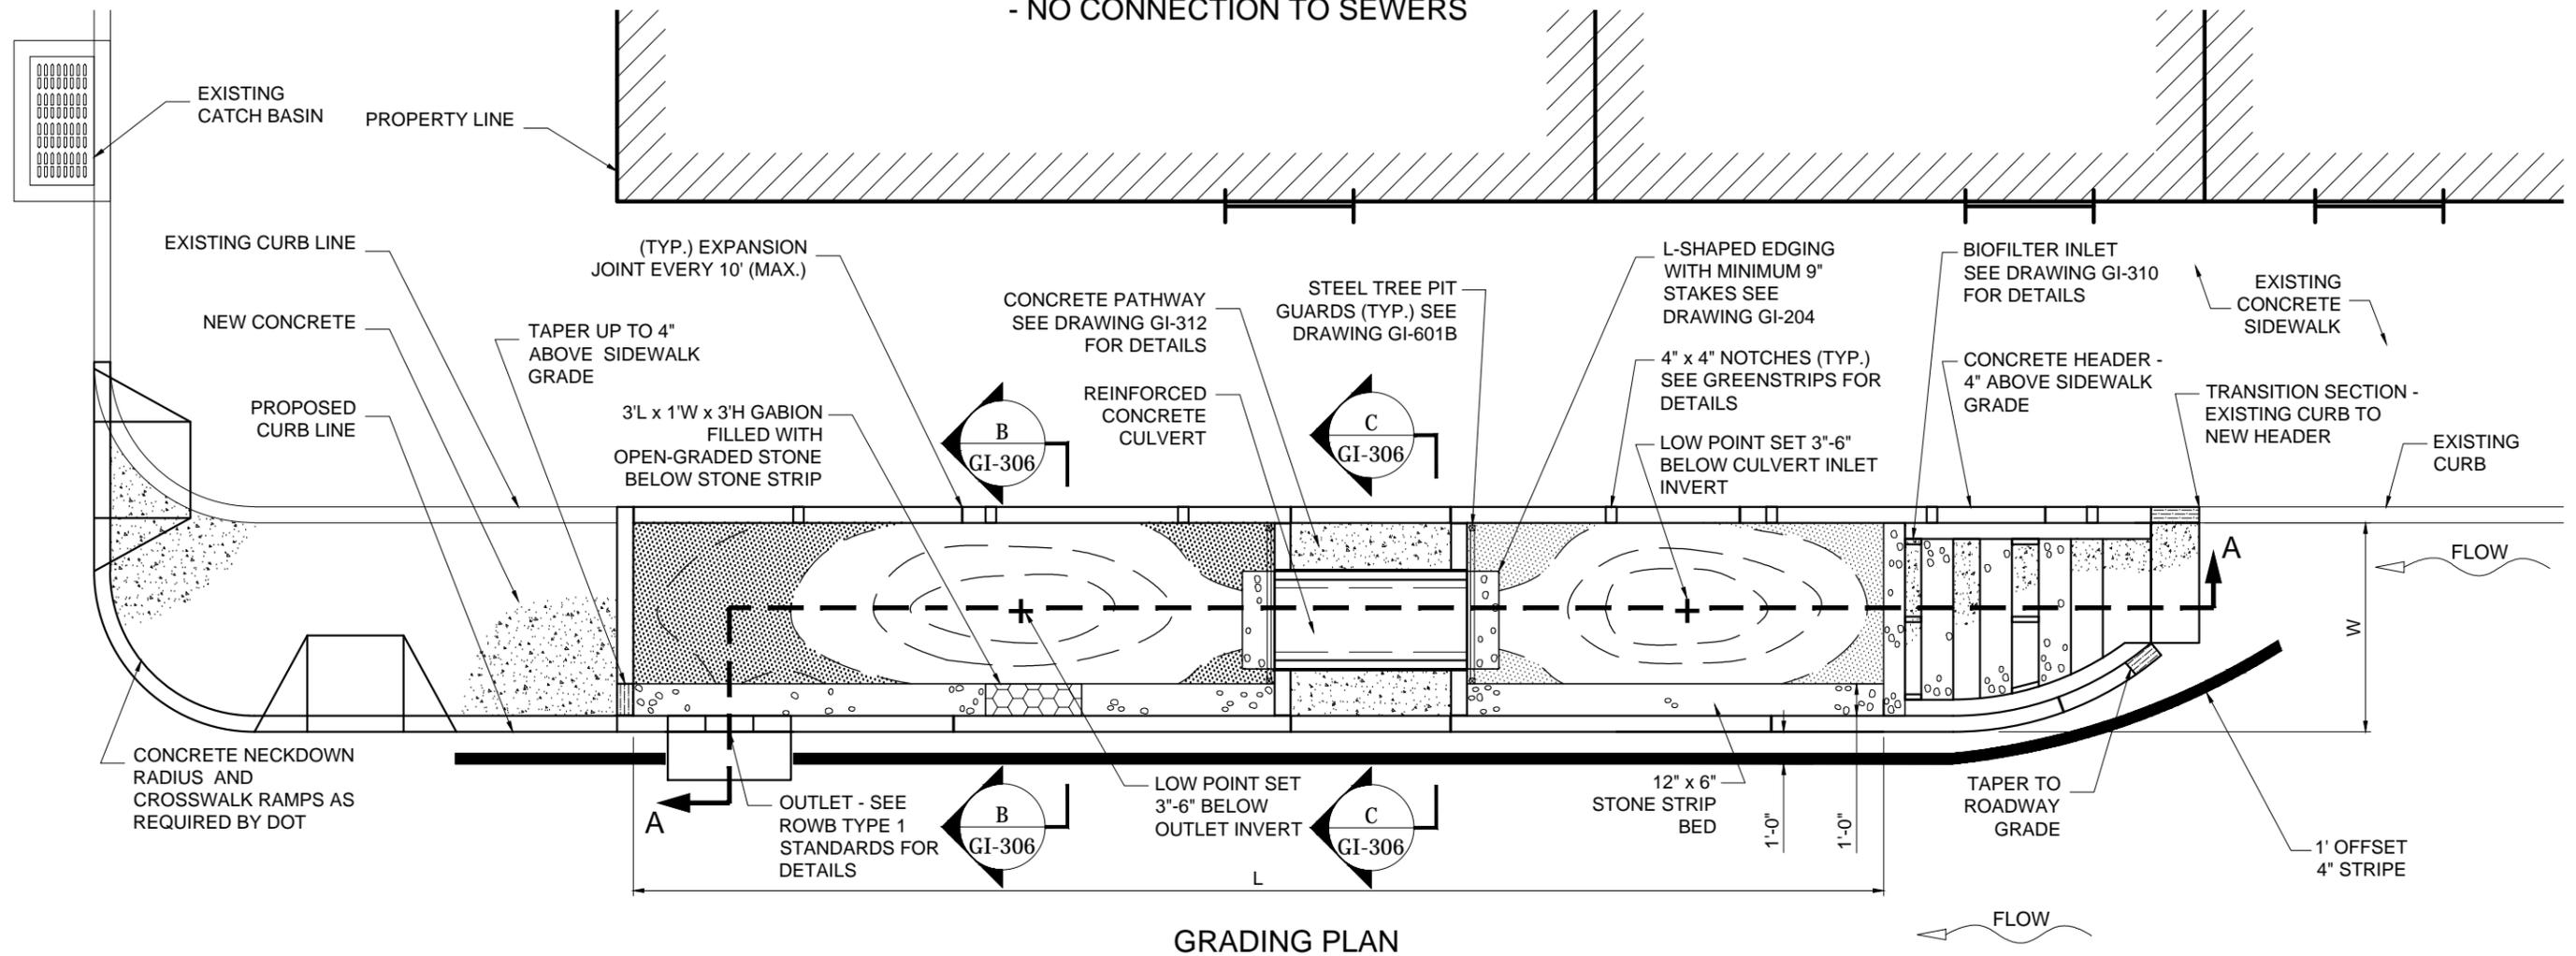

GRADING PLAN

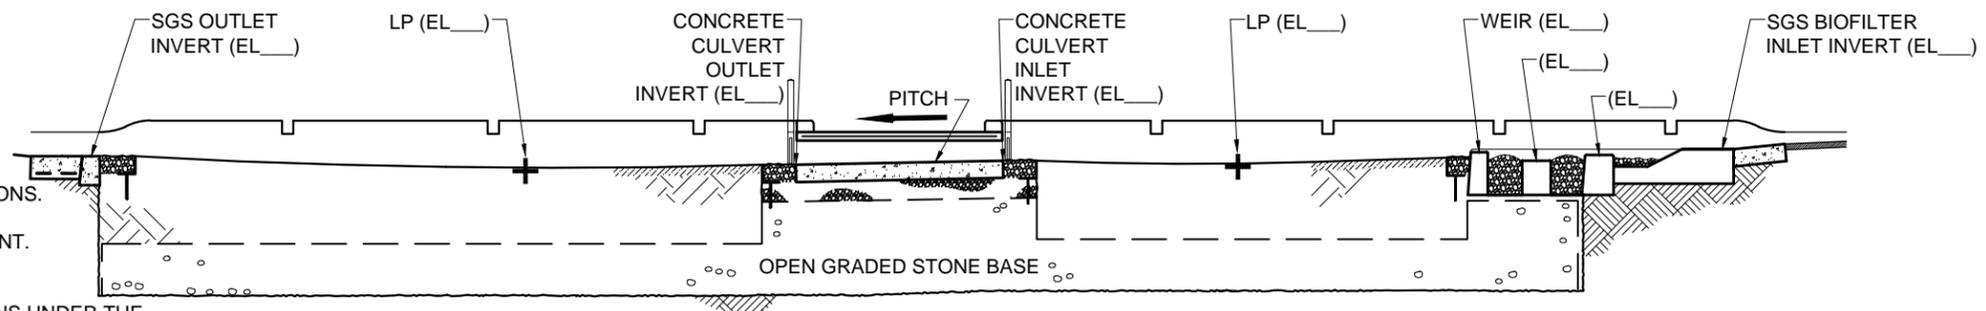

SECTION A-A



NOTES:

1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
3. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
4. IF DEEPER LOW POINT (L.P.) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
5. PEDESTRIAN PATHWAY WHEN REQUIRED.
6. WHERE (EL___) IS INDICATED, ELEVATION TO BE SHOWN IN CONTRACT PLANS.
7. HEADER NOTCHES ARE PLACED EQUALLY SPACED 4' TO 7' APART.

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2 LAYOUT GUIDELINES

- NO CONNECTION TO SEWERS

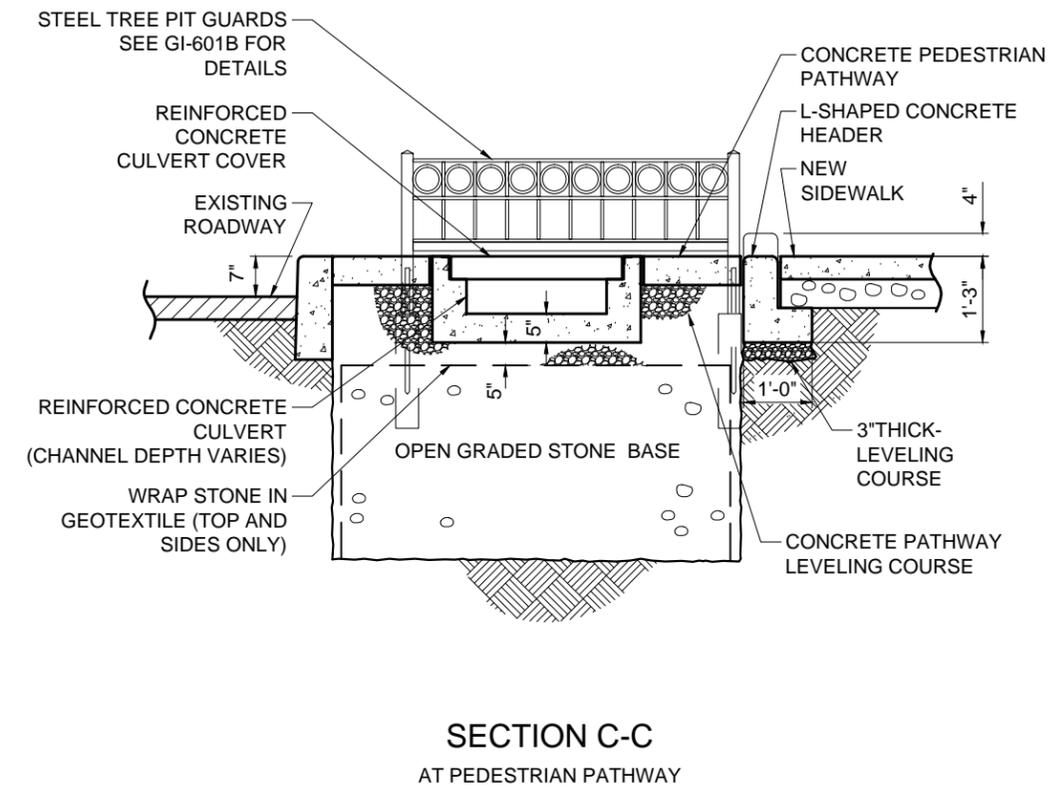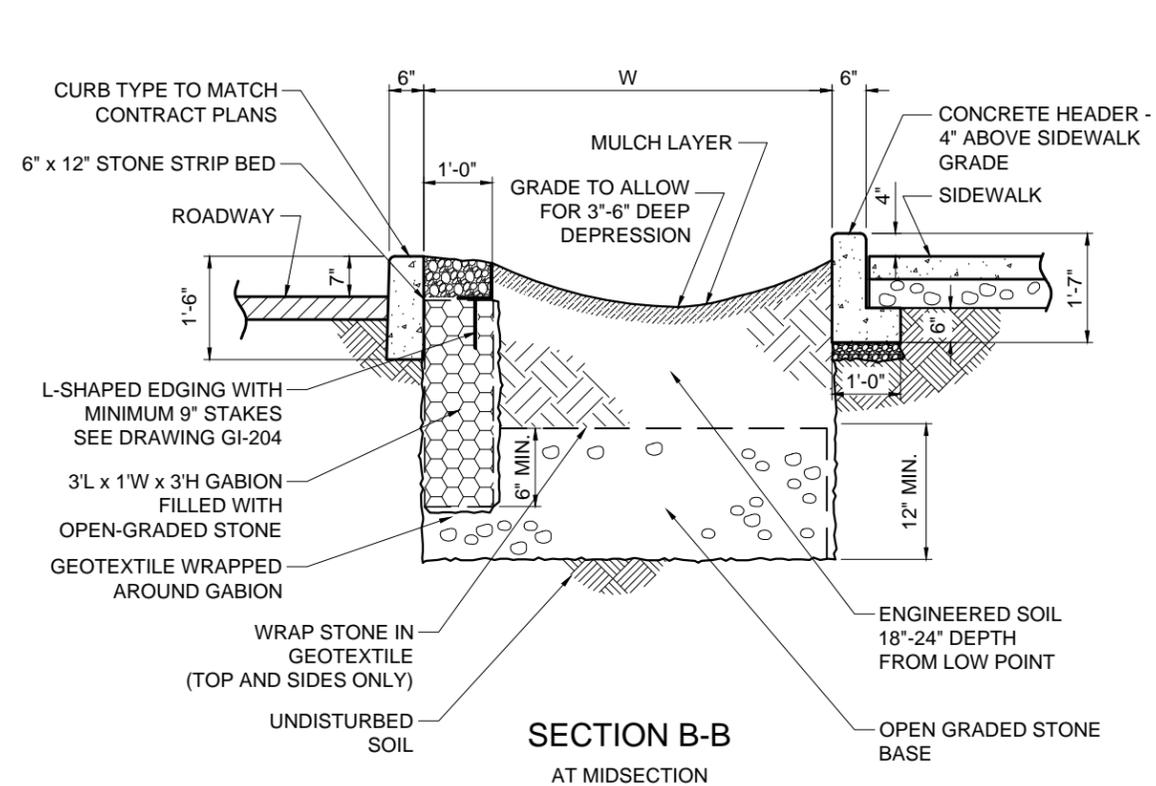

NOTES:


1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. IMPERVIOUS ROW AREA IS CALCULATED IN TDA ANALYSIS SPREADSHEET.
3. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
4. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
5. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
6. PEDESTRIAN PATHWAY WHEN REQUIRED.
7. WHERE (EL___) IS INDICATED. ELEVATION TO BE SHOWN IN CONTRACT PLANS.
8. PEDESTRIAN PATHWAY CULVERT COVER TO BE CONCRETE WHEN ELEVATION AT SIDEWALK CURB IS HIGHER THAN ELEVATION AT ROADWAY CURB; OTHERWISE, CULVERT COVER TO BE METAL GRATED WITH PATHWAY SLOPING TOWARDS GRATING ON EITHER SIDE.

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2A-WITH STONE COLUMNS

LAYOUT GUIDELINES


- NO CONNECTION TO SEWERS

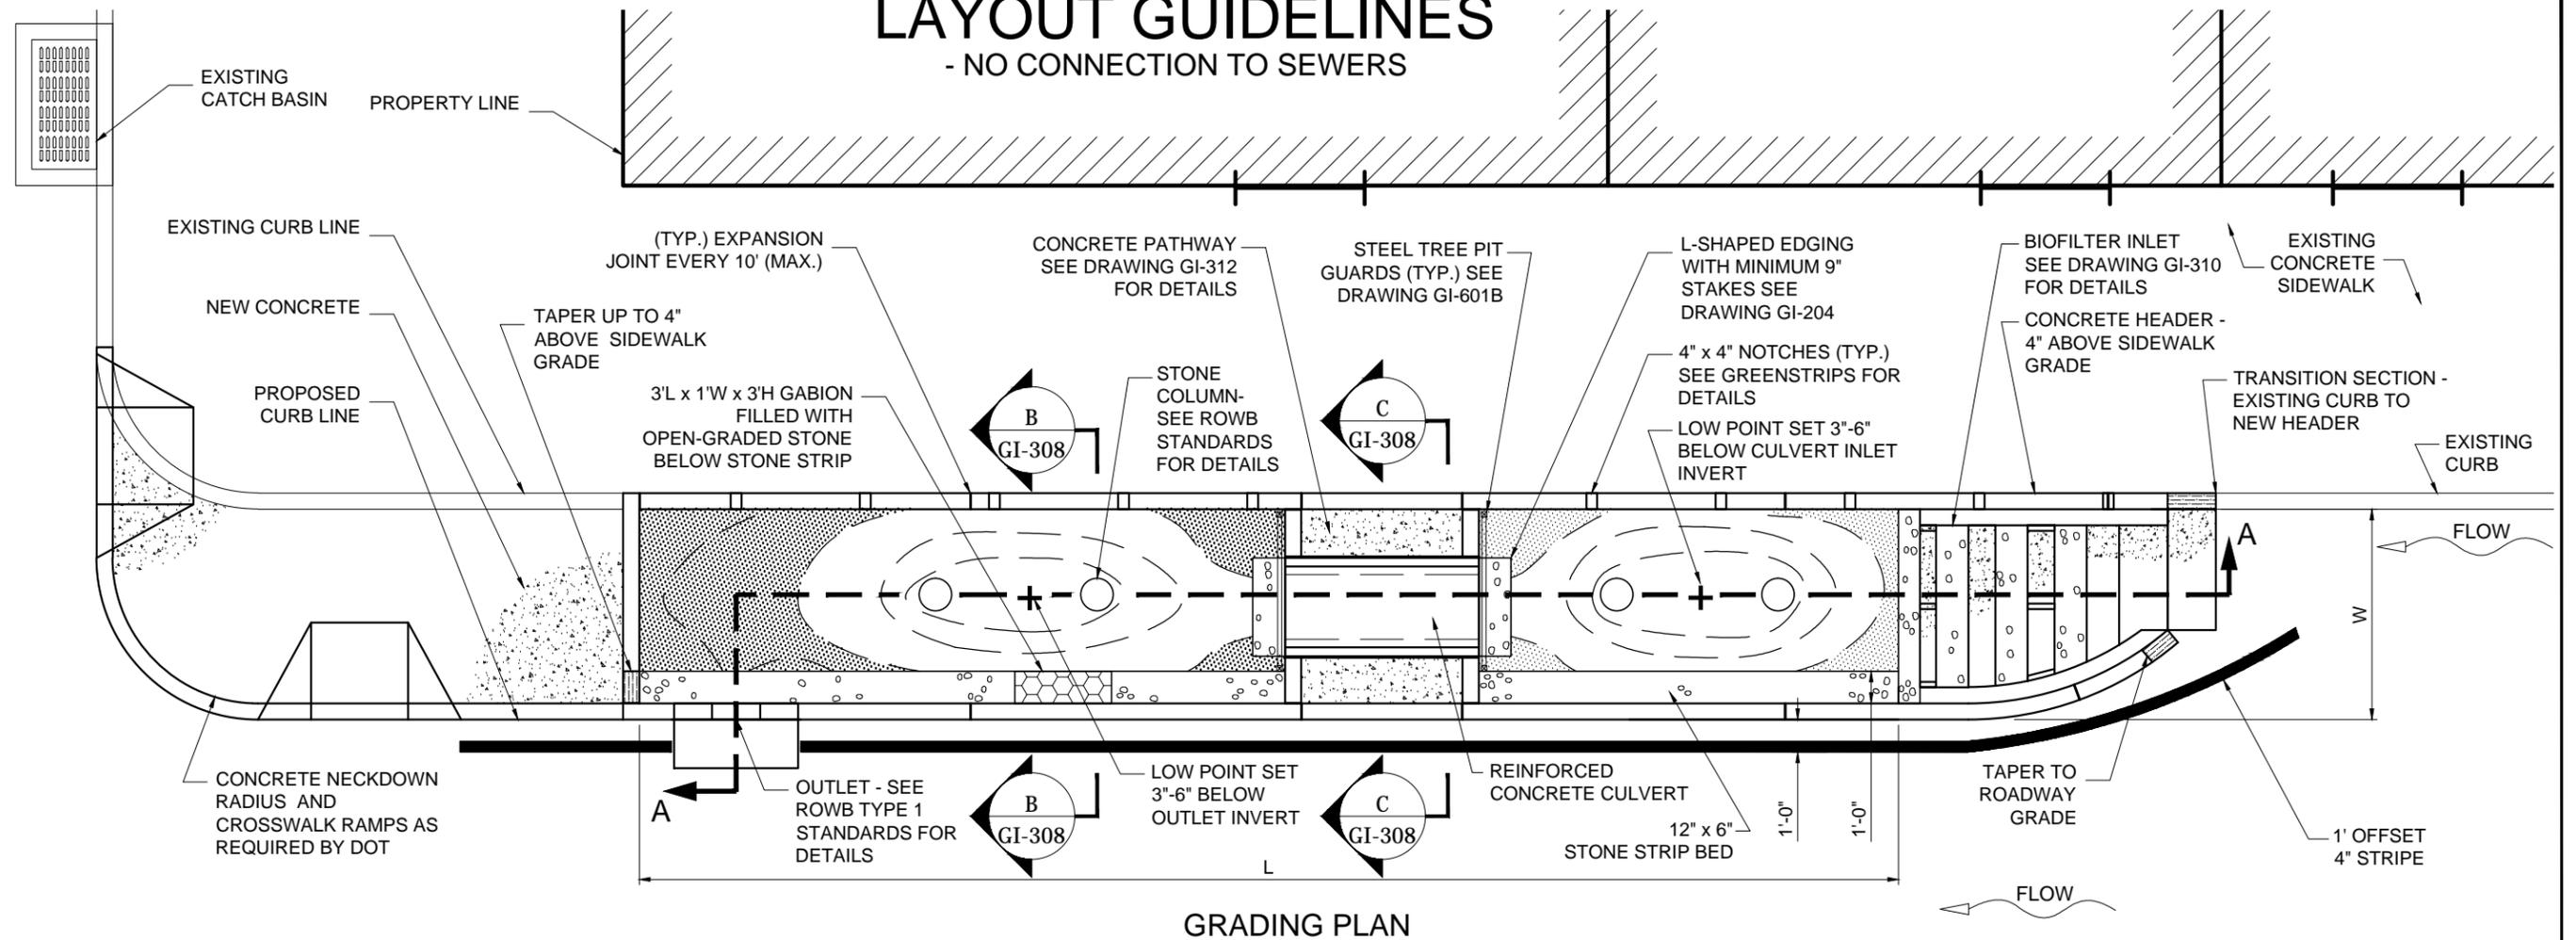

GRADING PLAN

NOTES:

1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
3. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
4. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
5. STONE COLUMN AND/OR PEDESTRIAN PATHWAY WHEN REQUIRED.
6. TOP OF DOWNSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN OUTLET INVERT (TYP.) TOP OF UPSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN CONCRETE CULVERT INLET INVERT (TYP.).
7. WHERE (EL___) IS INDICATED, ELEVATION TO BE SHOWN IN CONTRACT PLANS.
8. HEADER NOTCHES ARE PLACED EQUALLY SPACED 4' TO 7' APART.
9. 5' (MIN.) DISTANCE BETWEEN STONE COLUMNS; NUMBER OF STONE COLUMNS AS REQUIRED BY OGI.


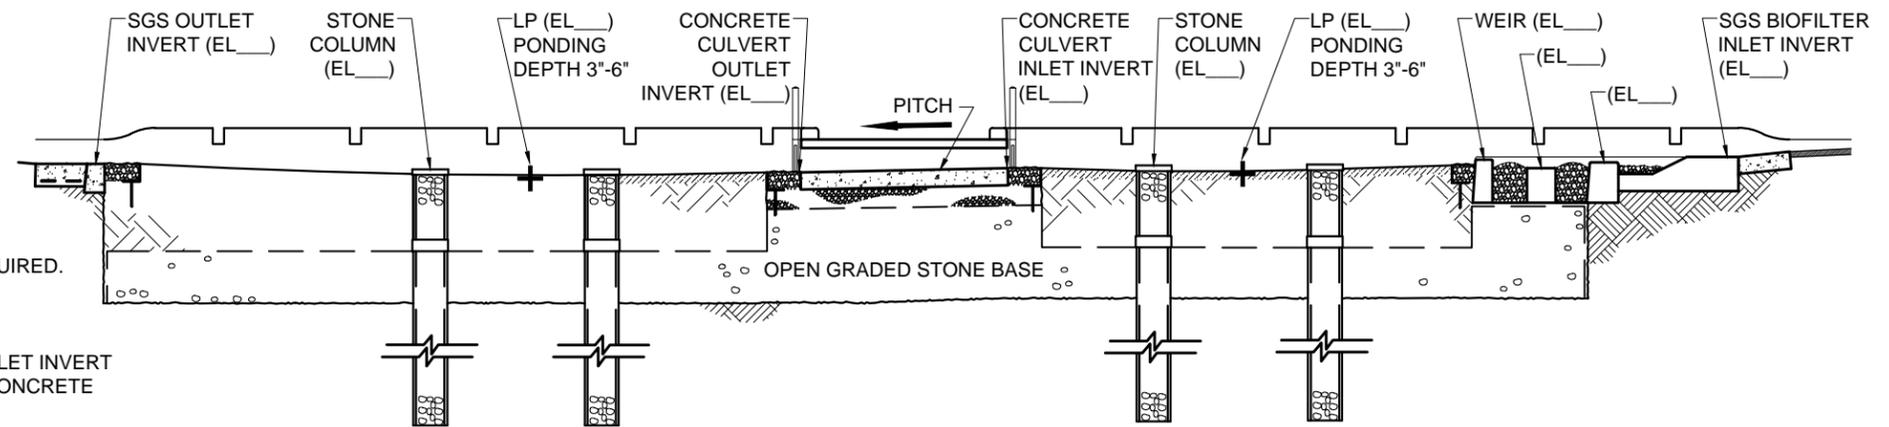


SECTION A-A

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 2A-WITH STONE COLUMNS LAYOUT GUIDELINES

- NO CONNECTION TO SEWERS

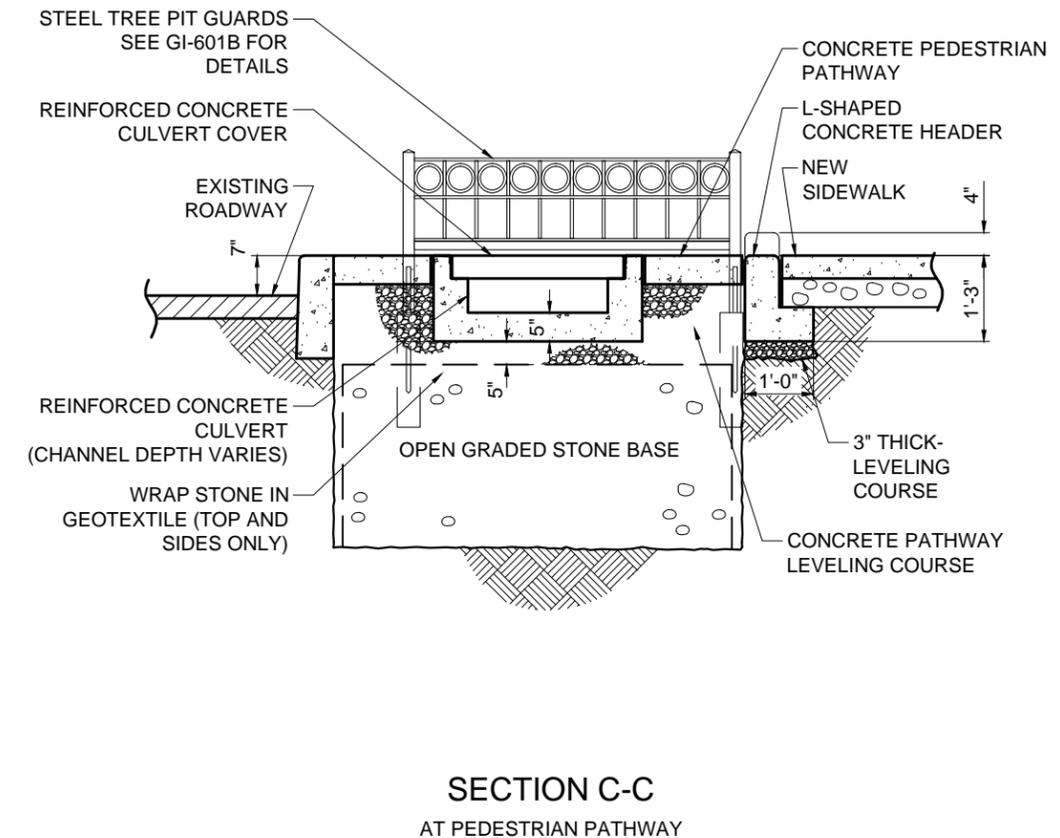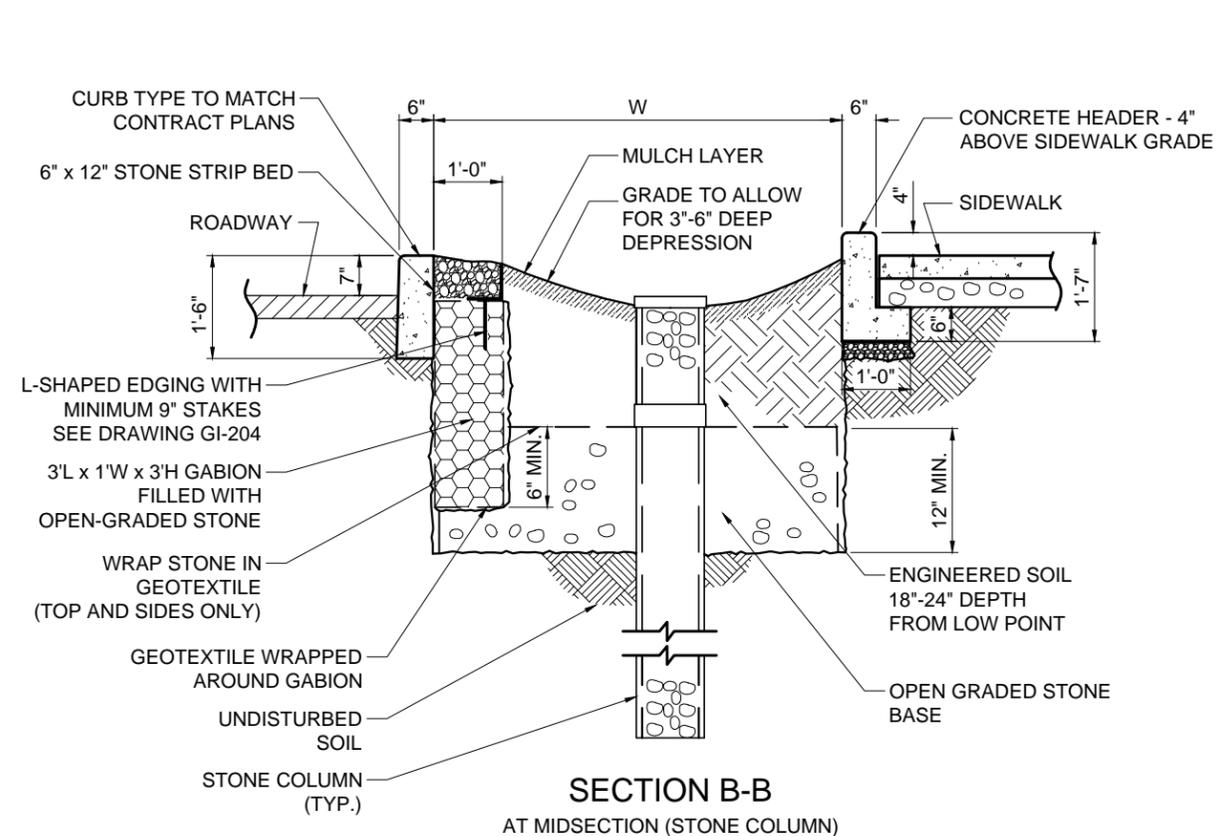


NOTES:

1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. IMPERVIOUS ROW AREA IS CALCULATED IN TDA ANALYSIS SPREADSHEET.
3. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
4. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
5. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED..
6. STONE COLUMN AND/OR PEDESTRIAN PATHWAY WHEN REQUIRED.
7. TOP OF DOWNSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN OUTLET INVERT (TYP.) TOP OF UPSTREAM STONE COLUMN(S) TO BE 1" LOWER THAN CONCRETE CULVERT INLET INVERT (TYP.)
8. WHERE (EL___) IS INDICATED. ELEVATION TO BE SHOWN IN CONTRACT PLANS.
9. PEDESTRIAN PATHWAY CULVERT COVER TO BE CONCRETE WHEN ELEVATION AT SIDEWALK CURB IS HIGHER THAN ELEVATION AT ROADWAY CURB; OTHERWISE, CULVERT COVER TO BE METAL GRATED WITH PATHWAY SLOPING TOWARDS GRATING ON EITHER SIDE.


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) TYPE 3 LAYOUT GUIDELINES


- NO CONNECTION TO SEWERS

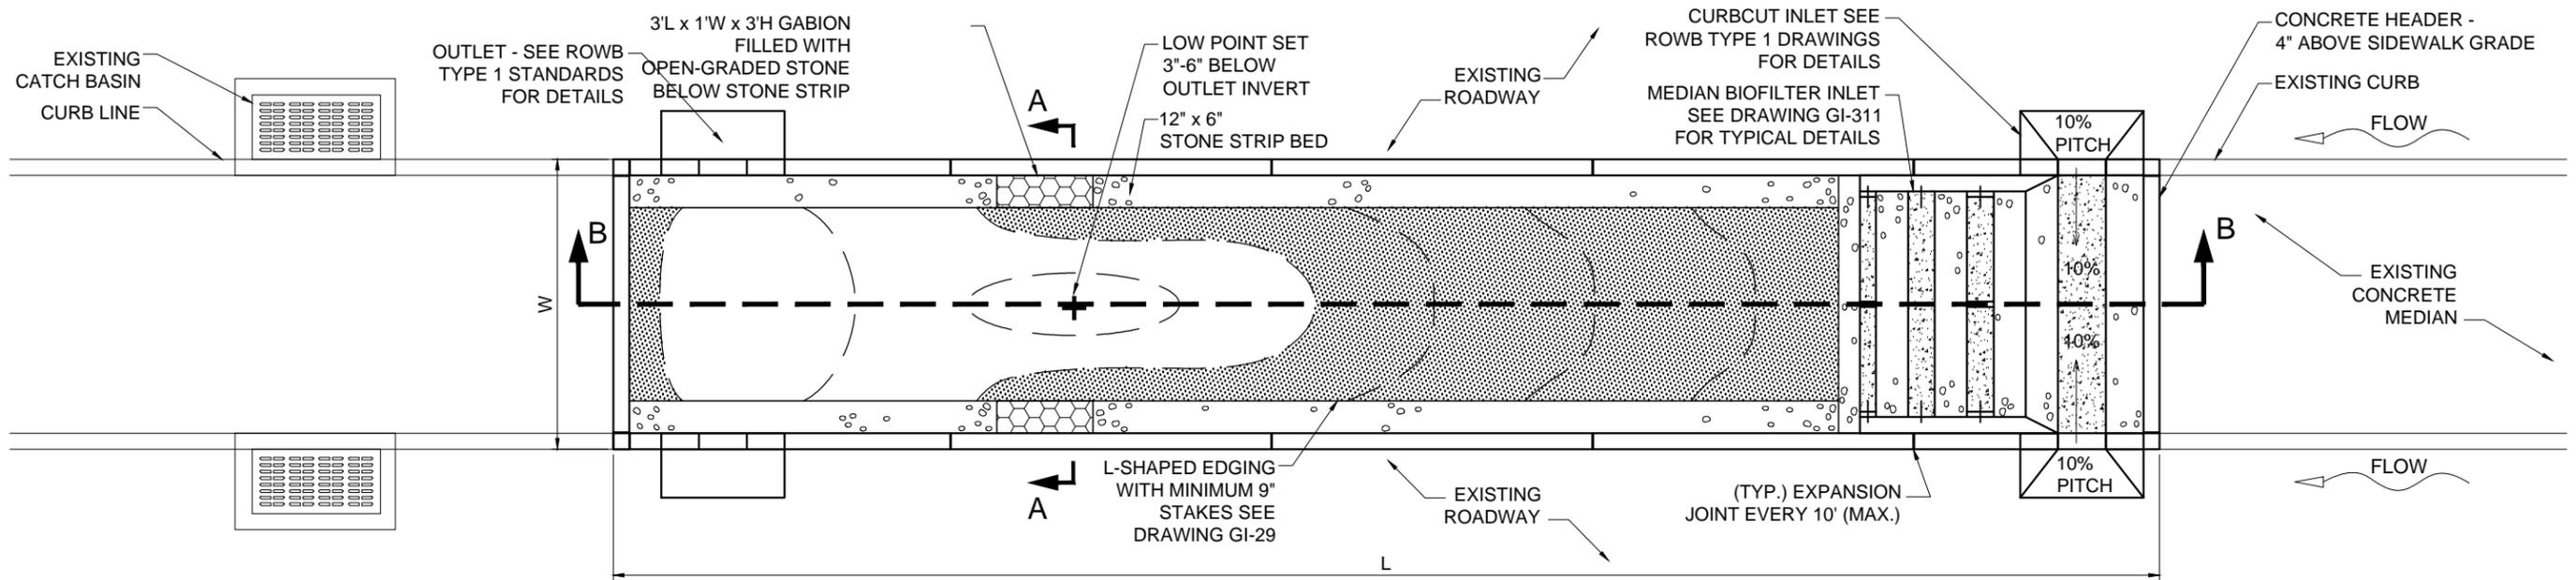

GRADING PLAN

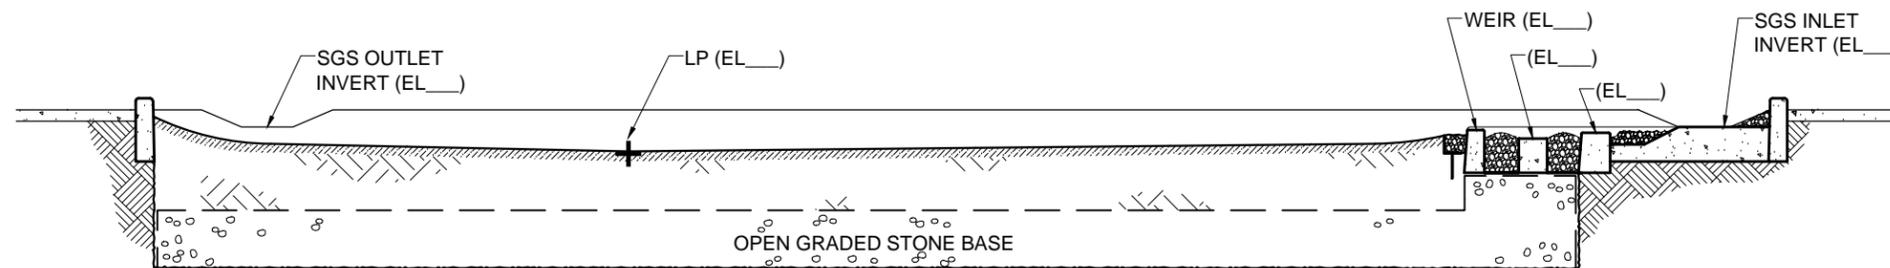

SECTION B-B

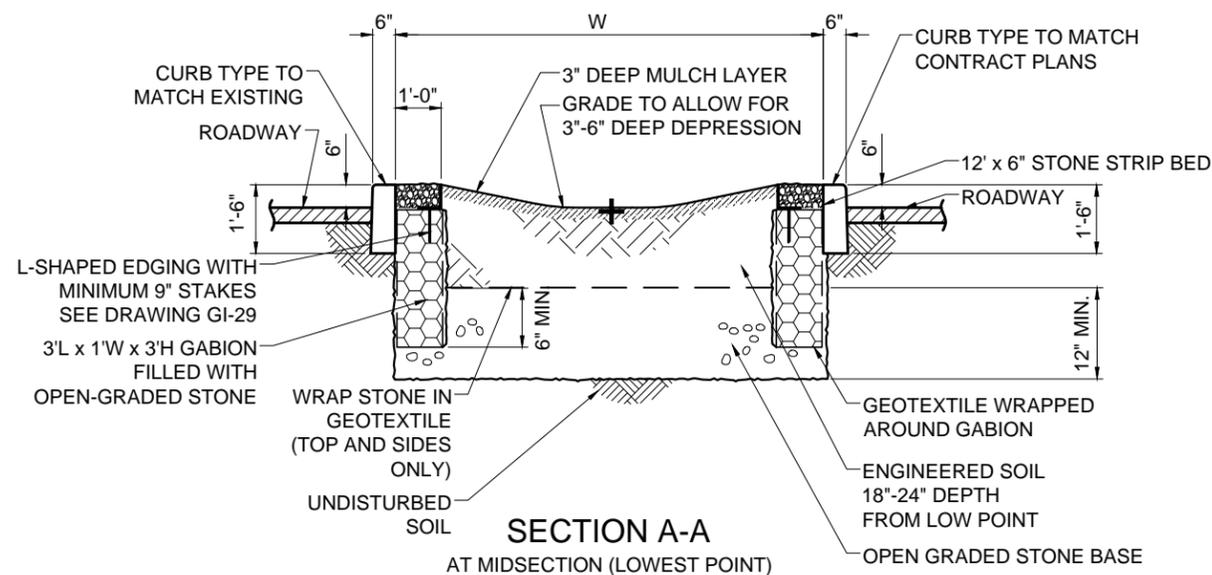

SECTION A-A

AT MIDSECTION (LOWEST POINT)


NOTES:

1. DEPTH OF SOIL AND STONE SHALL BE DIMENSIONED IN ACCORDANCE WITH STORMWATER GREENSTREET CALCULATIONS.
2. ENGINEERED SOIL DEPTH TO BE 18", AND 24" IF TREE IS PRESENT. STONE DEPTH VARIES. TOTAL DEPTH NOT TO EXCEED 60".
3. DEPTH AND MATERIALS MAY CHANGE DUE TO FIELD CONDITIONS UNDER THE DIRECTION OF THE ENGINEER.
4. IF DEEPER LOW POINT (LP) IS REQUIRED, OGI APPROVAL WILL BE REQUIRED.
5. PEDESTRIAN PATHWAY WHEN REQUIRED.
6. WHERE (EL ___) IS INDICATED. ELEVATION TO BE SHOWN IN CONTRACT PLANS.



CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) BIOFILTER INLET

- NO CONNECTION TO SEWERS

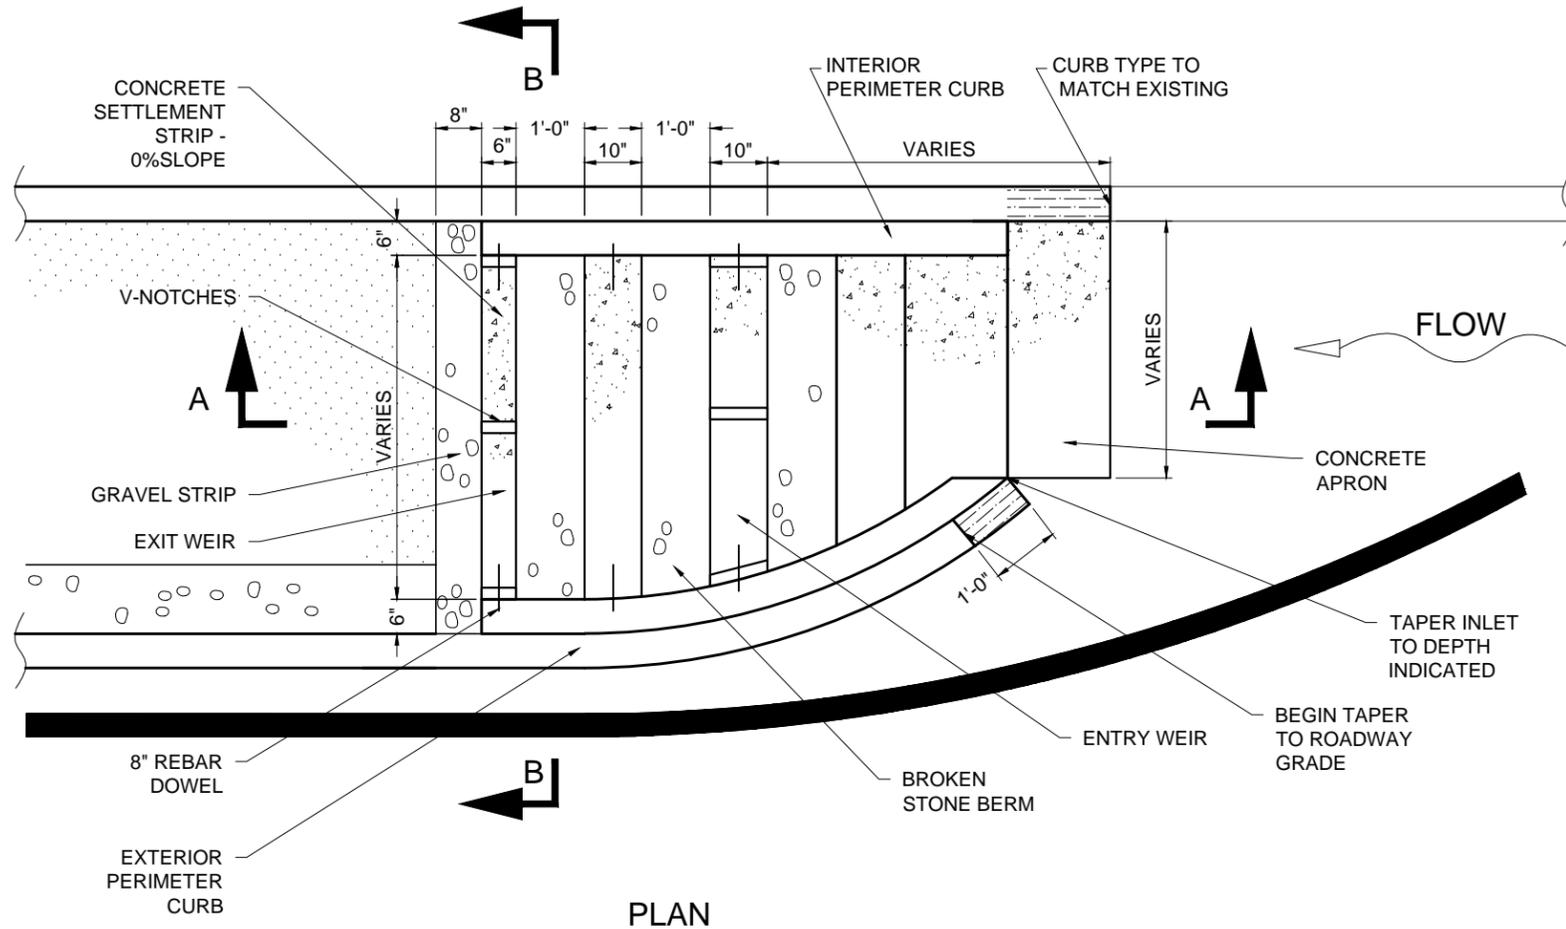


NOTES:
1. NUMBER OF BROKEN STONE BERMS MAY VARY AS REQUIRED BY OGI.

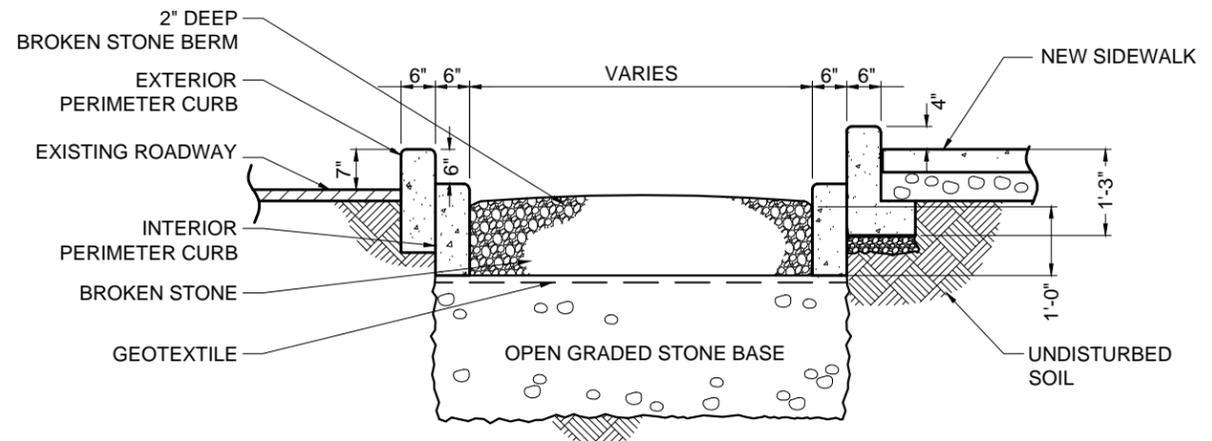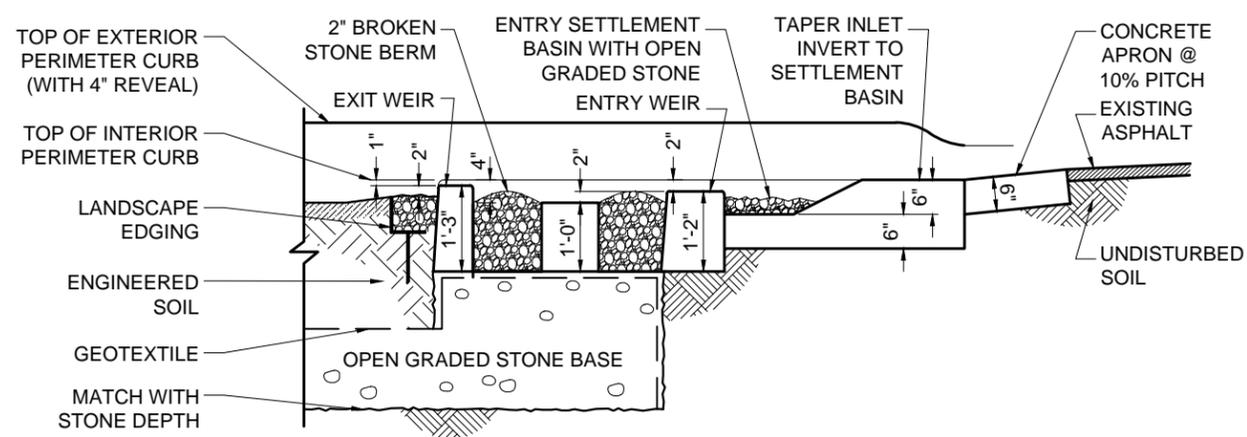

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


R.O.W. STORMWATER GREENSTREET (ROWSGS) MEDIAN BIOFILTER INLET

- NO CONNECTION TO SEWERS

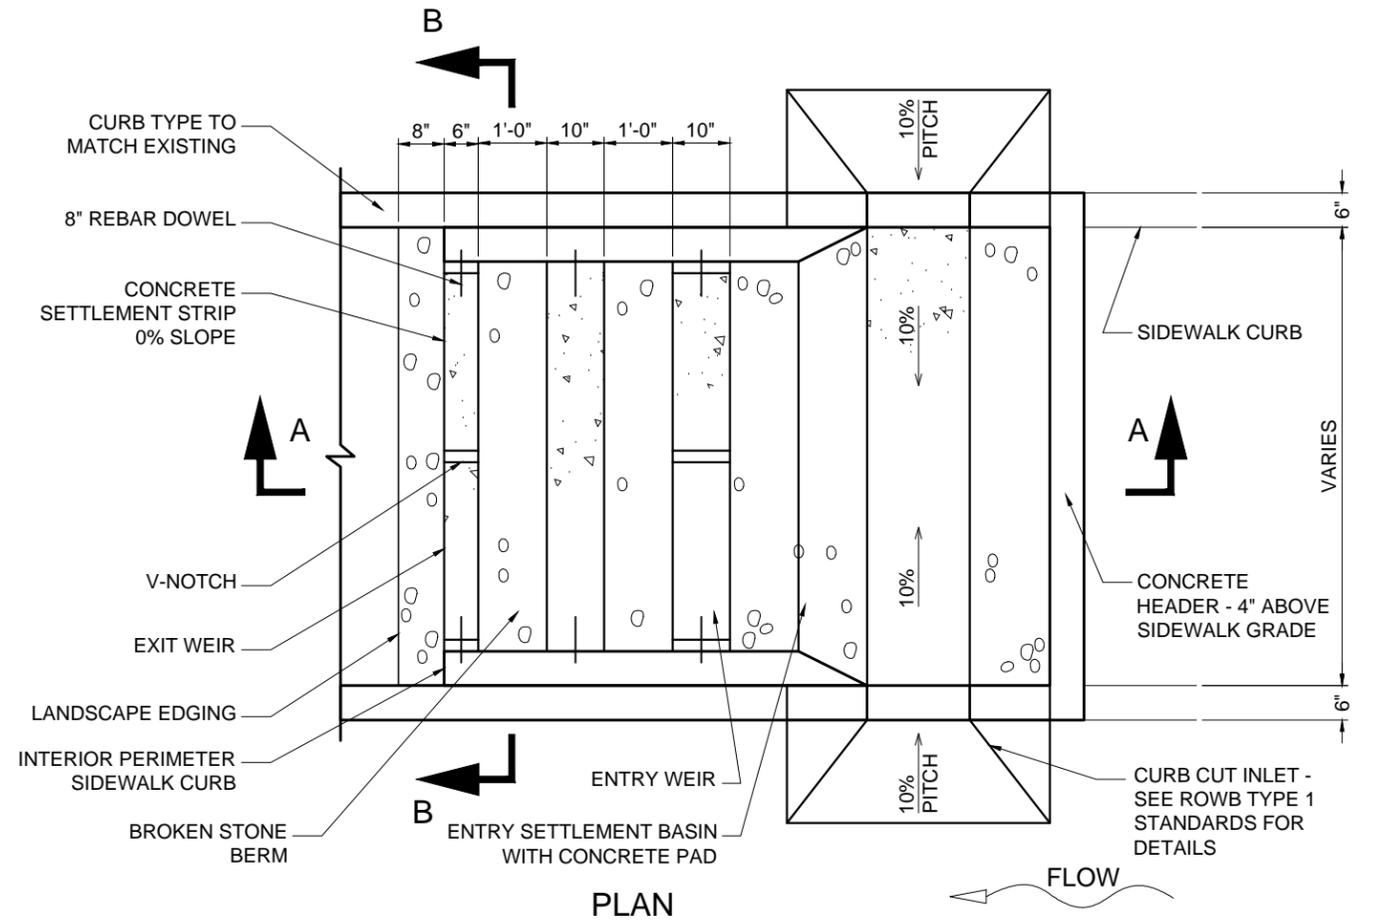


PLAN

- NOTES:
1. NUMBER OF BROKEN STONE BERMS MAY VARY AS REQUIRED BY OGI.

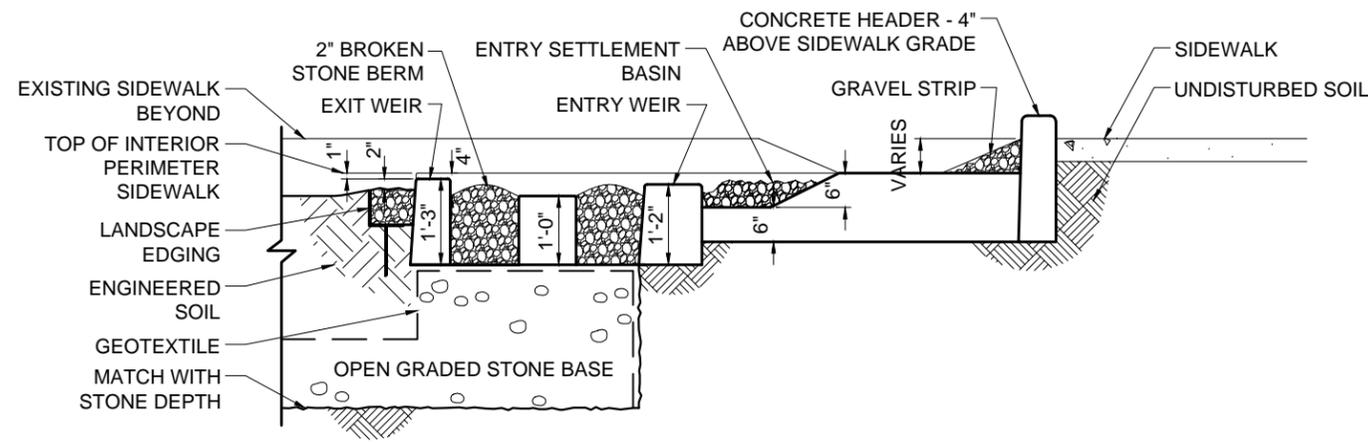

SECTION A-A

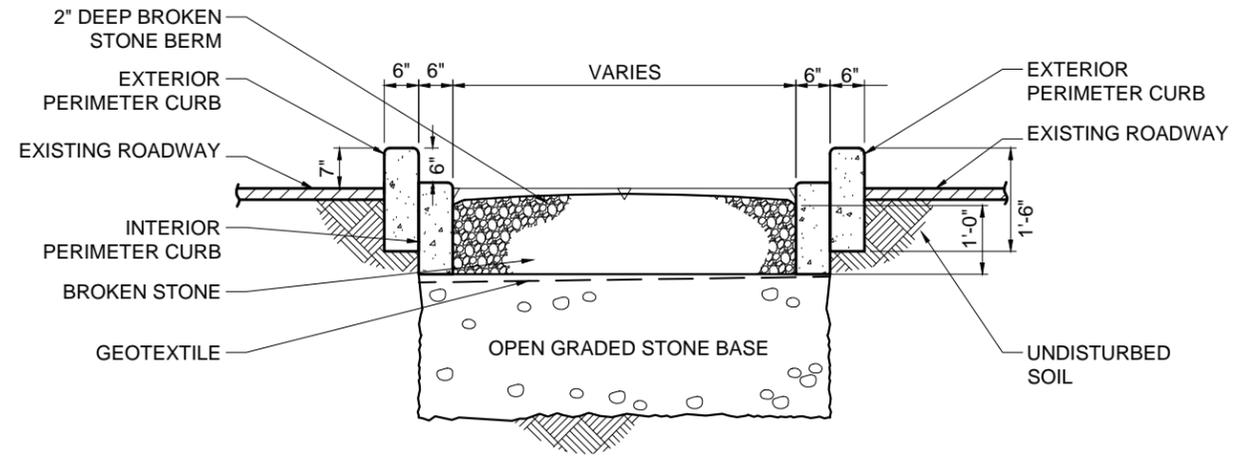


SECTION B-B


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

R.O.W. STORMWATER GREENSTREET (ROWSGS) CONCRETE AND GRATED PEDESTRIAN PATHWAYS


- NO CONNECTION TO SEWERS

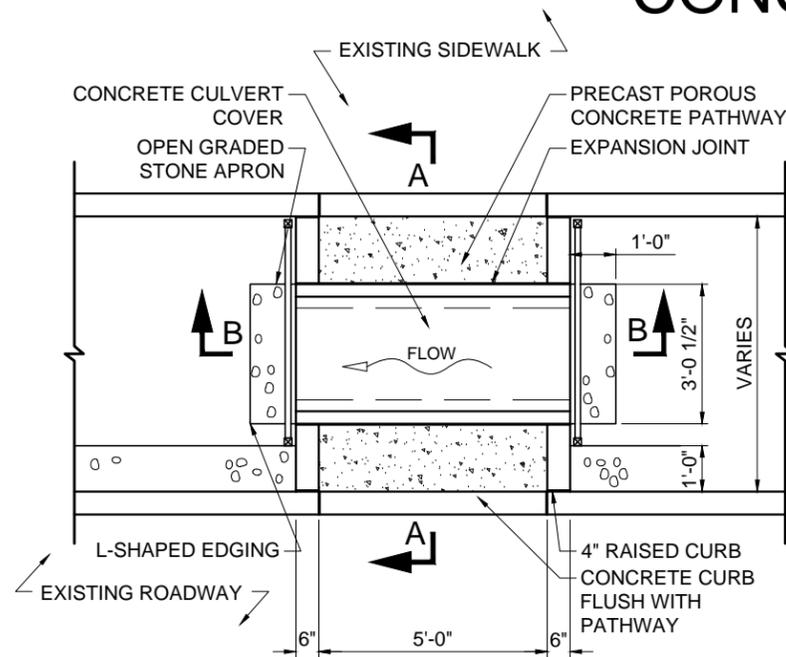


CONCRETE PATHWAY PLAN

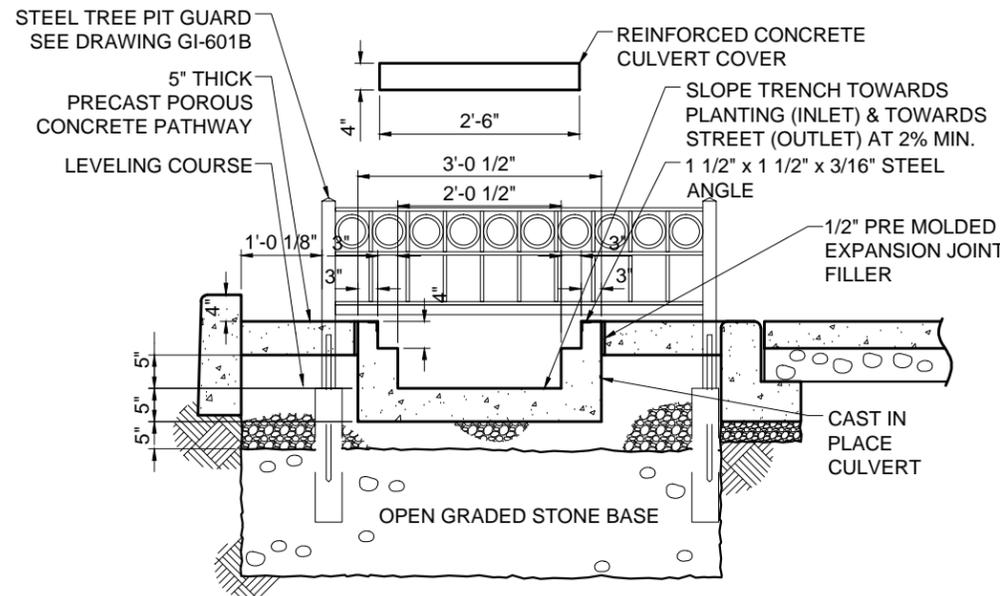


CONCRETE PATHWAY SECTION A-A

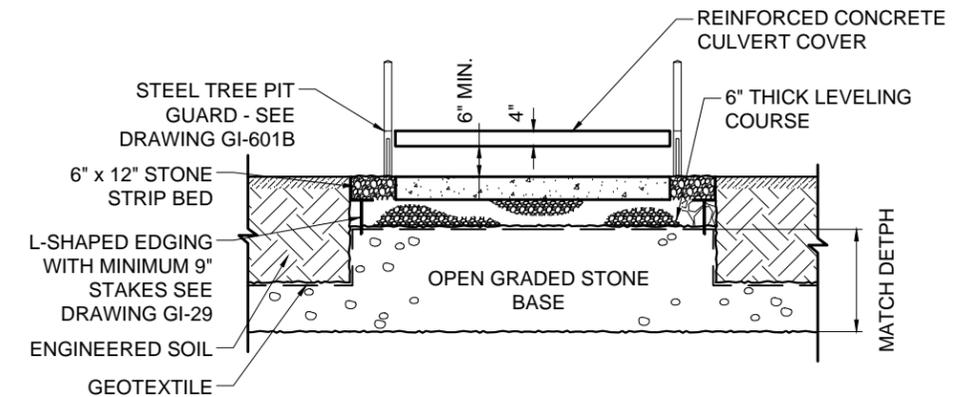


CONCRETE PATHWAY SECTION B-B

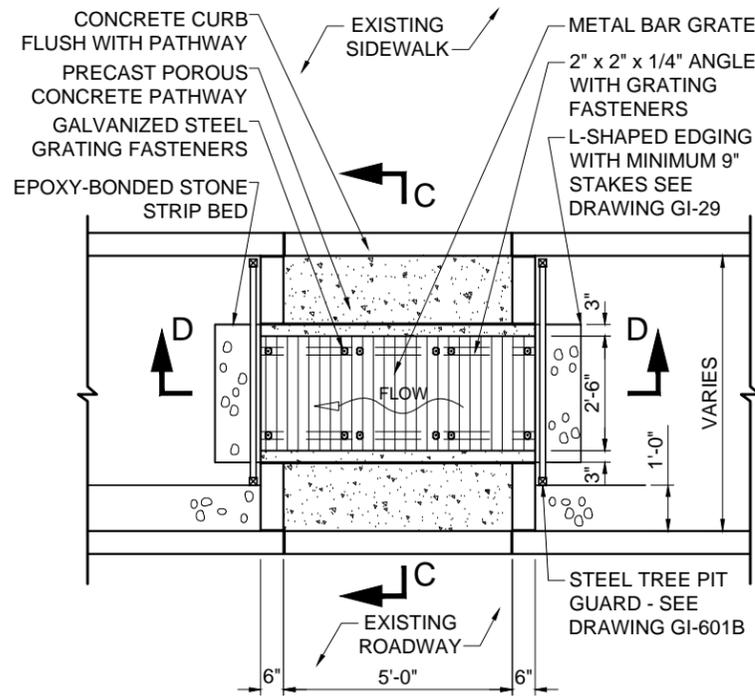

METAL GRATE PATHWAY PLAN

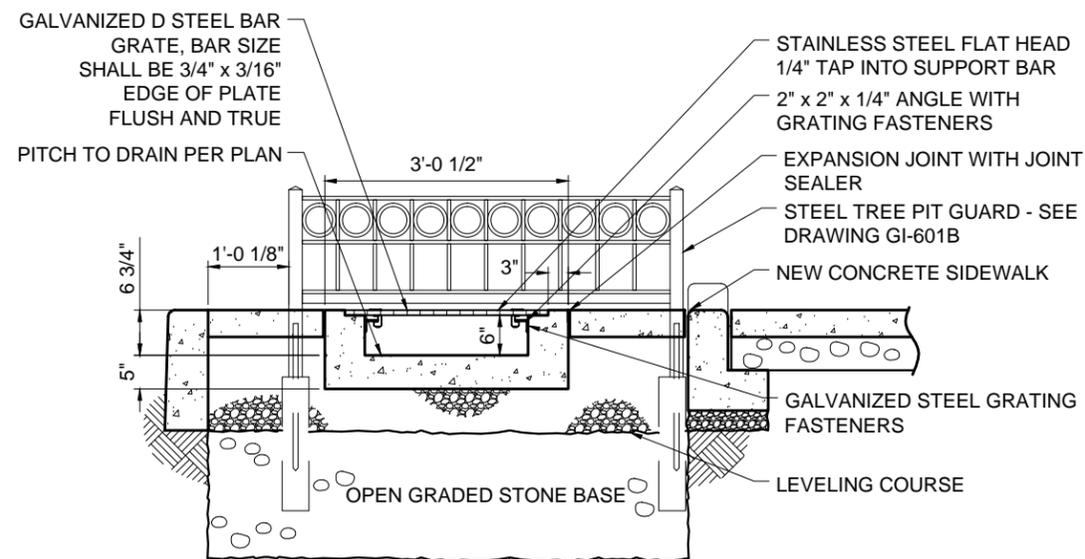

METAL GRATE PATHWAY SECTION C-C

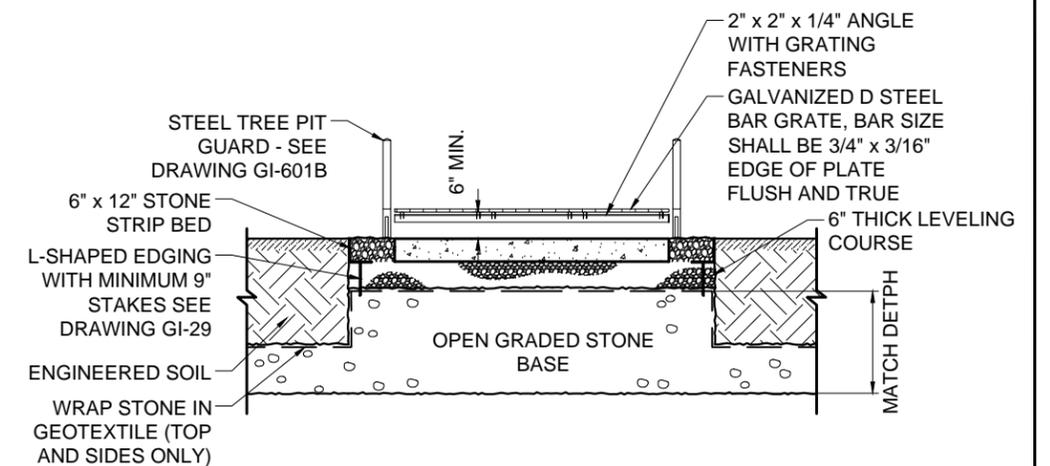



METAL GRATE PATHWAY SECTION D-D

**GI-400
GUIDELINES FOR ON-SITE
GREEN INFRASTRUCTURE
PRACTICES**


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

GUIDELINES FOR LAYOUT OF ON-SITE BIORETENTION RAIN GARDEN

- NO CONNECTION TO SEWERS

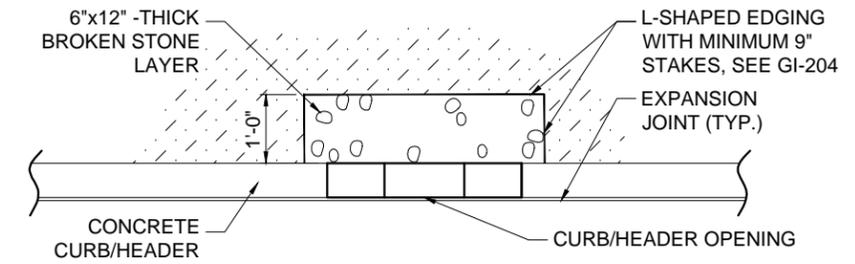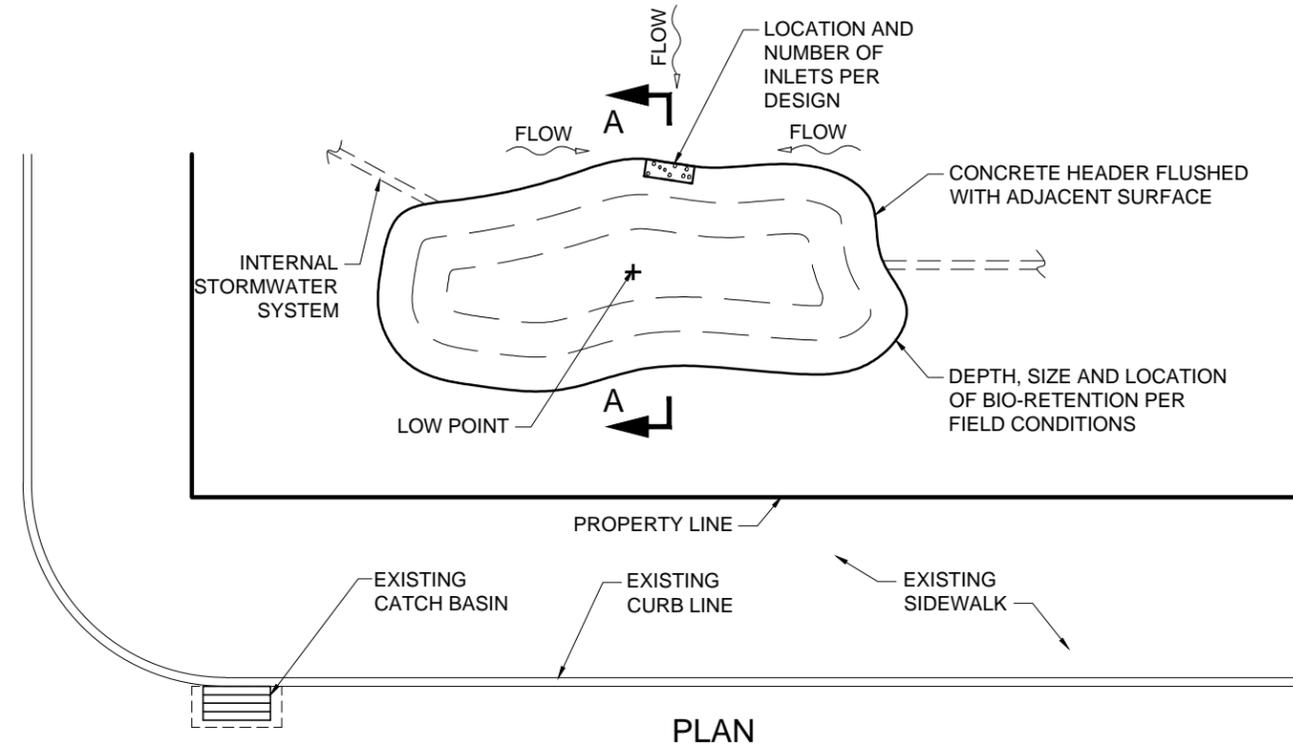

NOTES:
SUBMIT X-SECTION AND PLAN FOR ALTERNATE DESIGN.




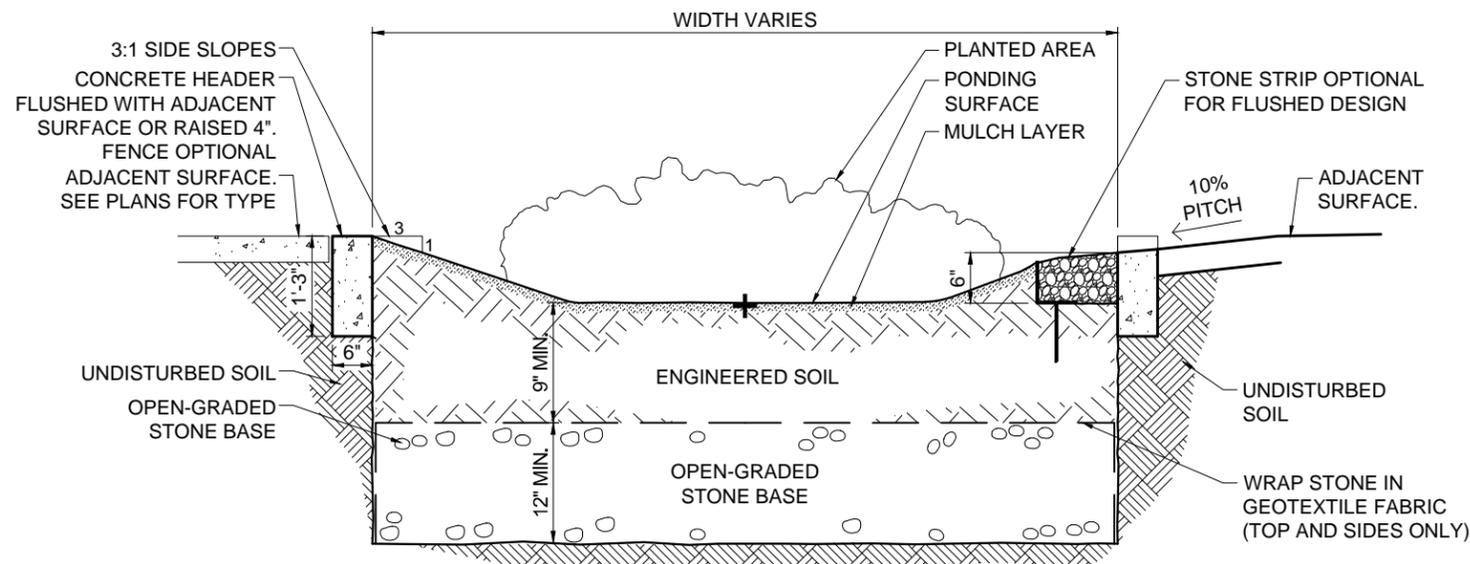


- GENERAL NOTES:
1. USE OFFICE OF GREEN INFRASTRUCTURE SPECIFICATIONS WHERE APPLICABLE UNLESS OTHERWISE DIRECTED/ PER OWNER AGENCY
 2. CLEARANCE TO: BUILDINGS, STRUCTURES/ FOUNDATIONS, VAULTS, RETAINING WALLS AND OTHERS AS REQUIRED
 3. PLANTING PLAN PER OWNER AGENCY REQUIREMENTS

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

GUIDELINES FOR ON-SITE POROUS AND PERMEABLE SURFACES


- NO CONNECTION TO SEWERS

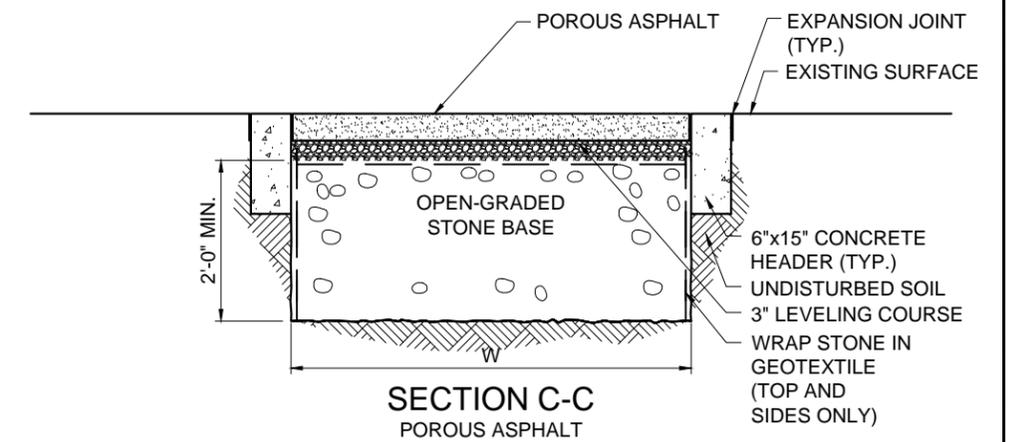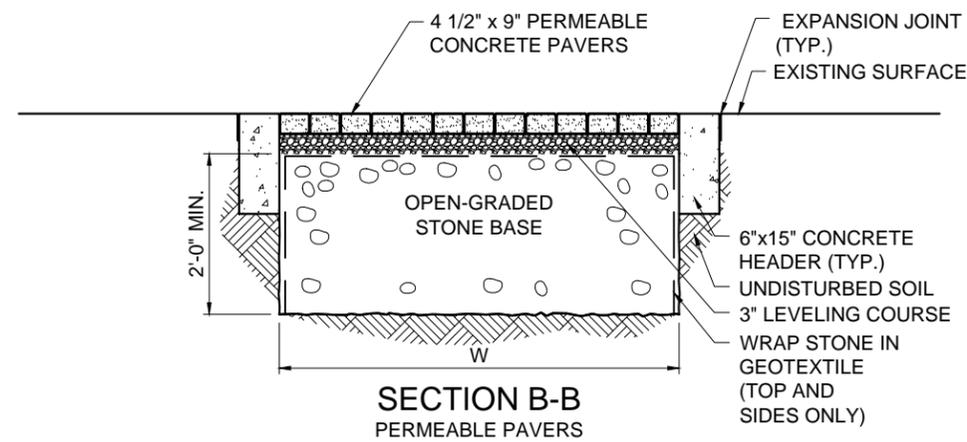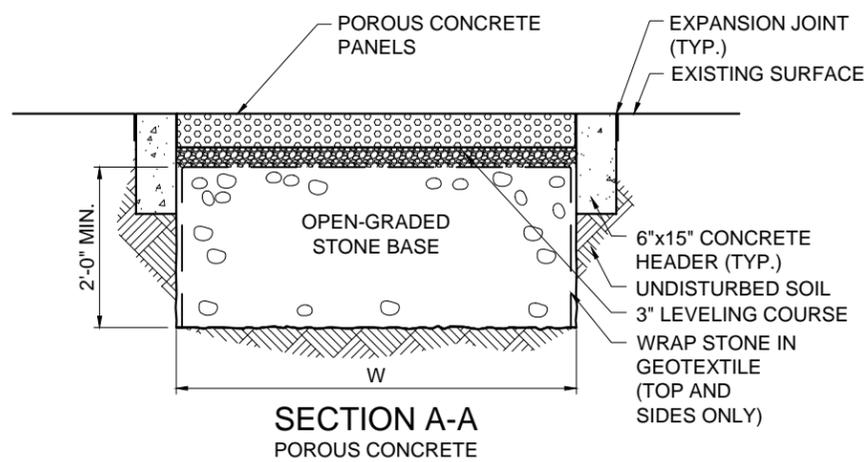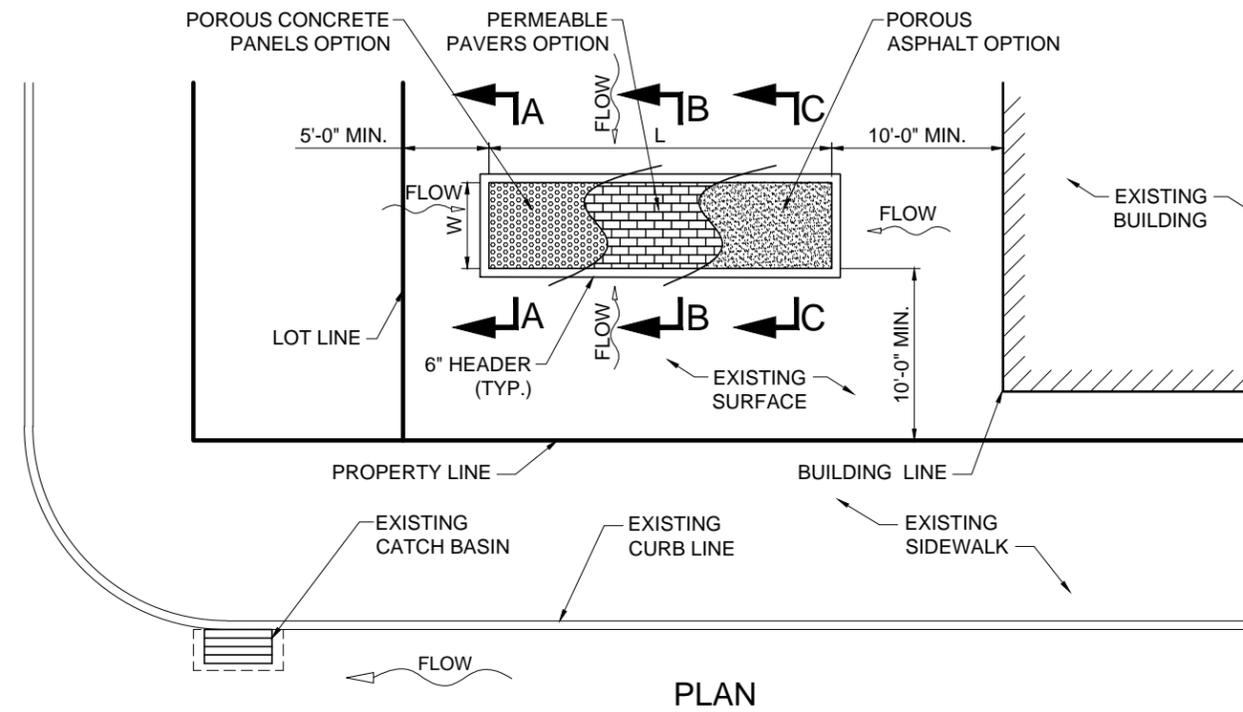


CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

GUIDELINES FOR ON-SITE SUBSURFACE STORMWATER RETENTION CHAMBER


- NO CONNECTION TO SEWERS

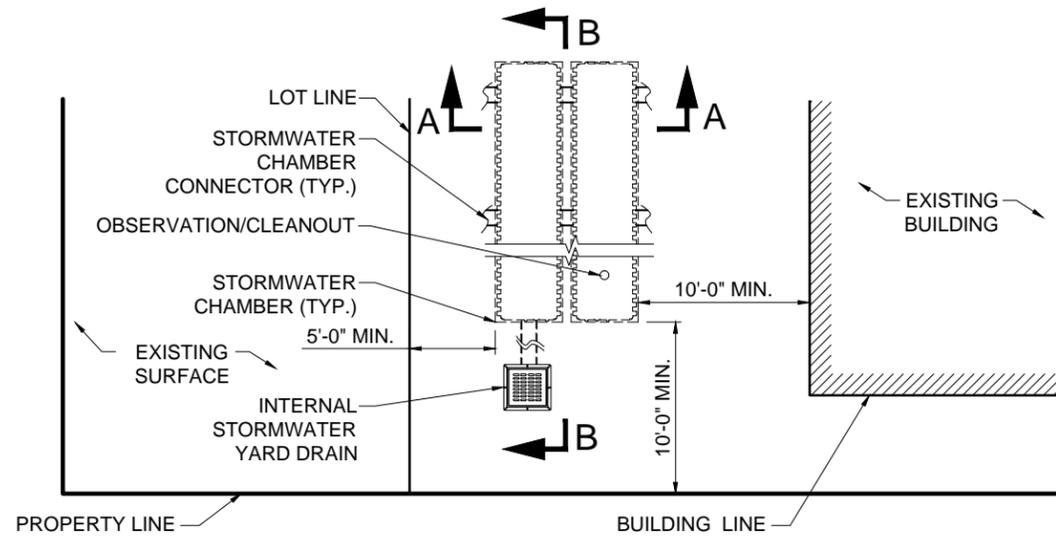

PLAN

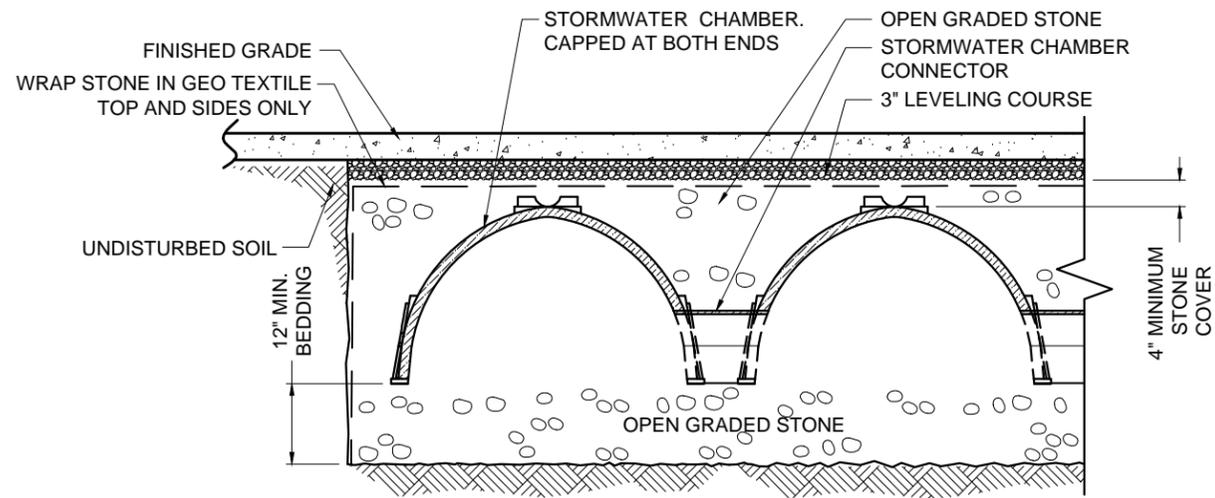

SECTION A-A

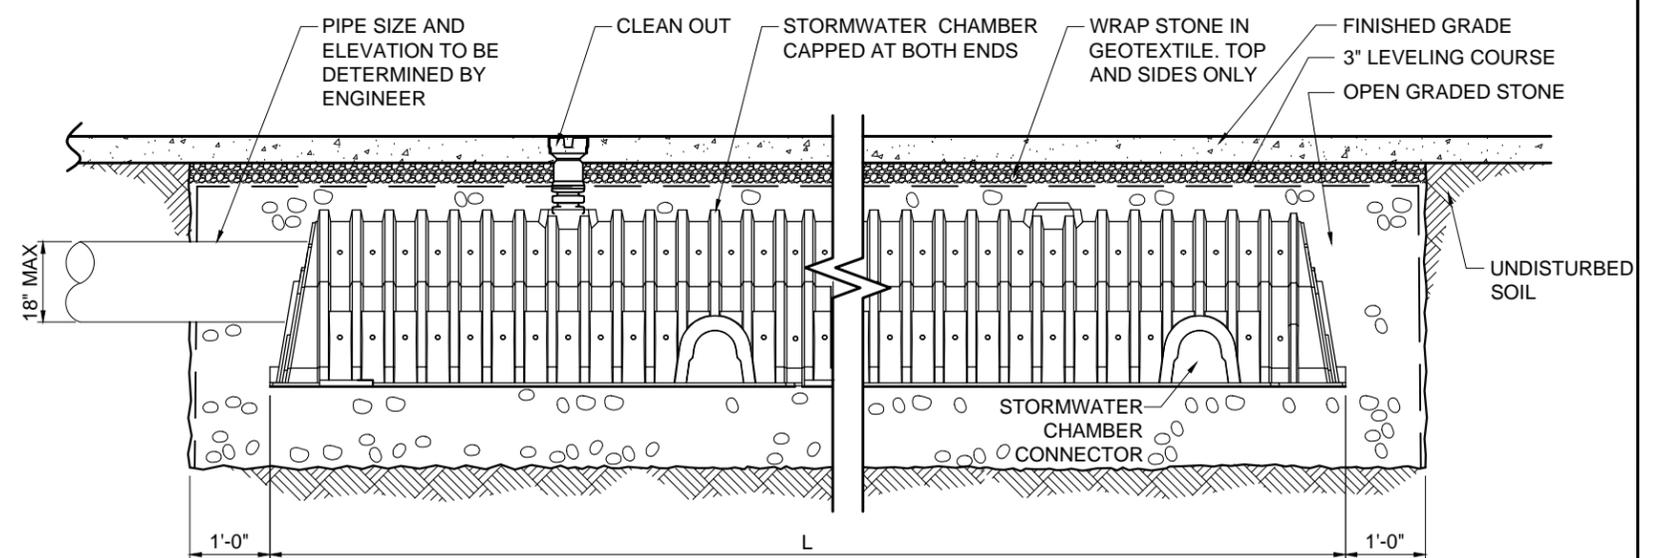

SECTION B-B


**GI-500
PLANTING PLANS FOR
RIGHT-OF-WAY GREEN INFRASTRUCTURE
PRACTICES**

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

RESIDENTIAL PLAN 1 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
8	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	ROSE	ROSA 'RADRAZZ' KNOCK OUT	SHRUB ROSE	#5 CONT. OR B&B	
22	B	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	
31	C	A	GROUNDCOVER	LIRIOPE SPICATA	LILY TURF	#1 CONT.	12" O.C.
		B	GROUNDCOVER	LIRIOPE MUSCARI 'MONROE WHITE'	LILY TURF	#1 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
5	B	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	
1	C	A	GROUNDCOVER	LIRIOPE SPICATA	LILY TURF	#1 CONT.	12" O.C.
		B	GROUNDCOVER	LIRIOPE MUSCARI 'MONROE WHITE'	LILY TURF	#1 CONT.	

RESIDENTIAL PLAN 2 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
20	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	
8	B	A	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	18" O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	
11	C	A	PERENNIAL	ECHINACEA PURPUREA 'KIM'S KNEEE HIGH'	PURPLE CONE FLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	
6	D	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
4	C	A	PERENNIAL	ECHINACEA PURPUREA 'KIM'S KNEEE HIGH'	PURPLE CONE FLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	

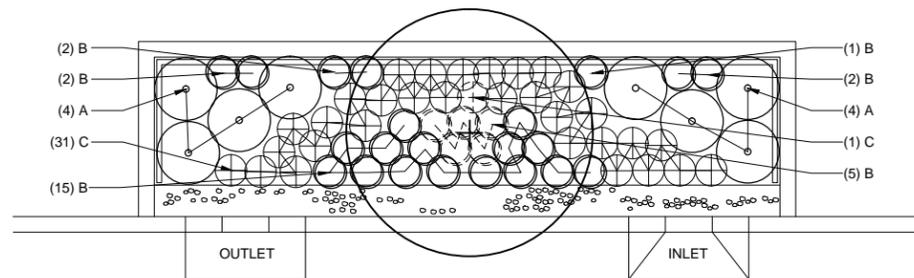

RESIDENTIAL PLAN 1
ROWBS IN RESIDENTIAL NEIGHBORHOODS WITH LOW VOLUME CIRCULATION

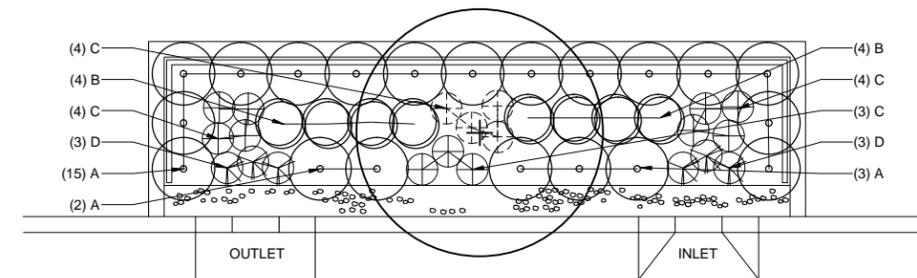

RESIDENTIAL PLAN 2
ROWBS IN RESIDENTIAL NEIGHBORHOODS WITH LOW VOLUME CIRCULATION

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.

R.L.A., LEED AP

DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016

DATE

P.E., F. ASCE

ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016


DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

URBAN PLAN 1 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
6	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	
12	B	A	PERENNIAL	HIBISCUS MOSCHEUTOS 'LUNA PINK'	HARDY HIBISCUS	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	
48	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'LITTLE BUNNY'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
2	B	A	PERENNIAL	HIBISCUS MOSCHEUTOS 'LUNA PINK'	HARDY HIBISCUS	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	
4	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'LITTLE BUNNY'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	

URBAN PLAN 2 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
21	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	
8	B	A	PERENNIAL	ECHINACEA SIMULATA	GLADE PURPLE CONEFLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
6	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	PENNISETUM ALOPECUROIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	
7	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'HEAVY METAL'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'HEAVY METAL'	SWITCH GRASS	#2 CONT.	

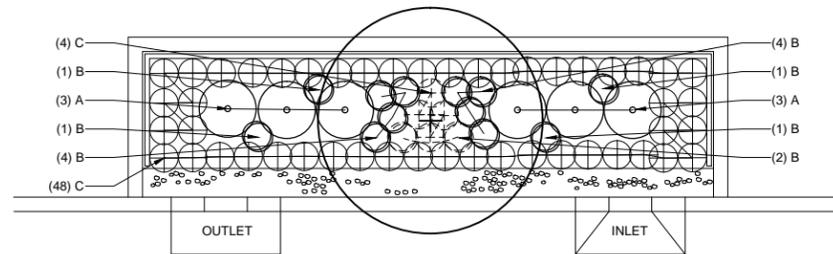

URBAN PLAN 1
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

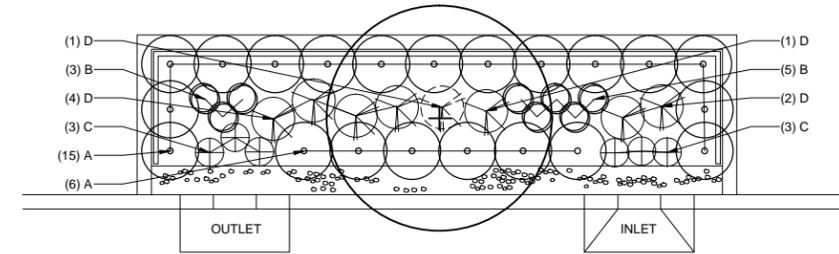

URBAN PLAN 2
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.

R.L.A., LEED AP

DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016

DATE

P.E., F. ASCE

ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016

DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

URBAN PLAN 3 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
18	A	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
19	B	A	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	12" O.C.
		B	PERENNIAL	HYLOTELEPHIUM 'VERA JAMESON'	STONECROP	#2 CONT.	
18	C	A	PERENNIAL	HEMEROCALIS 'SCARLET OAK'	DAYLILY	#2 CONT.	12" O.C.
		B	GRASSES	HELICTOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	
12	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
2	A	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
1	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	

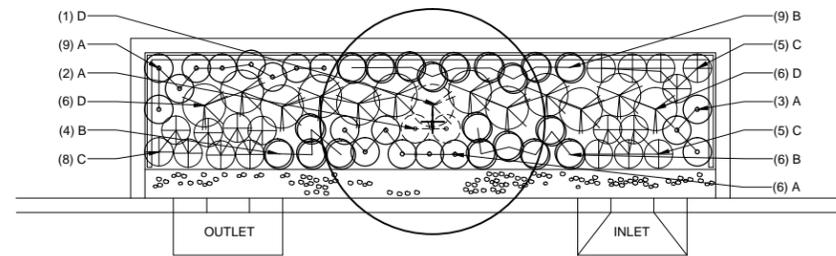

URBAN PLAN 3
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

SHADY PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
6	A	A	SHRUB	ITEA VIRGINICA 'LITTLE HENRY'	VIRGINIA SWEETSPIRE	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	
27	B	A	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	12" O.C.
		B	GRASSES	HAKONECHLOA MACRA 'ALL GOLD'	JAPANESE FOREST GRASS	#2 CONT.	
11	C	A	PERENNIAL	ASTILBE 'DEUTSCHLAND'	ASTILBE	#2 CONT.	12" O.C.
		B	PERENNIAL	ASTILBE CHINENSIS 'VISION IN RED'	CHINESE ASTILBE	#2 CONT.	
20	D	A	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	12" O.C.
		B	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
3	B	A	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	12" O.C.
		B	GRASSES	HAKONECHLOA MACRA 'ALL GOLD'	JAPANESE FOREST GRASS	#2 CONT.	
3	D	A	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	12" O.C.
		B	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	

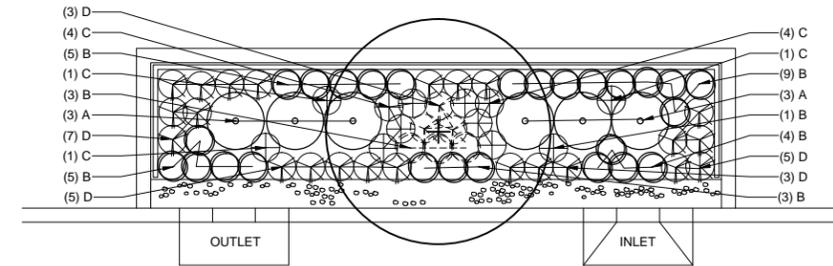

ESPECIALLY SHADY PLAN
ROWBS WITH PARTLY SUNNY OR SHADY LIGHT CONDITIONS

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.

R.L.A., LEED AP

DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016

DATE

P.E., F. ASCE

ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016


DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 1 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

DRY PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
24	A	A	GRASSES	PENNISETUM ALOPECURIOIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	HELICTOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	
13	B	A	GRASSES	PENNISETUM ALOPECURIOIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
2	A	A	GRASSES	PENNISETUM ALOPECURIOIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	HELICTOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	

WET PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
28	A	A	PERENNIAL	BRUNNERA MACROPHYLLA 'JACK FROST'	SIBERIAN BUGLOSS	#2 CONT.	12" O.C.
		B	PERENNIAL	ACHEMILLA MOLLIS	LADY'S MANTLE	#2 CONT.	
11	B	A	PERENNIAL	IRIS VERSICOLOR	BLUE FLAG	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
30	C	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	PERENNIAL	HEMEROCALLIS 'LADY FLORENCE'	DAYLILY	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
4	C	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	PERENNIAL	HEMEROCALLIS 'LADY FLORENCE'	DAYLILY	#2 CONT.	

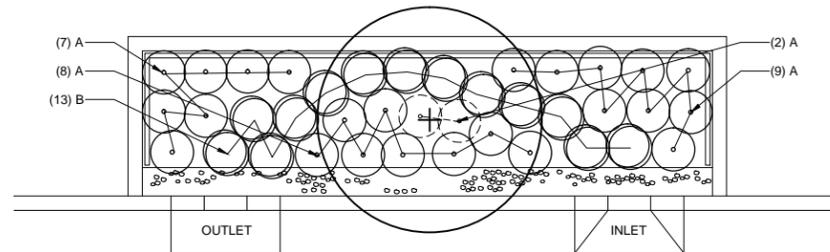

ESPECIALLY DRY PLAN
ROWBS WITH LESS THAN 15% STORMWATER RUNOFF MANAGED

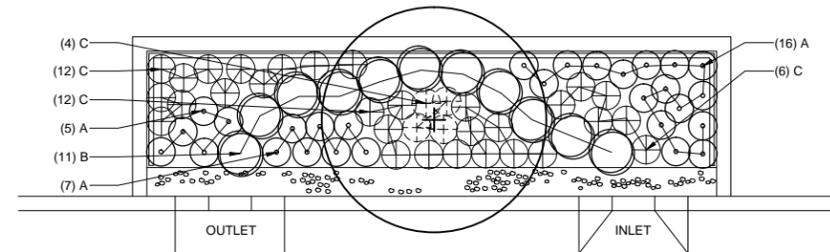

ESPECIALLY WET PLAN
ROWBS WITH GREATER THAN 30% STORMWATER RUNOFF MANAGED

- NOTES:**
1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
 2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
 3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
 4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.


R.L.A., LEED AP
DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016
DATE


P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

RESIDENTIAL PLAN 1 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
6	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	ROSE	ROSA 'RADRAZZ' KNOCK OUT	SHRUB ROSE	#5 CONT. OR B&B	
27	B	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	
19	C	A	GROUNDCOVER	LIRIOPE SPICATA	LILY TURF	#1 CONT.	12" O.C.
		B	GROUNDCOVER	LIRIOPE MUSCARI 'MONROE WHITE'	LILY TURF	#1 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
4	B	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	

RESIDENTIAL PLAN 2 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
16	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	
6	B	A	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	18" O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	
7	C	A	PERENNIAL	ECHINACEA PURPUREA 'KIM'S KNEEE HIGH'	PURPLE CONE FLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	
8	D	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	B	A	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	18" O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	

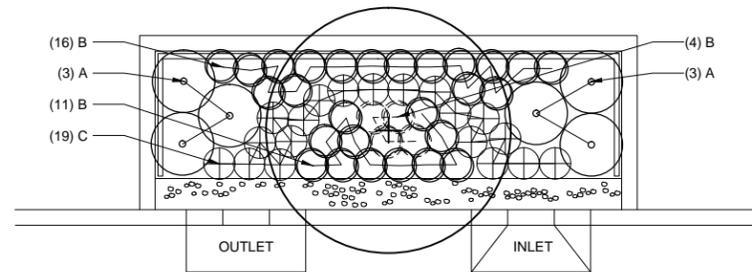

RESIDENTIAL PLAN 1
ROWBS IN RESIDENTIAL NEIGHBORHOODS WITH LOW VOLUME CIRCULATION

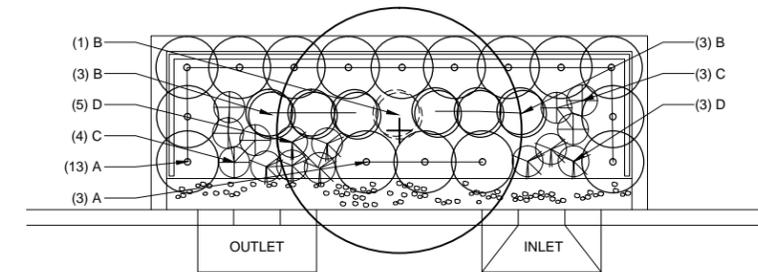

RESIDENTIAL PLAN 2
ROWBS IN RESIDENTIAL NEIGHBORHOODS WITH LOW VOLUME CIRCULATION

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.

R.L.A., LEED AP

DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016

DATE

P.E., F. ASCE

ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016


DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

URBAN PLAN 1 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
4	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	
11	B	A	PERENNIAL	HIBISCUS MOSCHEUTOS 'LUNA PINK'	HARDY HIBISCUS	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	
38	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'LITTLE BUNNY'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
3	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'LITTLE BUNNY'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	

URBAN PLAN 2 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
15	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	
7	B	A	PERENNIAL	ECHINACEA SIMULATA	GLADE PURPLE CONEFLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
8	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	PENNISETUM ALOPECUROIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	
6	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'HEAVY METAL'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'HEAVY METAL'	SWITCH GRASS	#2 CONT.	

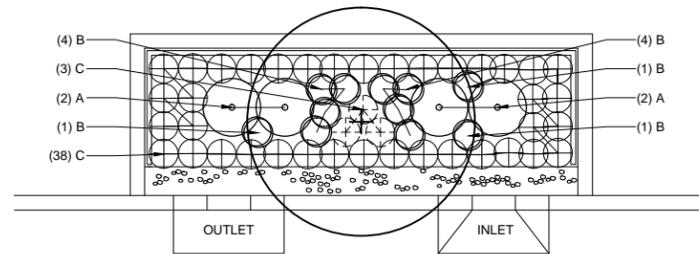

URBAN PLAN 1
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

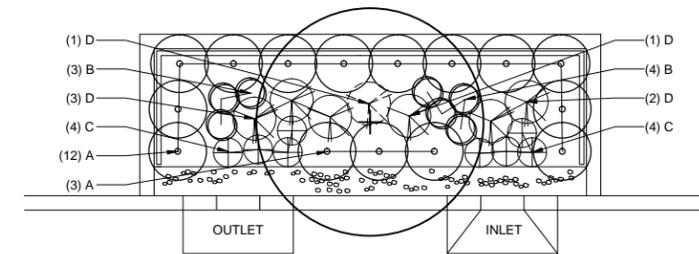

URBAN PLAN 2
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.

R.L.A., LEED AP

DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016

DATE

P.E., F. ASCE

ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016

DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

URBAN PLAN 3 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
14	A	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
18	B	A	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	12" O.C.
		B	PERENNIAL	HYLOTELEPHIUM 'VERA JAMESON'	STONECROP	#2 CONT.	
13	C	A	PERENNIAL	HEMEROCALIS 'SCARLET OAK'	DAYLILY	#2 CONT.	12" O.C.
		B	GRASSES	HELICTOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	
8	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN ROWB WITH NO TREE							
2	A	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
1	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	

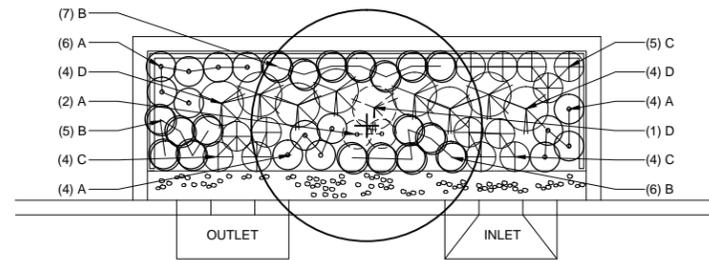

URBAN PLAN 3
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

SHADY PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
4	A	A	SHRUB	ITEA VIRGINICA 'LITTLE HENRY'	VIRGINIA SWEETSPIRE	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	
22	B	A	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	12" O.C.
		B	GRASSES	HAKONECHLOA MACRA 'ALL GOLD'	JAPANESE FOREST GRASS	#2 CONT.	
10	C	A	PERENNIAL	ASTILBE 'DEUTSCHLAND'	ASTILBE	#2 CONT.	12" O.C.
		B	PERENNIAL	ASTILBE CHINENSIS 'VISION IN RED'	CHINESE ASTILBE	#2 CONT.	
16	D	A	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	12" O.C.
		B	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
2	B	A	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	12" O.C.
		B	GRASSES	HAKONECHLOA MACRA 'ALL GOLD'	JAPANESE FOREST GRASS	#2 CONT.	
3	D	A	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	12" O.C.
		B	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	

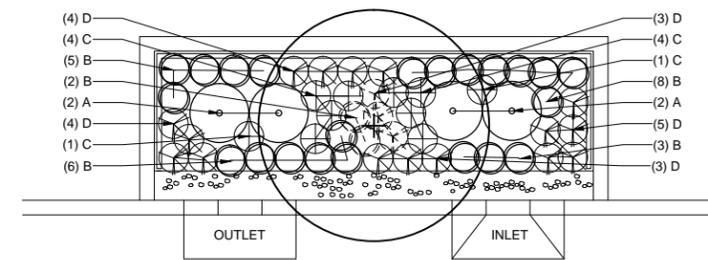

ESPECIALLY SHADY PLAN
ROWBS WITH PARTLY SUNNY OR SHADY LIGHT CONDITIONS

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.


R.L.A., LEED AP
DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016
DATE


P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 2 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

DRY PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
19	A	A	GRASSES	PENNISETUM ALOPECURIODES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	HELICTOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	
11	B	A	GRASSES	PENNISETUM ALOPECURIODES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	A	A	GRASSES	PENNISETUM ALOPECURIODES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	HELICTOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	

WET PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
21	A	A	PERENNIAL	BRUNNERA MACROPHYLLA 'JACK FROST'	SIBERIAN BUGLOSS	#2 CONT.	12" O.C.
		B	PERENNIAL	ACHEMILLA MOLLIS	LADY'S MANTLE	#2 CONT.	
9	B	A	PERENNIAL	IRIS VERSICOLOR	BLUE FLAG	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
25	C	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	PERENNIAL	HEMEROCALLIS 'LADY FLORENCE'	DAYLILY	#2 CONT.	
ONLY PLANTED IN ROWB WITH NO TREE							
4	C	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	PERENNIAL	HEMEROCALLIS 'LADY FLORENCE'	DAYLILY	#2 CONT.	

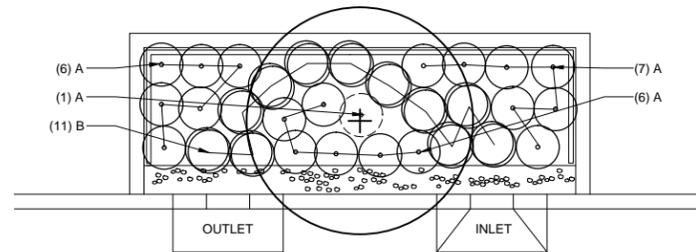


ESPECIALLY DRY PLAN
ROWBS WITH LESS THAN 15% STORMWATER RUNOFF MANAGED

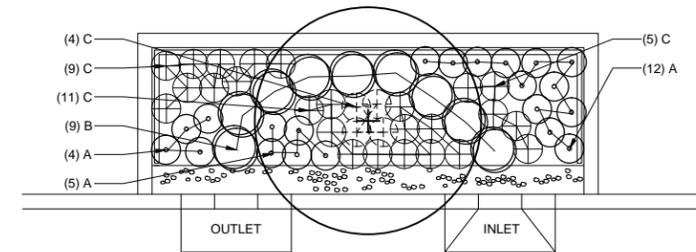


ESPECIALLY WET PLAN
ROWBS WITH GREATER THAN 30% STORMWATER RUNOFF MANAGED

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.


R.L.A., LEED AP
DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016
DATE



P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

RESIDENTIAL PLAN 1 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
4	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	ROSE	ROSA 'RADRAZZ' KNOCK OUT	SHRUB ROSE	#5 CONT. OR B&B	
13	B	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	
12	C	A	GROUNDCOVER	LIRIOPE SPICATA	LILY TURF	#1 CONT.	12" O.C.
		B	GROUNDCOVER	LIRIOPE MUSCARI 'MONROE WHITE'	LILY TURF	#1 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	B	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	
2	C	A	GROUNDCOVER	LIRIOPE SPICATA	LILY TURF	#1 CONT.	12" O.C.
		B	GROUNDCOVER	LIRIOPE MUSCARI 'MONROE WHITE'	LILY TURF	#1 CONT.	

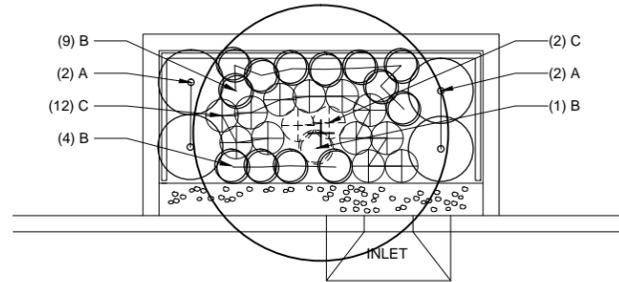

RESIDENTIAL PLAN 1
ROWBS IN RESIDENTIAL NEIGHBORHOODS WITH LOW VOLUME CIRCULATION

RESIDENTIAL PLAN 2 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
11	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	
4	B	A	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	18" O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	
3	C	A	PERENNIAL	ECHINACEA PURPUREA 'KIM'S KNEEE HIGH'	PURPLE CONE FLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	
5	D	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	B	A	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	18" O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	
2	C	A	PERENNIAL	ECHINACEA PURPUREA 'KIM'S KNEEE HIGH'	PURPLE CONE FLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	

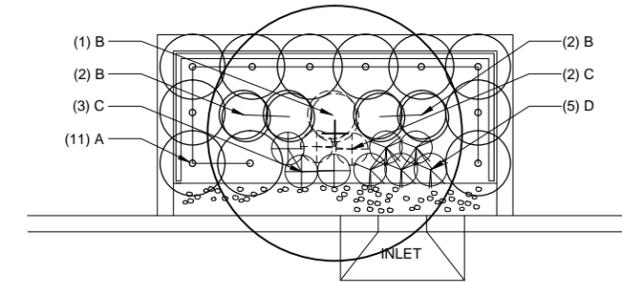

RESIDENTIAL PLAN 2
ROWBS IN RESIDENTIAL NEIGHBORHOODS WITH LOW VOLUME CIRCULATION

- NOTES:**
1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
 2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
 3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
 4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.


R.L.A., LEED AP
DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016
DATE


P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

URBAN PLAN 1 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
2	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	ROSE	ROSA PALUSTRIS	SWAMP ROSE	#2/#3 CONT.	
3	B	A	PERENNIAL	HIBISCUS MOSCHEUTOS 'LUNA PINK'	HARDY HIBISCUS	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	
28	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'LITTLE BUNNY'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
5	B	A	PERENNIAL	HIBISCUS MOSCHEUTOS 'LUNA PINK'	HARDY HIBISCUS	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA SUBTOMENTOSA 'HENRY EILERS'	SWEET CONEFLOWER	#2 CONT.	

URBAN PLAN 2 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
12	A	A	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	ILEX GLABRA 'SHAMROCK'	INKBERRY	#5 CONT. OR B&B	
5	B	A	PERENNIAL	ECHINACEA SIMULATA	GLADE PURPLE CONEFLOWER	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
3	C	A	GRASSES	PENNISETUM ALOPECUROIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	12" O.C.
		B	GRASSES	PENNISETUM ALOPECUROIDES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	
4	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'HEAVY METAL'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'HEAVY METAL'	SWITCH GRASS	#2 CONT.	

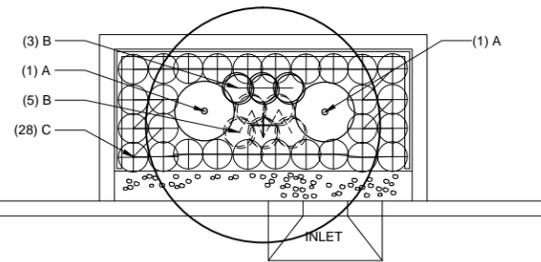

URBAN PLAN 1
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

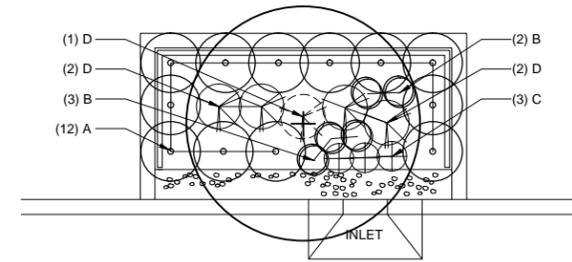

URBAN PLAN 2
ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.

R.L.A., LEED AP

DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016

DATE

P.E., F. ASCE

ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016

DATE


CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE

STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

URBAN PLAN 3 PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
16	A	A	PERENNIAL	COREOPSIS 'REDSHIFT'	TICKSEED	#2 CONT.	12" O.C.
		B	PERENNIAL	RUDBECKIA FULGIDA 'GOLDSTURM'	BLACK-EYED SUSAN	#2 CONT.	
15	B	A	PERENNIAL	NEPETA X FAASSENII 'WALKER'S LOW'	CATMINT	#2 CONT.	12" O.C.
		B	PERENNIAL	HYLOTELEPHIUM 'VERA JAMESON'	STONECROP	#2 CONT.	
7	C	A	PERENNIAL	HEMEROCALIS 'SCARLET OAK'	DAYLILY	#2 CONT.	12" O.C.
		B	GRASSES	HELIOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	
4	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
ONLY PLANTED IN ROWB WITH NO TREE							
1	D	A	GRASSES	CHASMANTHIUM LATIFOLIUM	NORTHERN SEA OATS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.

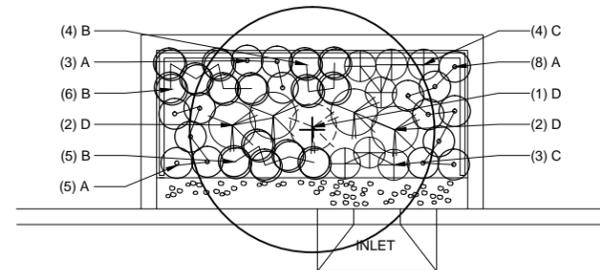

URBAN PLAN 3
 ROWBS IN COMMERCIAL AND INDUSTRIAL AREAS WITH HIGHER VOLUME CIRCULATION

R.L.A., LEED AP

DIRECTOR OF GREEN INFRASTRUCTURE
 DEPARTMENT OF PARKS AND RECREATION

03-07-2016

DATE

P.E., F. ASCE

ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016

DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS

SHADY PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
3	A	A	SHRUB	ITEA VIRGINICA 'LITTLE HENRY'	VIRGINIA SWEETSPIRE	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	
19	B	A	GRASSES	CAREX 'ICE DANCE'	SEDGE	#2 CONT.	12" O.C.
		B	GRASSES	HAKONECHLOA MACRA 'ALL GOLD'	JAPANESE FOREST GRASS	#2 CONT.	
4	C	A	PERENNIAL	ASTILBE 'DEUTSCHLAND'	ASTILBE	#2 CONT.	12" O.C.
		B	PERENNIAL	ASTILBE CHINENSIS 'VISION IN RED'	CHINESE ASTILBE	#2 CONT.	
12	D	A	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	12" O.C.
		B	GROUNDCOVER	AJUGA REPTANS 'CATLIN'S GIANT'	BUGLEWEED	#1 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
1	A	A	SHRUB	ITEA VIRGINICA 'LITTLE HENRY'	VIRGINIA SWEETSPIRE	#5 CONT. OR B&B	2' O.C.
		B	SHRUB	CLETHRA ANIFOLIA 'HUMMINGBIRD'	SWEET PEPPERBUSH	#5 CONT. OR B&B	

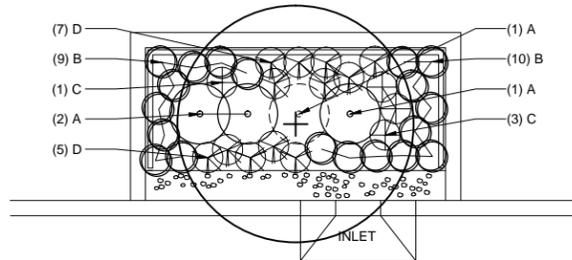


ESPECIALLY SHADY PLAN
ROWBS WITH PARTLY SUNNY OR SHADY LIGHT CONDITIONS

DRY PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
11	A	A	GRASSES	PENNISETUM ALOPECURIODES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	HELICTOTRICHON SEMPERVIRENS	BLUE OAT GRASS	#2 CONT.	
9	B	A	GRASSES	PENNISETUM ALOPECURIODES 'HAMELN'	FOUNTAIN GRASS	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	

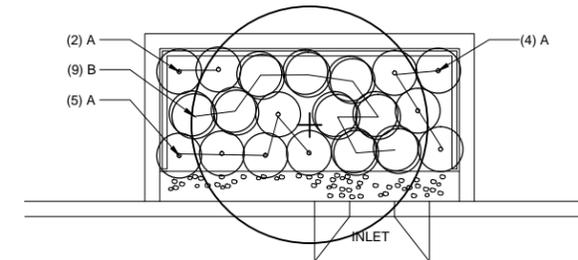

ESPECIALLY DRY PLAN
ROWBS WITH LESS THAN 15% STORMWATER RUNOFF MANAGED

WET PLAN PLANT SCHEDULE							
QUAN	KEY	PLAN VERSION	TYPE	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
19	A	A	PERENNIAL	BRUNNERA MACROPHYLLA 'JACK FROST'	SIBERIAN BUGLOSS	#2 CONT.	12" O.C.
		B	PERENNIAL	ACHEMILLA MOLLIS	LADY'S MANTLE	#2 CONT.	
6	B	A	PERENNIAL	IRIS VERSICOLOR	BLUE FLAG	#2 CONT.	18" O.C.
		B	GRASSES	PANICUM VIRGATUM 'SHENANDOAH'	SWITCH GRASS	#2 CONT.	
15	C	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	PERENNIAL	HEMEROCALLIS 'LADY FLORENCE'	DAYLILY	#2 CONT.	
ONLY PLANTED IN R.O.W. RAIN GARDEN OR R.O.W. BIOSWALE WITH NO TREE							
3	C	A	GRASSES	ACORUS CALAMUS 'VARIEGATUS'	SWEETFLAG	#2 CONT.	12" O.C.
		B	PERENNIAL	HEMEROCALLIS 'LADY FLORENCE'	DAYLILY	#2 CONT.	

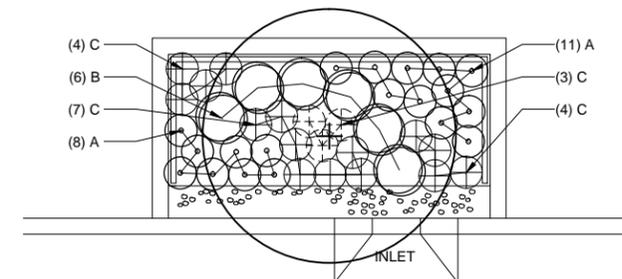

ESPECIALLY WET PLAN
ROWBS WITH GREATER THAN 30% STORMWATER RUNOFF MANAGED

- NOTES:**
1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
 2. TREES TO BE INCLUDED IN PLANTING PLANS UPON DIRECTION OF DPR.
 3. THE AREA DIRECTLY ABOVE THE TREE ROOTBALL IS NOT TO BE PLANTED WITH SHRUBS, PERENNIALS, OR GRASSES.
 4. PLANTING PLANS FOR VARIABLE SIZE R.O.W. BIOSWALES AND R.O.W. RAIN GARDENS ARE DETERMINED AS PER THE SCHEDULE ON GI-122.


R.L.A., LEED AP
DIRECTOR OF GREEN INFRASTRUCTURE
DEPARTMENT OF PARKS AND RECREATION

03-07-2016
DATE


P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPES 1 & TYPE 2 R.O.W. GREENSTRIPS

FULL SUN PLANT SCHEDULE					
QTY.	KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
3	ST	SPIREA TOMENTOSA	MEADOW SWEET	#3 CONT.	2' O.C.
10	ES	ERAGROTIS SPECTABILIS	PURPLE LOVEGRASS	#2 CONT.	12" O.C.
12	AT	ASCLEPIAS TUBEROSA	BUTTERFLY WEED	#2 CONT.	12" O.C.
12	EP	ECHINACEA PURPUREA	PURPLE CONEFLOWER	#2 CONT.	12" O.C.

SUN/PART SHADE PLANT SCHEDULE					
QTY.	KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
3	CA	CEANOTHUS AMERICANUS	NEW JERSEY TEA	#3 CONT.	2' O.C.
2	DL	DIERVILLA LONICERA	DWARF BUSH HONEYSUCKLE	#3 CONT.	2' O.C.
8	PD	PENSTEMON DIGITALIS	WHITE BEARD TONGUE	PLUGS	12" O.C.

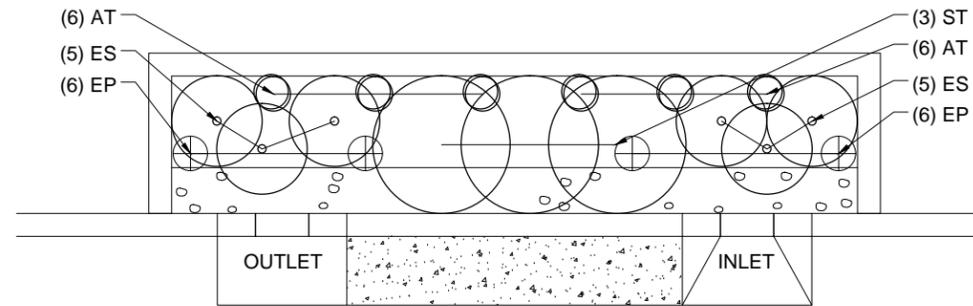

FULL SUN PLAN 1

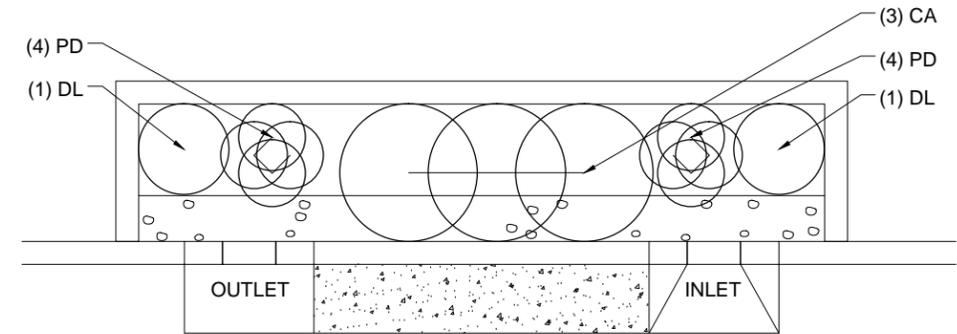

SUN/SHADE PLAN 1

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. PLANTING PLANS FOR VARIABLE SIZE R.O.W. GREEN STRIPS DETERMINED AS PER THE SCHEDULE ON GI-133.


Maedi Tava
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPES 1 & TYPE 2 R.O.W. GREENSTRIPS

FULL SUN PLANT SCHEDULE					
QTY.	KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
17	LM	LIRIOPE MUSCARI 'BIG BLUE'	BIG BLUE LILY TURF	#2 CONT.	12" O.C.
6	HM	HIBISCUS MOSCHEUTOS 'SOUTHERN BELLE'	SWAMP ROSE MALLOW	#2 CONT.	3' O.C.

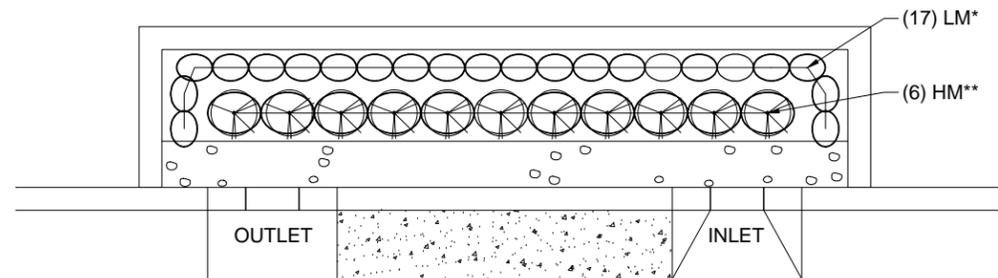


FULL SUN PLAN 2

SUN/PART SHADE PLANT SCHEDULE					
QTY.	KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
17	TV	TRADESCANTIA VIRGINIANA	VIRGINIA SPIDERWORT	#2 CONT.	12" O.C.
13	IV	IRIS VERSICOLOR	BLUE FLAG	#2 CONT.	12" O.C.

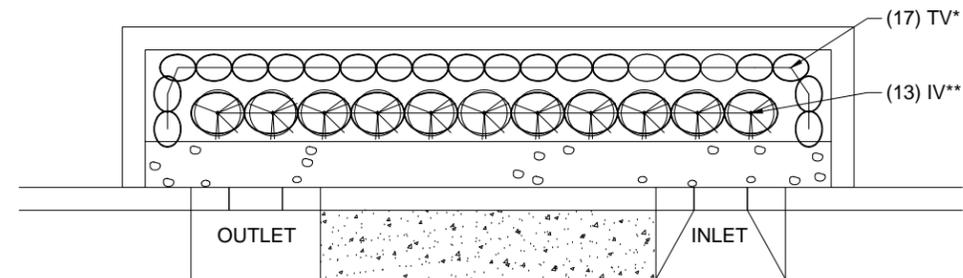

SUN/PART SHADE PLAN 2

RESIDENTIAL PLAN, WET, SUN TO PART SHADE					
QTY.	KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
16	MP	MONARDA DIDYMA 'PARDON MY PURPLE'	PARDON MY PURPLE - BEE BALM	#2 CONT.	12" O.C.
4	VIB	VERNONIA LETTERMANNII 'IRON BUTTERFLY'	NARROWLEAF IRONWEED	#2 CONT.	2' O.C.
9	CV	CAREX VULPINOIDEA	FOX SEDGE	#2 CONT.	18" O.C.

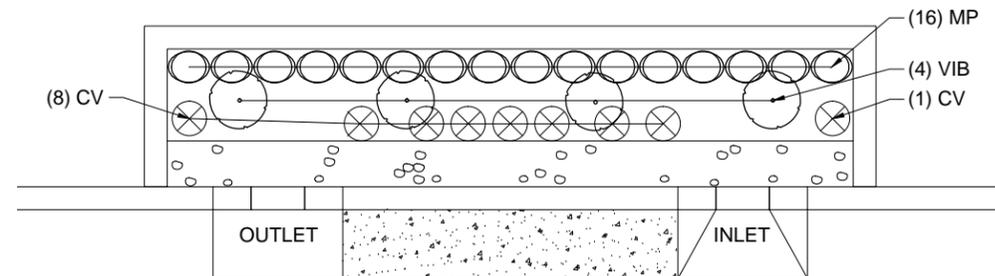

RESIDENTIAL PLAN, WET, SUN TO PART SHADE

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. PLANTING PLANS FOR VARIABLE SIZE R.O.W. GREEN STRIPS DETERMINED AS PER THE SCHEDULE ON GI-133.
3. * AROUND THE PERIMETER ON SLOPE.
4. ** EVENLY SPACED IN THE LOWEST, FLAT PORTION OF GREEN STRIP.

Maedi Tana
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
DATE

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE


STANDARD PLANTING PLANS FOR TYPE 3 R.O.W. GREENSTRIPS

PLANT SCHEDULE: SUN & DRY - OPTION 1					
QTY.	KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
SHRUBS					
2	RA	RHUS AROMATICA 'GRO LO'	DWARF BUSH HONEYSUCKLE	#3	8"
PERENNIALS					
6	VL	VERNONIA LETTERMANNII 'IRON BUTTERFLY'	NARROWLEAF IRONWEED	#2	1"
GRASSES					
8	CL	CAREX LURIDA	SHALLOW SEDGE	#2	1"

PLANT SCHEDULE: SUN & DRY - OPTION 2					
QTY.	KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING
PERENNIALS					
5	IV	IRIS VERSICOLOR	NORTHERN BLUE FLAG	#2	12"
6	LC	LOBELIA CARDINALIS	CARDINAL FLOWER	#2	18"
GRASSES					
3	CL	CHASMANTHIUM LATIFOLIUM	INDIAN WOOD	#2	18"-24"

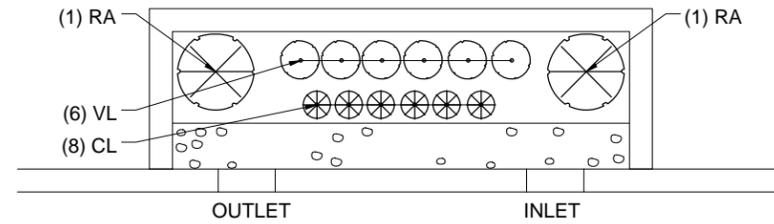

RESIDENTIAL PLAN SUN AND DRY - OPTION 1

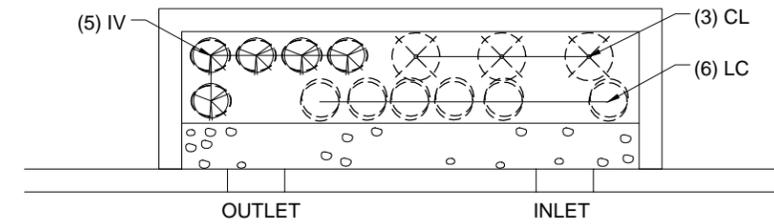

RESIDENTIAL PLAN SUN AND DRY - OPTION 2

NOTES:

1. PLANTING LOCATIONS ARE SPECIFIC TO THE INLET AND OUTLET ORIENTATION SHOWN. IF THE INLET AND OUTLET ORIENTATION IS REVERSED, THE PLANTING LOCATIONS MUST BE MIRRORED.
2. PLANTING PLANS FOR VARIABLE SIZE R.O.W. GREEN STRIPS DETERMINED AS PER THE SCHEDULE ON GI-133.



Maedi Tava
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

GI-600
STEEL GUARDS STANDARDS FOR
RIGHT-OF-WAY GREEN INFRASTRUCTURE
PRACTICES

CITY OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL PROTECTION
 OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. BIOSWALES - TYPE 'A' WELDED STEEL GUARD

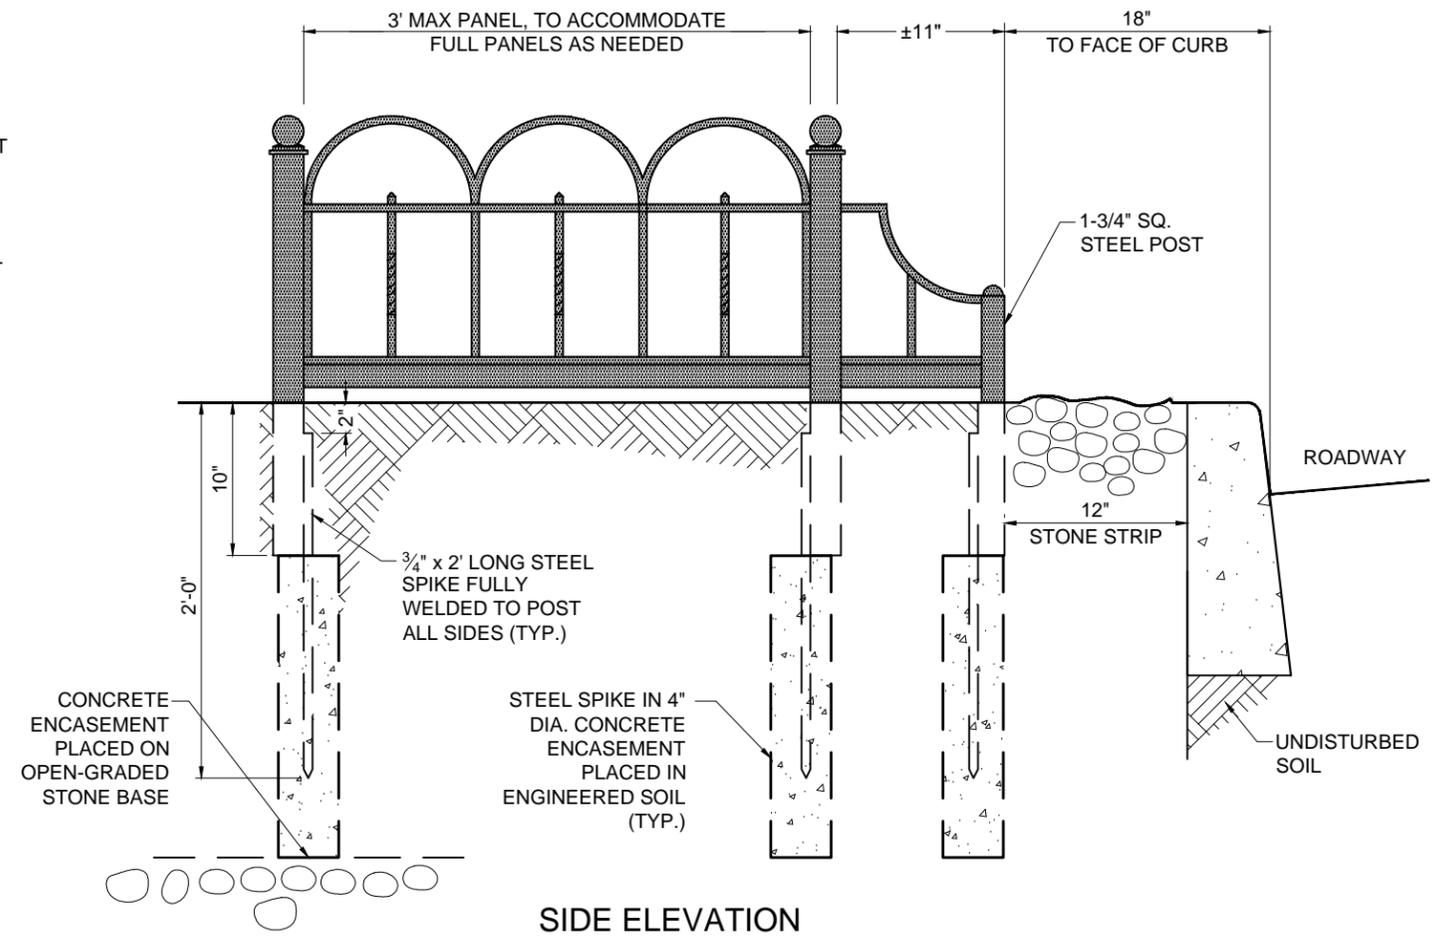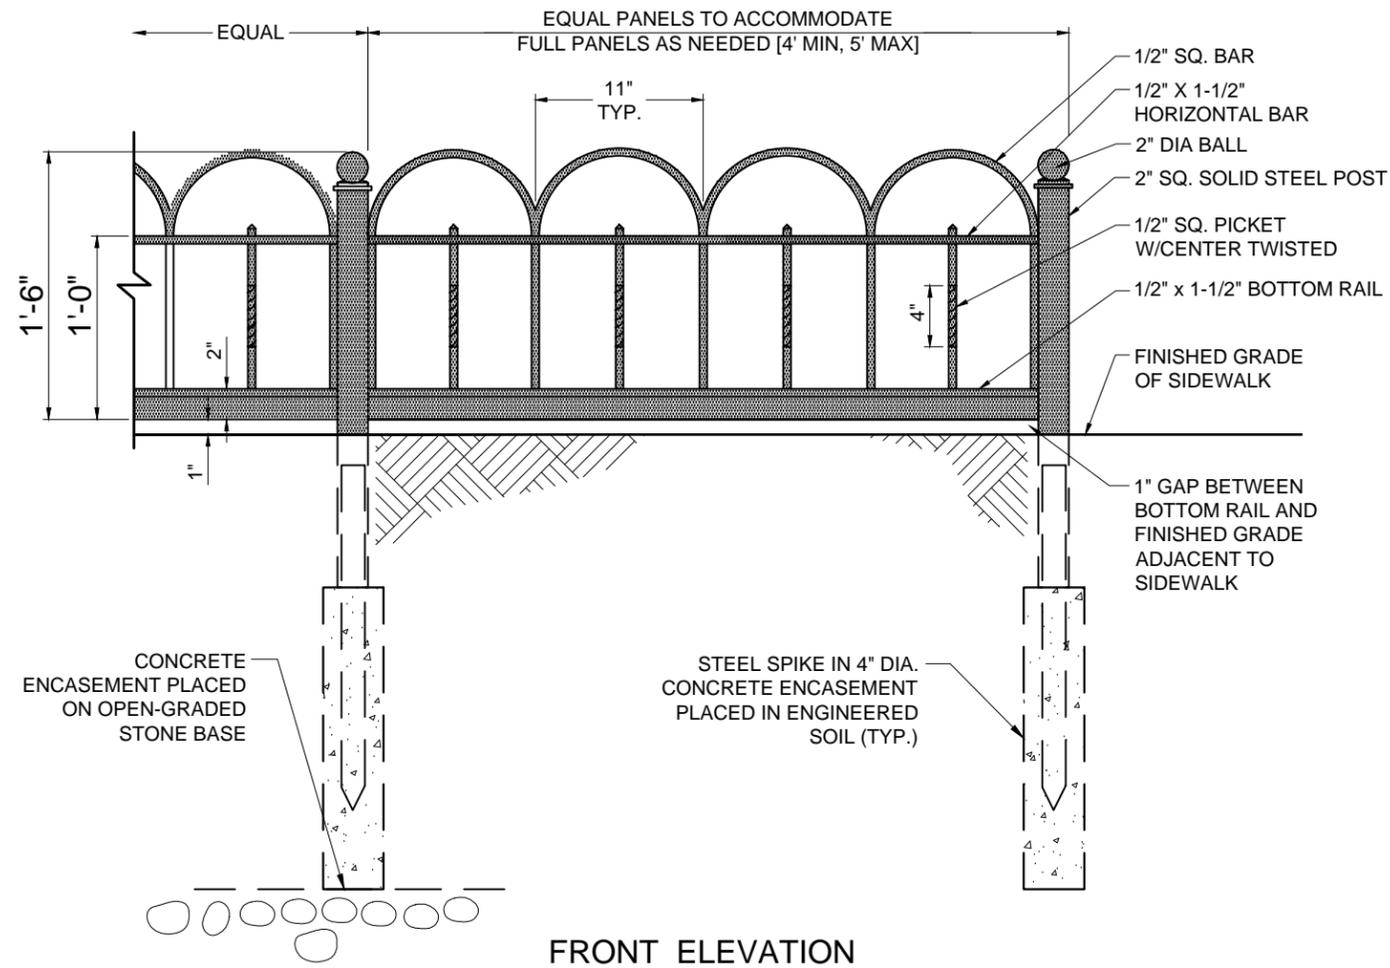

NOTES:

** FINAL DESIGN OF GUARDS TO BE SELECTED BY DPR/DOT UPON REVIEW OF NEIGHBORHOOD'S CONTEXT



1. FIELD MEASUREMENTS MUST BE TAKEN PRIOR TO FABRICATION.
2. ALL STEEL SHALL CONFORM TO SPECIFICATION C1015 OF THE A.I.S.I.
3. ALL JOINTS TO BE WELDED UNLESS NOTED OTHERWISE.
4. ALL STEEL TO BE PAINTED WITH ONE (1) SHOP COAT OF PRIMER AND ONE (1) SHOP COAT OF INTERMEDIATE AND ONE (1) SHOP COAT (OR ROLLED FIELD COAT) OF FINISH TOP COAT IN COMPLIANCE WITH THE REQUIREMENTS OF SUBSECTION 2.13.4 OF THE NYC DOT STANDARD HIGHWAY SPECIFICATIONS. THE COLOR OF TOP COAT SHALL BE BLACK.
5. RAILS TO FOLLOW LINE OF GRADE.
6. ALL STEEL TO BE SOLID STEEL.
7. ALL SPIKES OF TREE GUARD TO BE EMBEDDED IN CONCRETE PIERS AS PER STANDARD DRAWINGS

Maedi Tava
 P.E., F. ASCE
 ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
 DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. BIOSWALES - TYPE 'B' WELDED STEEL GUARD

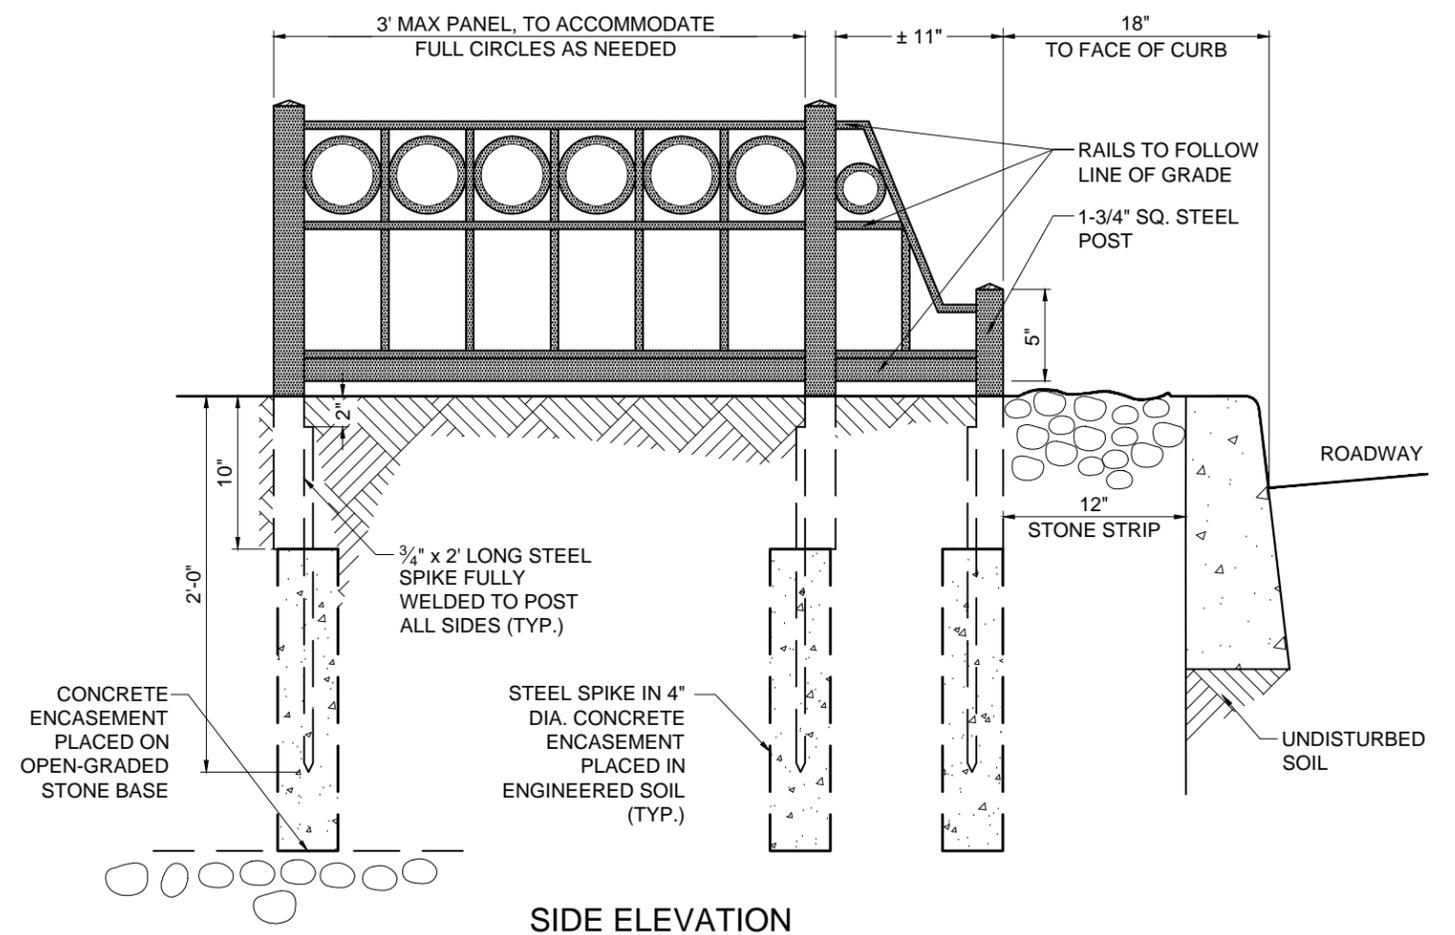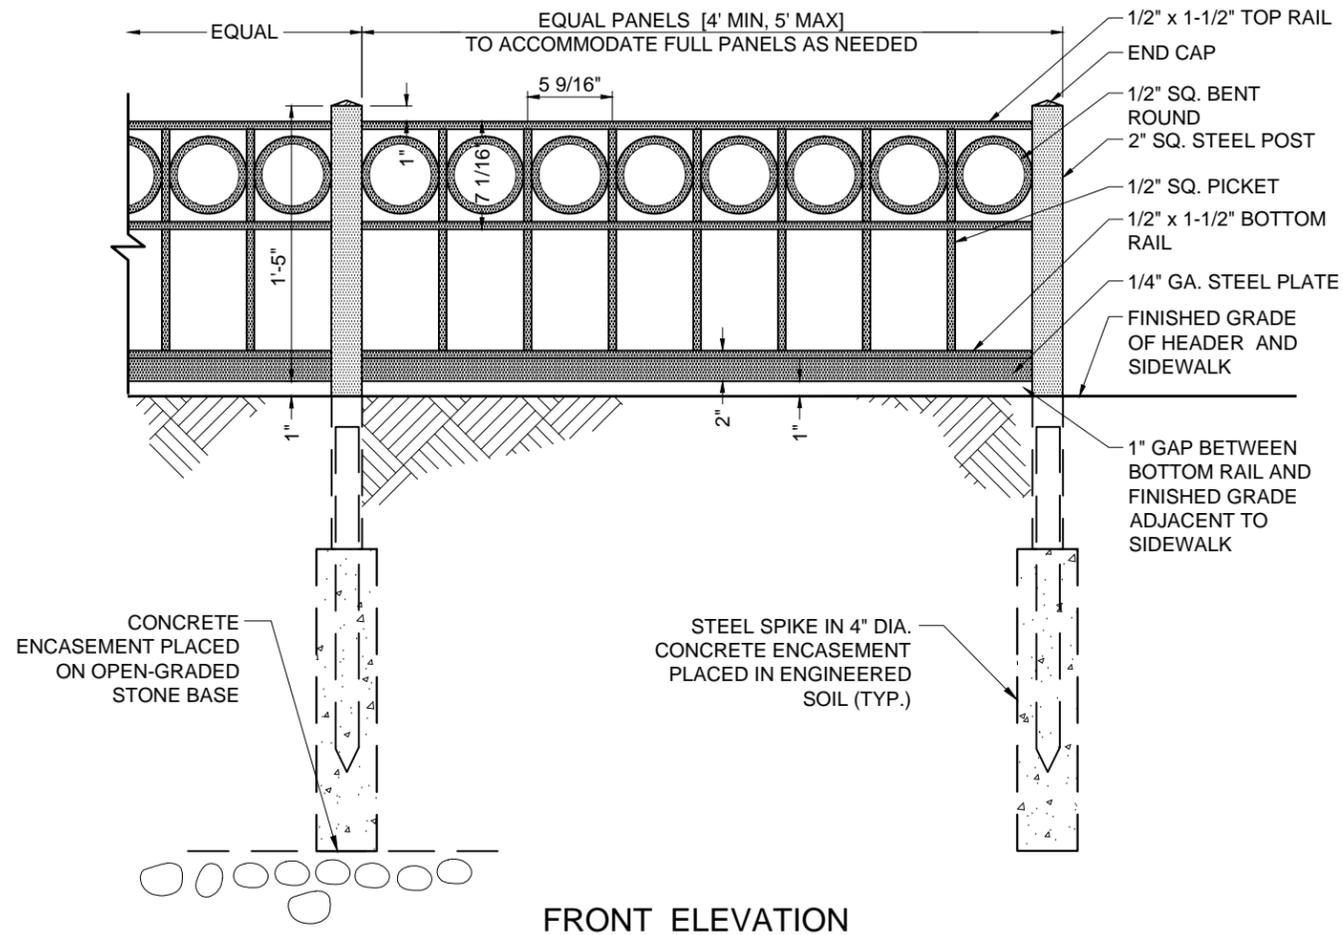

NOTES:



- ** FINAL DESIGN OF GUARDS TO BE SELECTED BY DPR/DOT UPON REVIEW OF NEIGHBORHOOD'S CONTEXT
- 1. FIELD MEASUREMENTS MUST BE TAKEN PRIOR TO FABRICATION.
- 2. ALL STEEL SHALL CONFORM TO SPECIFICATION C1015 OF THE A.I.S.I.
- 3. ALL JOINTS TO BE WELDED UNLESS NOTED OTHERWISE.
- 4. ALL STEEL TO BE PAINTED WITH ONE (1) SHOP COAT OF PRIMER AND ONE (1) SHOP COAT OF INTERMEDIATE AND ONE (1) SHOP COAT (OR ROLLED FIELD COAT) OF FINISH TOP COAT IN COMPLIANCE WITH THE REQUIREMENTS OF SUBSECTION 2.13.4 OF THE NYC DOT STANDARD HIGHWAY SPECIFICATIONS. THE COLOR OF TOP COAT SHALL BE BLACK.
- 5. RAILS TO FOLLOW LINE OF GRADE.
- 6. ALL STEEL TO BE SOLID STEEL.
- 7. ALL SPIKES OF TREE GUARD TO BE EMBEDDED IN CONCRETE PIERS AS PER STANDARD DRAWINGS

Maedi Tana
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. BIOSWALES - TYPE 'C' WELDED STEEL GUARD

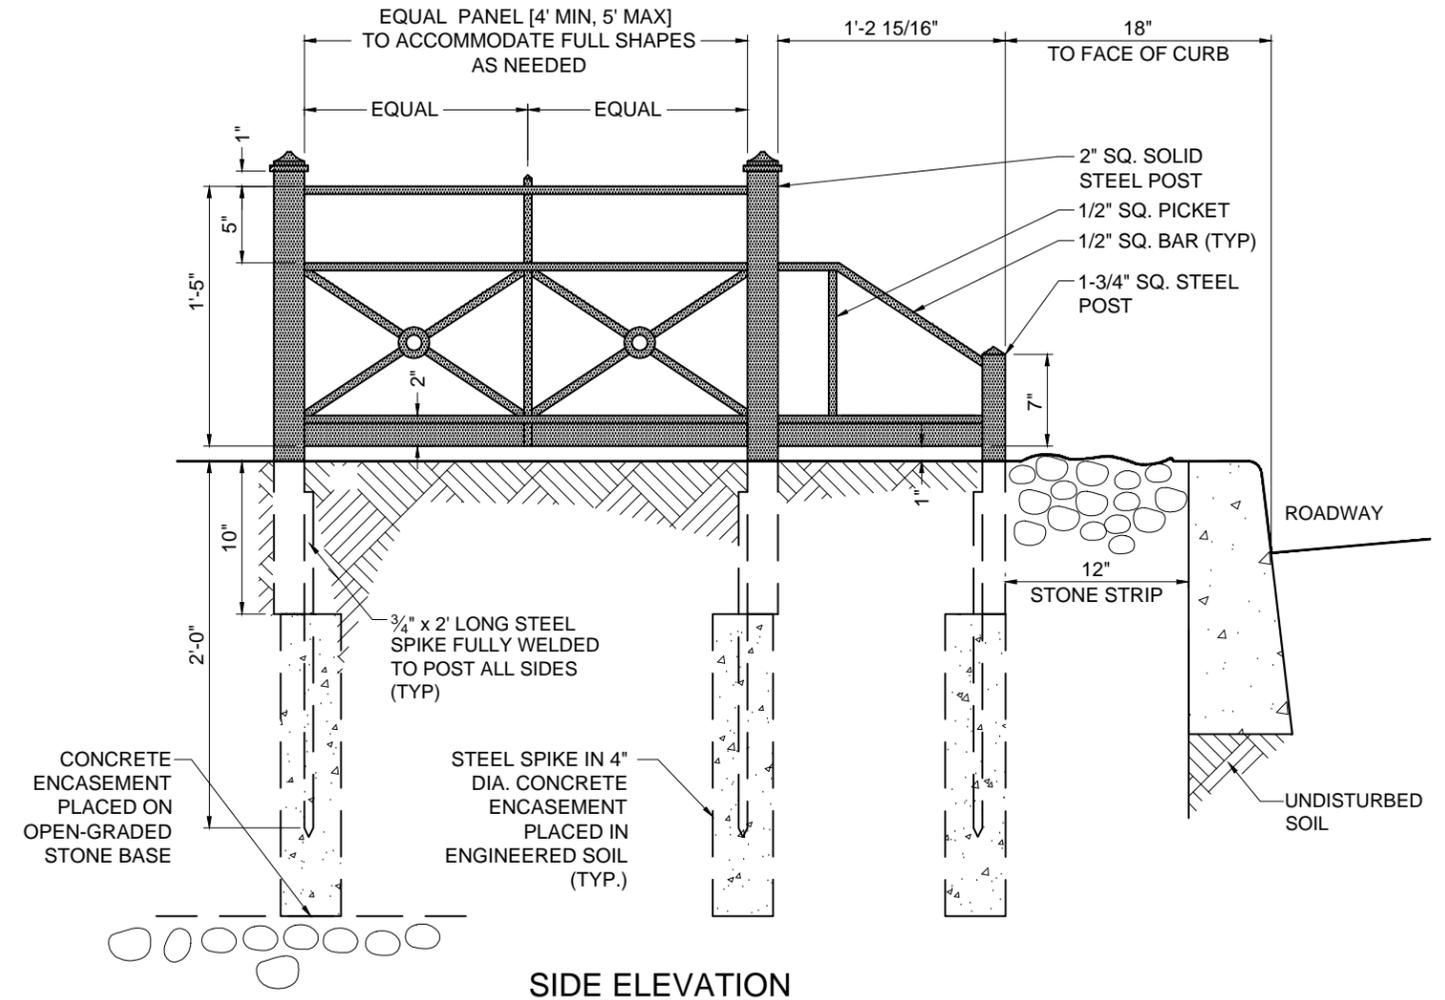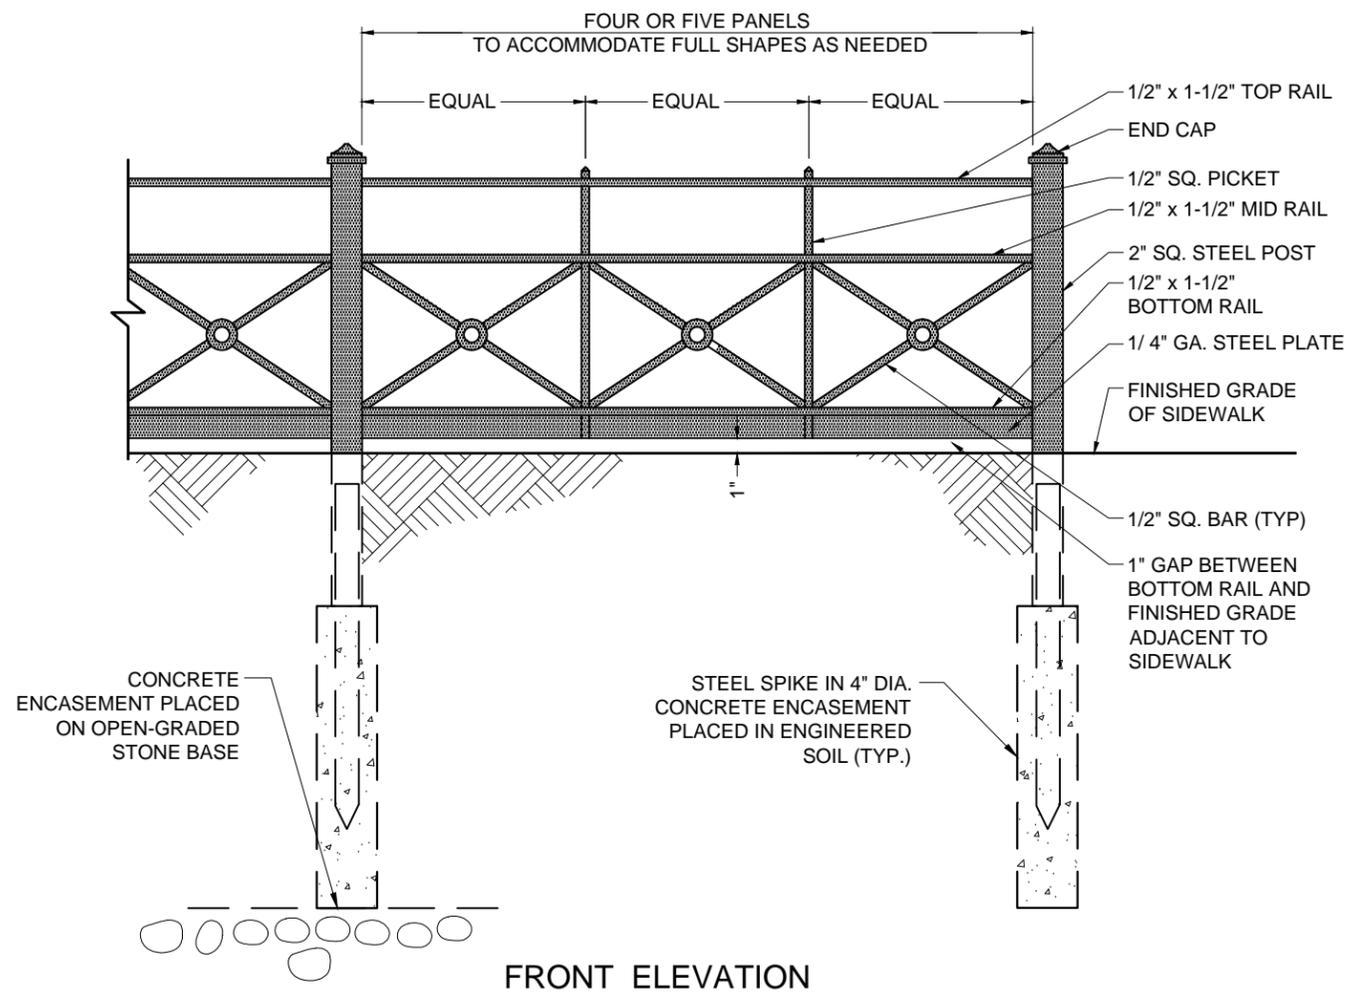

NOTES:


- ** FINAL DESIGN OF GUARDS TO BE SELECTED BY DPR/DOT UPON REVIEW OF NEIGHBORHOOD'S CONTEXT
- 1. FIELD MEASUREMENTS MUST BE TAKEN PRIOR TO FABRICATION.
- 2. ALL STEEL SHALL CONFORM TO SPECIFICATION C1015 OF THE A.I.S.I.
- 3. ALL JOINTS TO BE WELDED UNLESS NOTED OTHERWISE.
- 4. ALL STEEL TO BE PAINTED WITH ONE (1) SHOP COAT OF PRIMER AND ONE (1) SHOP COAT OF INTERMEDIATE AND ONE (1) SHOP COAT (OR ROLLED FIELD COAT) OF FINISH TOP COAT IN COMPLIANCE WITH THE REQUIREMENTS OF SUBSECTION 2.13.4 OF THE NYC DOT STANDARD HIGHWAY SPECIFICATIONS. THE COLOR OF TOP COAT SHALL BE BLACK.
- 5. RAILS TO FOLLOW LINE OF GRADE.
- 6. ALL STEEL TO BE SOLID STEEL.
- 7. ALL SPIKES OF TREE GUARD TO BE EMBEDDED IN CONCRETE PIERS AS PER STANDARD DRAWINGS

Maedi Taha P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. BIOSWALES - TYPE 'D' WELDED STEEL GUARD

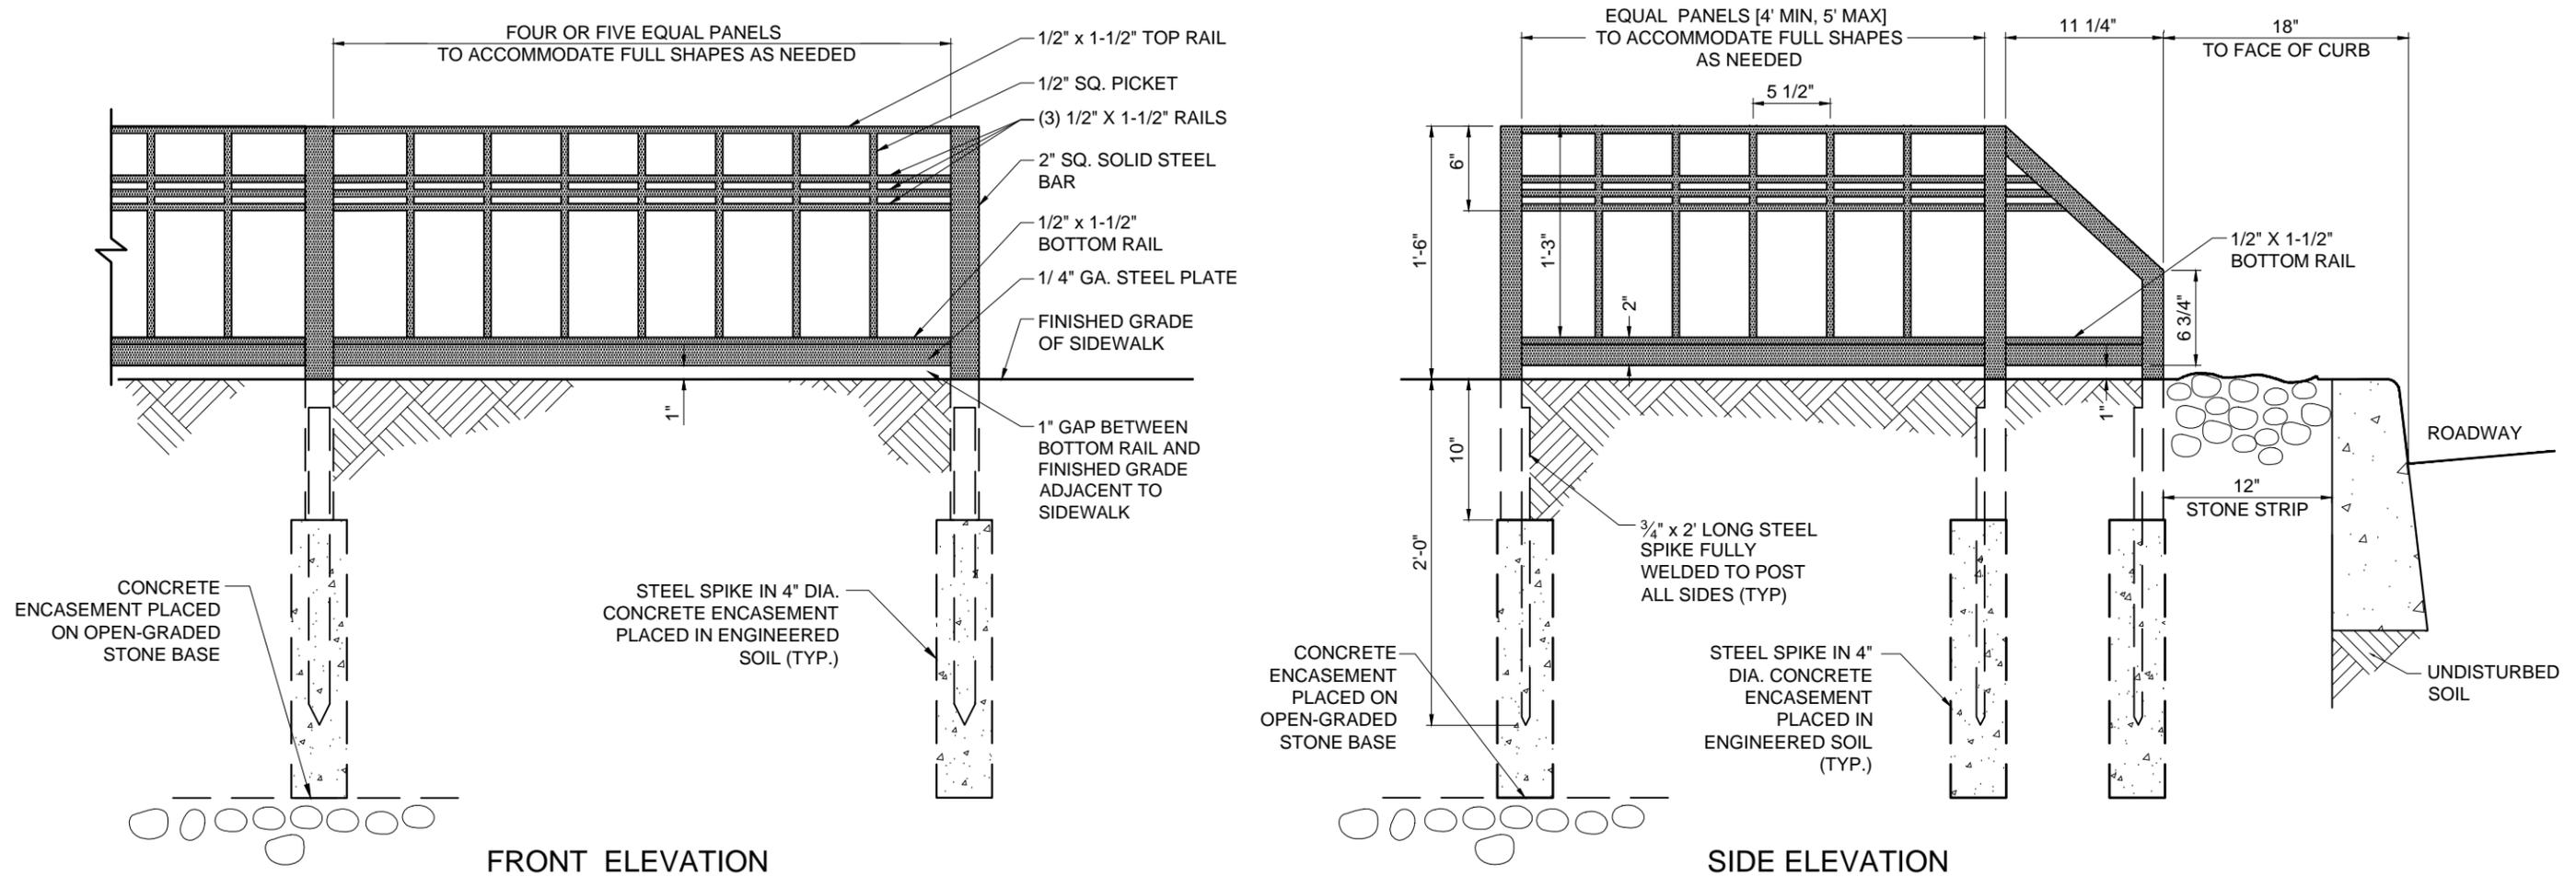

NOTES:


- ** FINAL DESIGN OF GUARDS TO BE SELECTED BY DPR/DOT UPON REVIEW OF NEIGHBORHOOD'S CONTEXT
- 1. FIELD MEASUREMENTS MUST BE TAKEN PRIOR TO FABRICATION.
- 2. ALL STEEL SHALL CONFORM TO SPECIFICATION C1015 OF THE A.I.S.I.
- 3. ALL JOINTS TO BE WELDED UNLESS NOTED OTHERWISE.
- 4. ALL STEEL TO BE PAINTED WITH ONE (1) SHOP COAT OF PRIMER AND ONE (1) SHOP COAT OF INTERMEDIATE AND ONE (1) SHOP COAT (OR ROLLED FIELD COAT) OF FINISH TOP COAT IN COMPLIANCE WITH THE REQUIREMENTS OF SUBSECTION 2.13.4 OF THE NYC DOT STANDARD HIGHWAY SPECIFICATIONS. THE COLOR OF TOP COAT SHALL BE BLACK.
- 5. RAILS TO FOLLOW LINE OF GRADE.
- 6. ALL STEEL TO BE SOLID STEEL.
- 7. ALL SPIKES OF TREE GUARD TO BE EMBEDDED IN CONCRETE PIERS AS PER STANDARD DRAWINGS

Maedi Taha
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE

STANDARD FOR R.O.W. BIOSWALES - TYPE 'B-1' STEEL GUARD WITH BOLTED PANELS

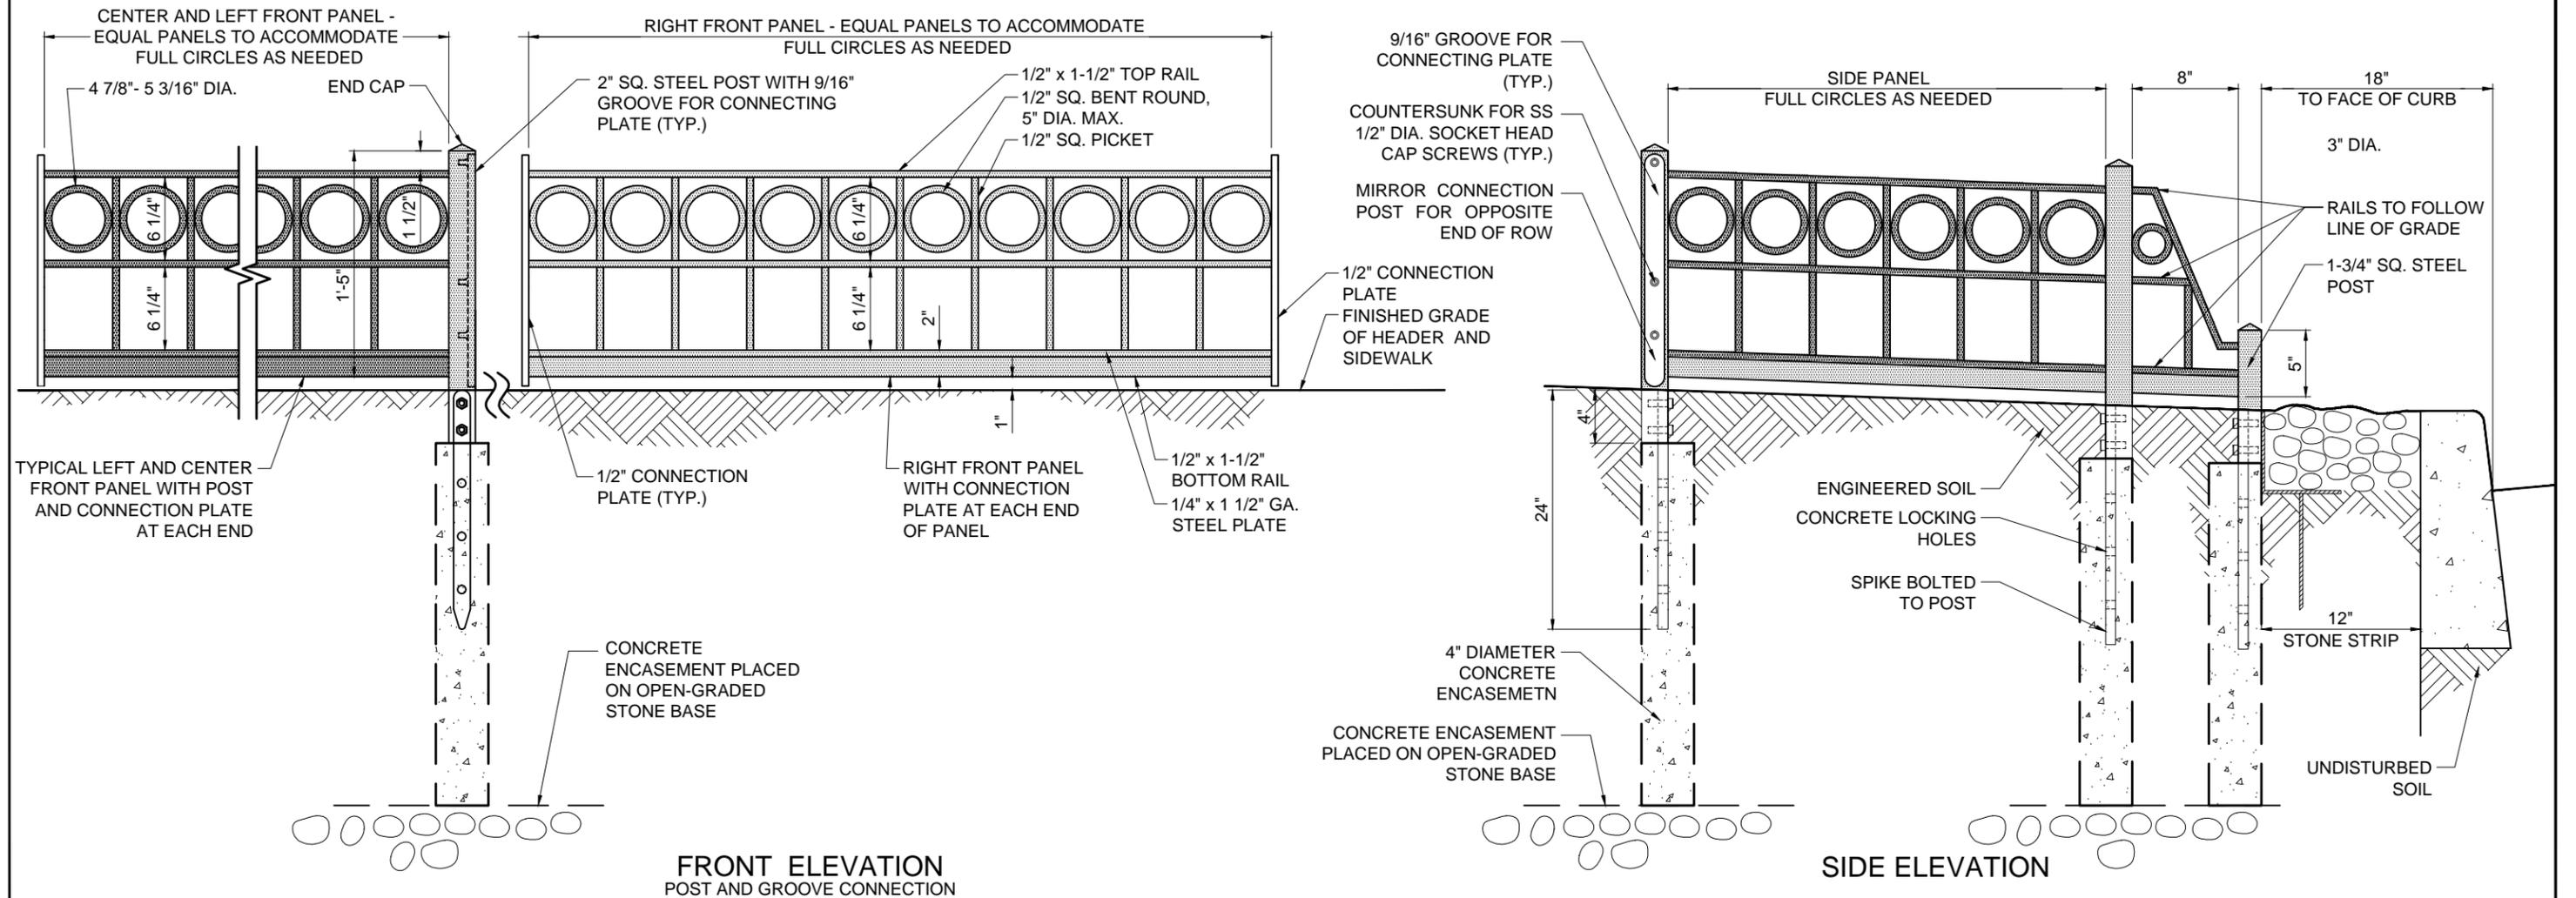

NOTES:

** FINAL DESIGN OF GUARDS TO BE SELECTED BY DPR/DOT UPON REVIEW OF NEIGHBORHOOD'S CONTEXT


1. FIELD MEASUREMENTS MUST BE TAKEN PRIOR TO FABRICATION.
2. ALL STEEL SHALL CONFORM TO ASTM - A36 SPECIFICATION
3. ALL JOINTS TO BE WELDED UNLESS NOTED OTHERWISE.
4. ALL POST AND GROOVE CONNECTIONS TO BE BOLTED.
5. ALL VISIBLE BOLTS TO BE COUNTERSUNK AND FLUSHED WITH THE POSTS
6. ALL STEEL TO BE PAINTED WITH ONE (1) SHOP COAT OF PRIMER AND ONE (1) SHOP COAT OF INTERMEDIATE AND ONE (1) SHOP COAT (OR ROLLED FIELD COAT) OF FINISH TOP COAT IN COMPLIANCE WITH THE REQUIREMENTS OF SUBSECTION 2.13.4 OF THE NYC DOT STANDARD HIGHWAY SPECIFICATIONS. THE COLOR OF TOP COAT SHALL BE BLACK.
7. RAILS TO FOLLOW LINE OF GRADE.
8. ALL SPIKES OF TREE GUARD TO BE EMBEDDED IN CONCRETE PIERS AS PER STANDARD DRAWINGS

Maedi Tana
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION


03-07-2016
DATE

CITY OF NEW YORK
DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF GREEN INFRASTRUCTURE


STANDARD DETAILS FOR R.O.W. BIOSWALES - TYPE 'B-1' STEEL GUARD WITH BOLTED PANELS

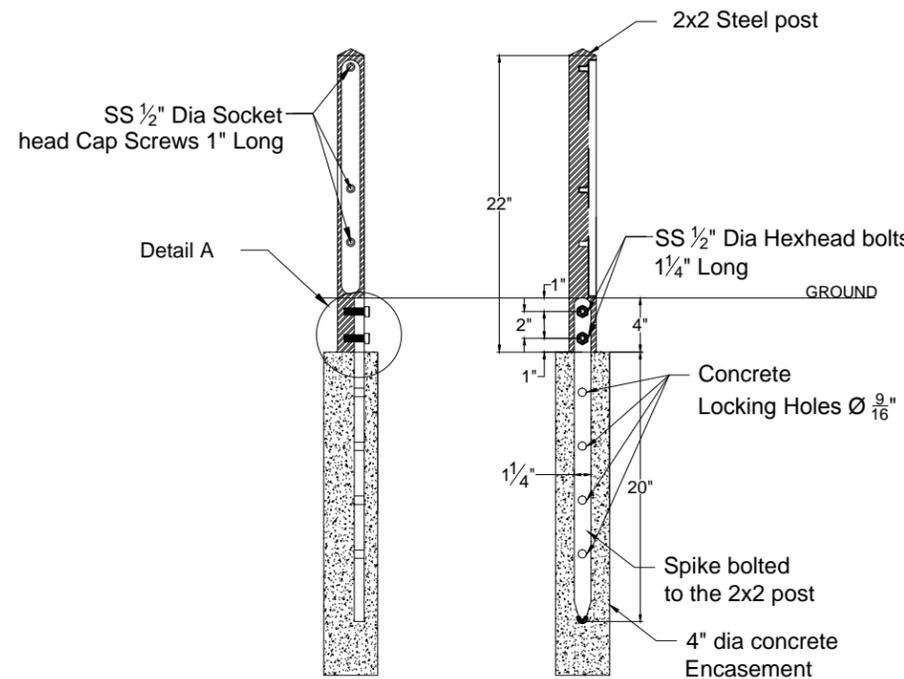


STEEL POST 2"X2"

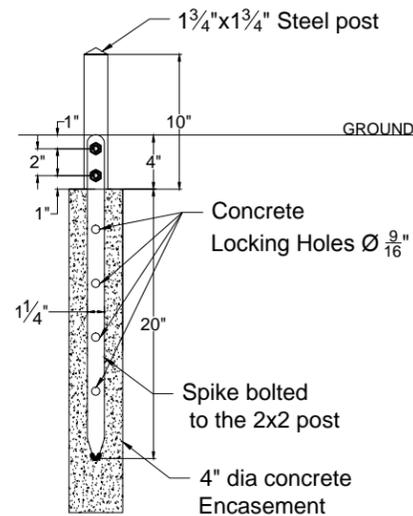


STEEL POST 1 3/4"X1 3/4"




Detail - A
Spike Embedded in machined groove of the post for additional strength and support

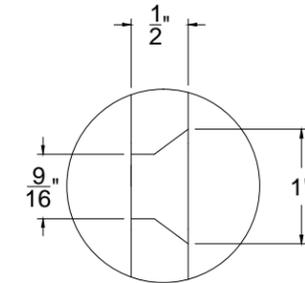

Detail - B
Countersunk for Socket Head Cap Screws

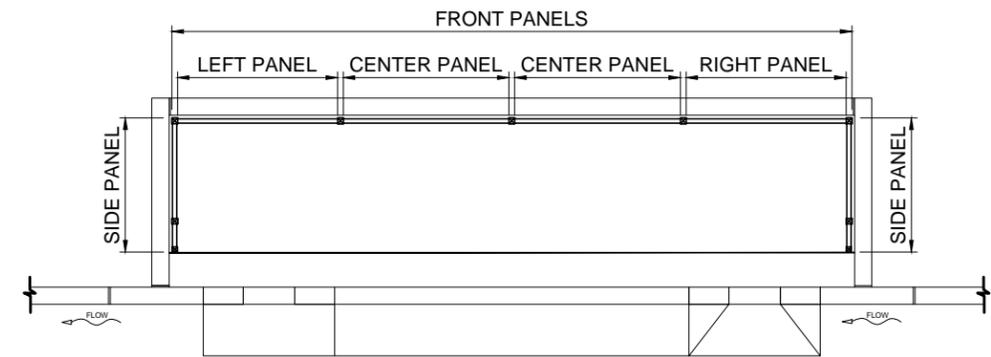


FRONT AND SIDE PANELS - PLAN

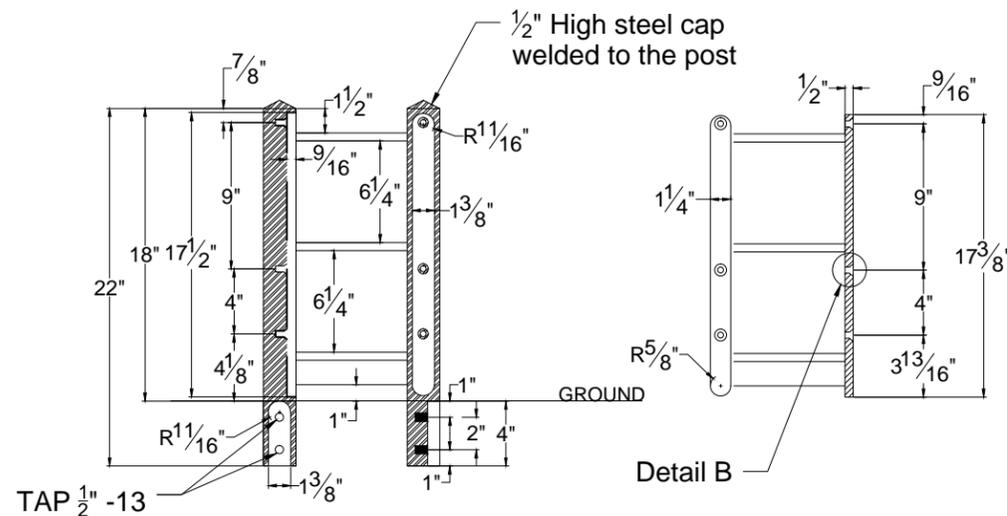

POST AND GROOVE

CONNECTION PLATE

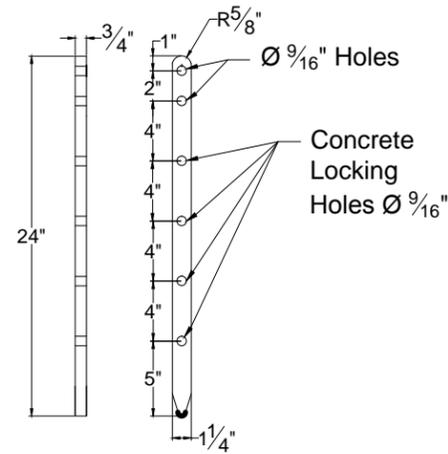

SPIKE

ROW TYPE	ROWB, ROWRG LENGTH, FT	PANELS REQUIRED	LENGTH OF FRONT PANELS, IN			
			LEFT	CENTER	CENTER	RIGHT
TYPE 1	20	4	56	58	58	56
	19	4	56	52	52	56
	18	4	50	52	52	50
	17	4	50	46	46	50
TYPE 2	16	3	62	58	N/A	62
	15	3	56	58	N/A	56
	14	3	50	58	N/A	50
TYPE 3	13	3	50	46	N/A	50
	12	3	44	46	N/A	44
	11	2	62	N/A	N/A	62
	10	2	56	N/A	N/A	56

FRONT PANELS SCHEDULE

ROWB, ROWRG WIDTH, FT	SIDE PANEL LENGTH, IN
4'-0"	36
4'-6"	42
5'-0"	48

SIDE PANELS SCHEDULE

Maedi Tana
P.E., F. ASCE
ASSISTANT COMMISSIONER, OFFICE OF GREEN INFRASTRUCTURE
DEPARTMENT OF ENVIRONMENTAL PROTECTION

03-07-2016
DATE