



CROSS CONNECTION CONTROL RISK ASSESSMENT

General Domestic

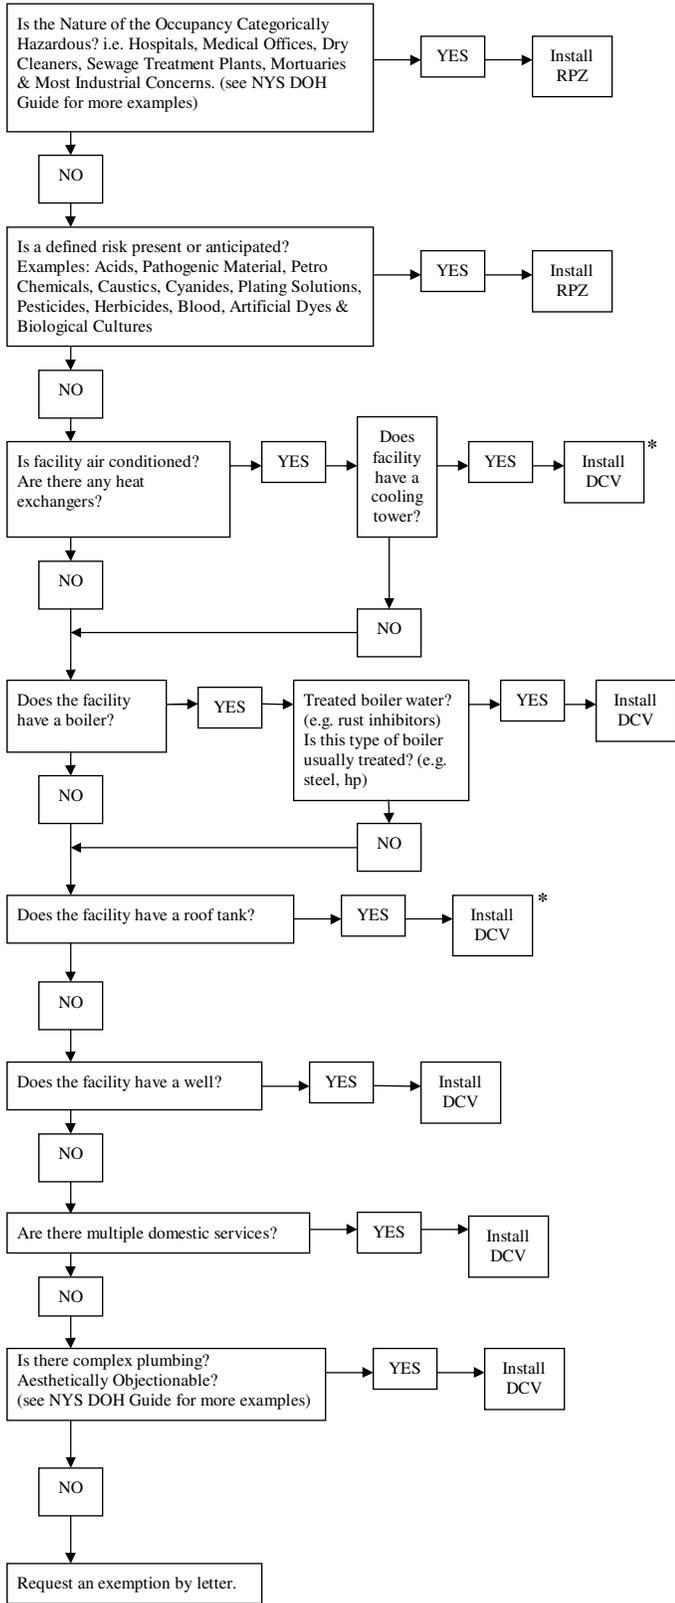

General Fire Sprinkler/Standpipe

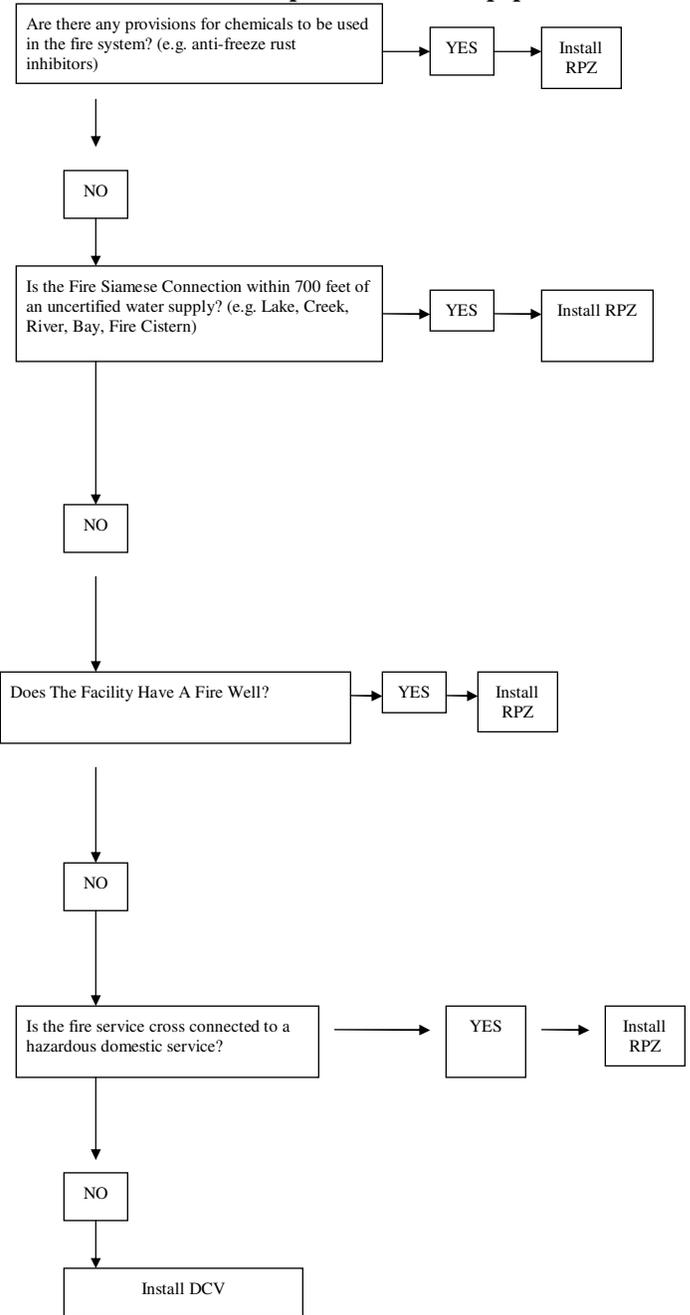

DCV = approved Double Check Valve Assembly
RPZ = approved Reduced Pressure Zone Device

* For facilities with roof tanks, cooling towers or treated boilers, DCV's may be installed provided that internal protective devices are installed in accordance with the Department of Building requirements.